



ITEM NO.	W14-EH-4706 A/B
SERVICE	RO CIP TANK ELECTRIC HEATER
QTY	2
MAT'L	STS316L
POWER KW	101



電 氣 SCALE	NONE
日 時 DATE	2025. 08. 14
PROJ. NO.	223300
도면번호 SHEET NO.	CJ-W15H14-PR-A20-000312 1A

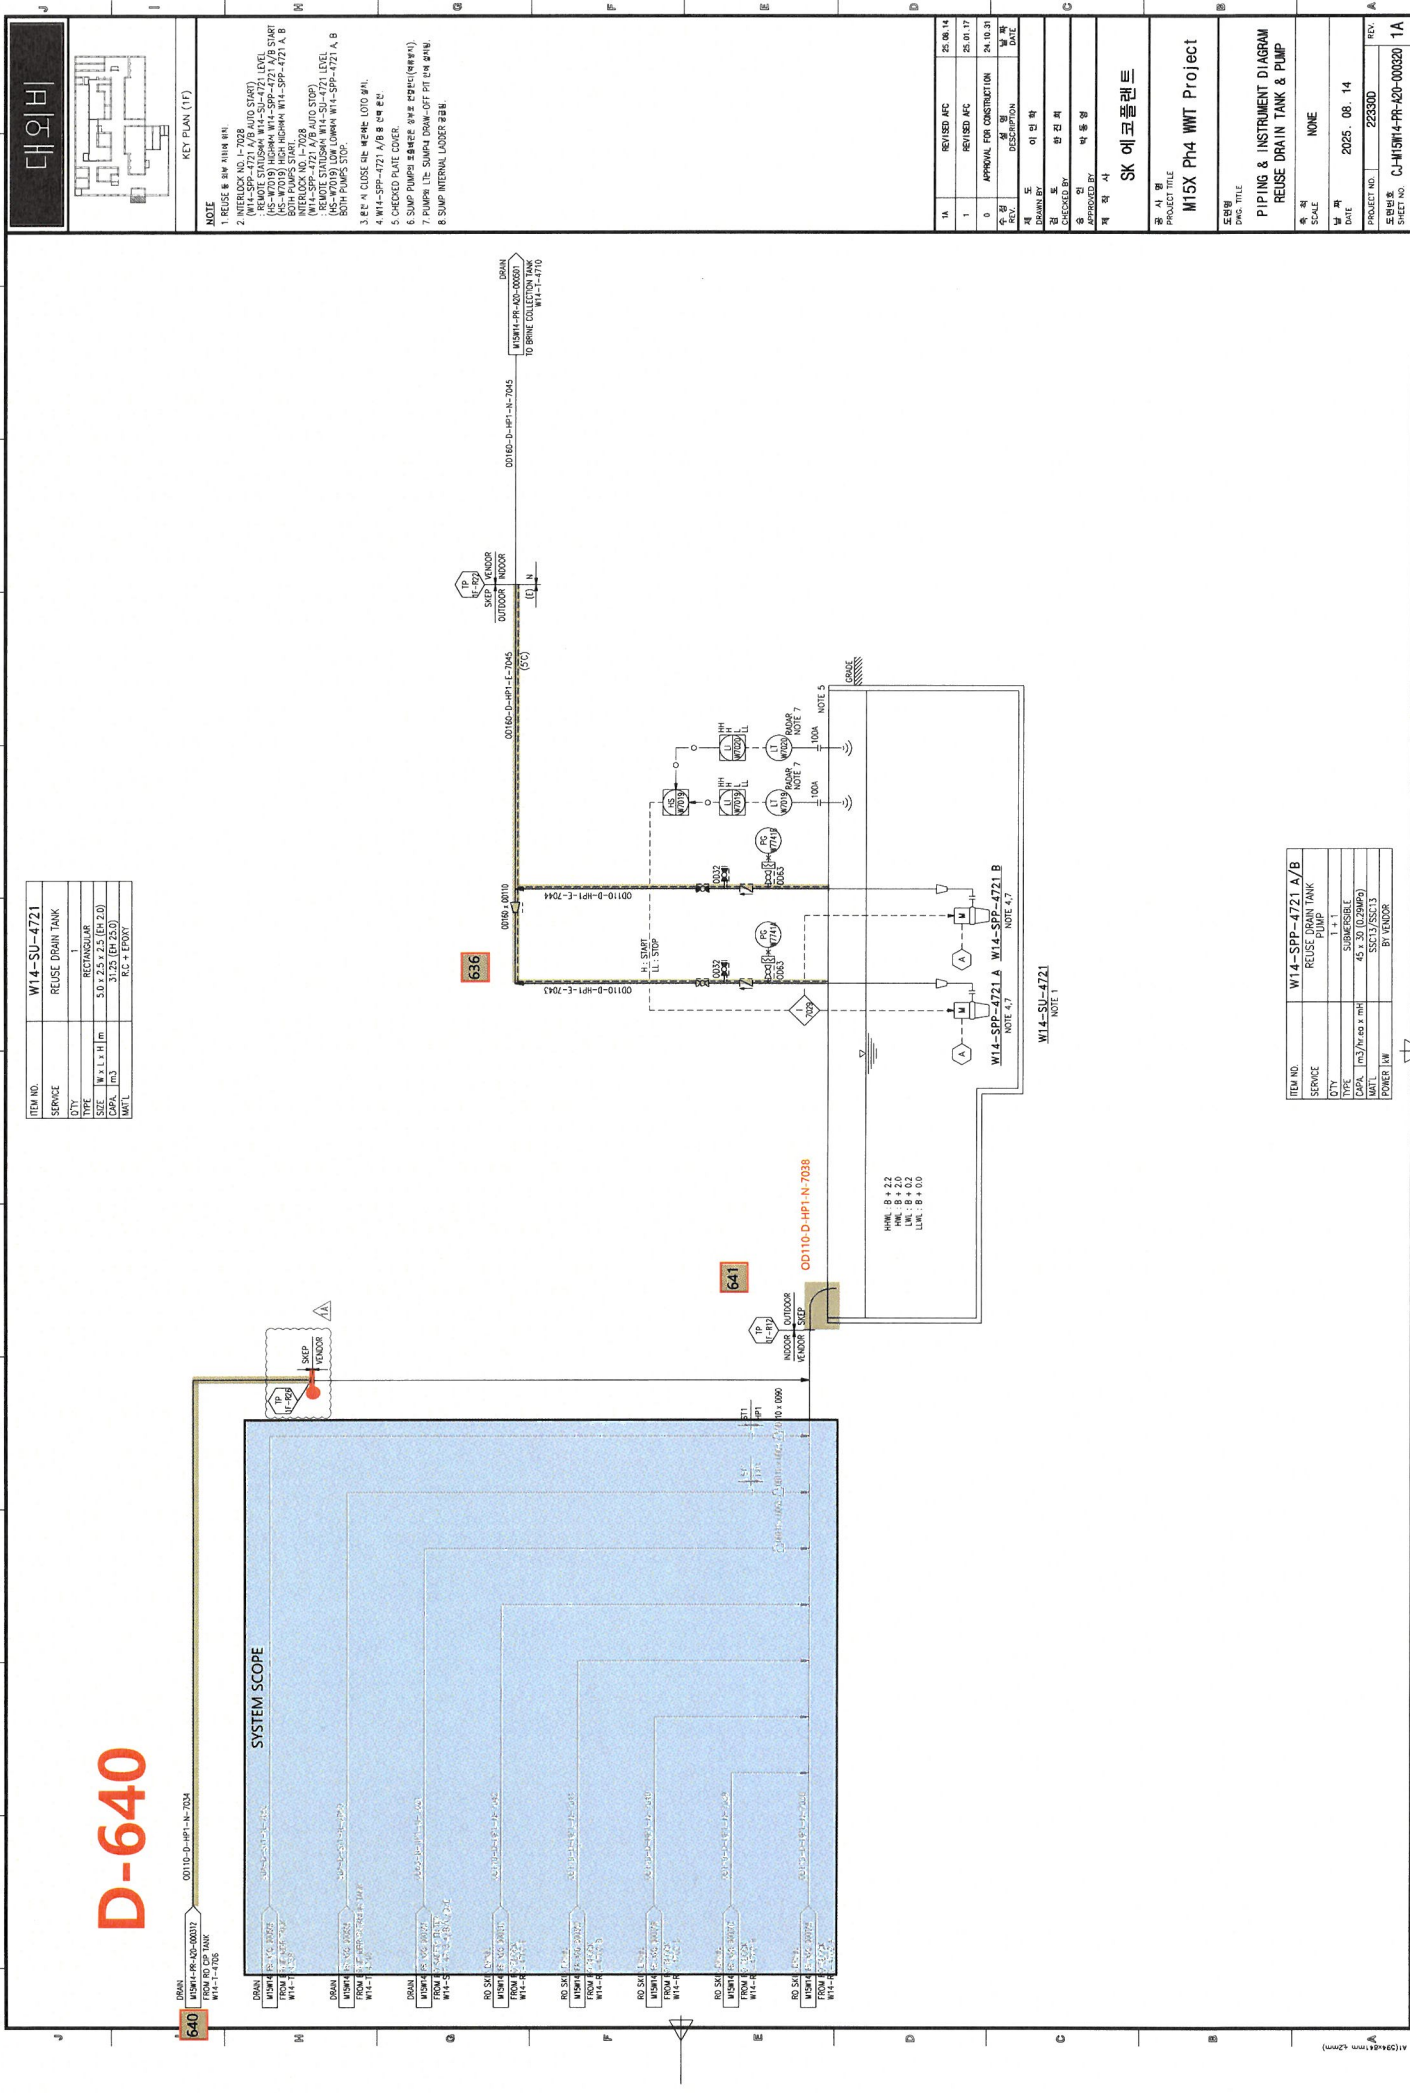

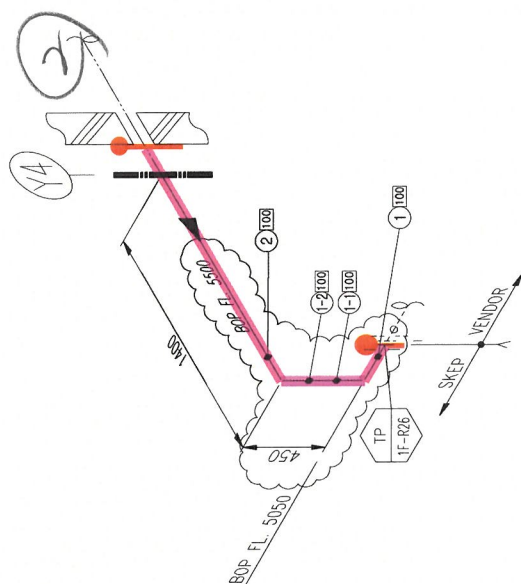

<NOTE>
1. TRAY & ANGLE, CHANNEL SUPPORT가 적용되는
배관 ELEVATION은 한장 잊음으로 한다.
2. (*) FIELD ADJUST

PPPE - P/P1	90° ELBOW - L30	45° ELBOW - L45	TEE - T	REDUCER - TR	STUB-IN - SU1	REINFORCING PAD - RP	CONCRETE - RC	COLLECTOR - CE	CONSUMABLE - MCS/ACS1	FEED SOURCE - RES/RES1	WIPPLE - WP/IMP/IMP2	PLUG - PLG	FULL COUPLING - FC	HAIF COUPLING - HF/H1
STUB-IN - SU2	SOCKET/HEP/PCV - SC	SADDLE/HEP/PCV - SC	FLANGE - F/F1	CASKET - C/GS/G2	BLIND FLANGE - FB/FB1	BOLT & NUT - B/N	FLANGE JOINT/FLANGE JOINT PTFE LINED - FJL	FLEXIBLE JOINT/FLANGE JOINT PTFE LINED - FJL	STUB-IN - SU3	ANCHOR BOLT - STUB	STRANCHER/ROCKET - TP/STR	STRANCHER - TP/STR	STRANCHER - TP/STR	STRANCHER - TP/STR
STUB-IN - SU4	STUB-IN - SU5	STUB-IN - SU6	STUB-IN - SU7	STUB-IN - SU8	STUB-IN - SU9	STUB-IN - SU10	STUB-IN - SU11	STUB-IN - SU12	STUB-IN - SU13	STUB-IN - SU14	STUB-IN - SU15	STUB-IN - SU16	STUB-IN - SU17	STUB-IN - SU18
STUB-IN - SU19	STUB-IN - SU20	STUB-IN - SU21	STUB-IN - SU22	STUB-IN - SU23	STUB-IN - SU24	STUB-IN - SU25	STUB-IN - SU26	STUB-IN - SU27	STUB-IN - SU28	STUB-IN - SU29	STUB-IN - SU30	STUB-IN - SU31	STUB-IN - SU32	STUB-IN - SU33
STUB-IN - SU34	STUB-IN - SU35	STUB-IN - SU36	STUB-IN - SU37	STUB-IN - SU38	STUB-IN - SU39	STUB-IN - SU40	STUB-IN - SU41	STUB-IN - SU42	STUB-IN - SU43	STUB-IN - SU44	STUB-IN - SU45	STUB-IN - SU46	STUB-IN - SU47	STUB-IN - SU48
STUB-IN - SU49	STUB-IN - SU50	STUB-IN - SU51	STUB-IN - SU52	STUB-IN - SU53	STUB-IN - SU54	STUB-IN - SU55	STUB-IN - SU56	STUB-IN - SU57	STUB-IN - SU58	STUB-IN - SU59	STUB-IN - SU60	STUB-IN - SU61	STUB-IN - SU62	STUB-IN - SU63
STUB-IN - SU64	STUB-IN - SU65	STUB-IN - SU66	STUB-IN - SU67	STUB-IN - SU68	STUB-IN - SU69	STUB-IN - SU70	STUB-IN - SU71	STUB-IN - SU72	STUB-IN - SU73	STUB-IN - SU74	STUB-IN - SU75	STUB-IN - SU76	STUB-IN - SU77	STUB-IN - SU78
STUB-IN - SU79	STUB-IN - SU80	STUB-IN - SU81	STUB-IN - SU82	STUB-IN - SU83	STUB-IN - SU84	STUB-IN - SU85	STUB-IN - SU86	STUB-IN - SU87	STUB-IN - SU88	STUB-IN - SU89	STUB-IN - SU90	STUB-IN - SU91	STUB-IN - SU92	STUB-IN - SU93
STUB-IN - SU94	STUB-IN - SU95	STUB-IN - SU96	STUB-IN - SU97	STUB-IN - SU98	STUB-IN - SU99	STUB-IN - SU100	STUB-IN - SU101	STUB-IN - SU102	STUB-IN - SU103	STUB-IN - SU104	STUB-IN - SU105	STUB-IN - SU106	STUB-IN - SU107	STUB-IN - SU108
STUB-IN - SU109	STUB-IN - SU110	STUB-IN - SU111	STUB-IN - SU112	STUB-IN - SU113	STUB-IN - SU114	STUB-IN - SU115	STUB-IN - SU116	STUB-IN - SU117	STUB-IN - SU118	STUB-IN - SU119	STUB-IN - SU120	STUB-IN - SU121	STUB-IN - SU122	STUB-IN - SU123
STUB-IN - SU124	STUB-IN - SU125	STUB-IN - SU126	STUB-IN - SU127	STUB-IN - SU128	STUB-IN - SU129	STUB-IN - SU130	STUB-IN - SU131	STUB-IN - SU132	STUB-IN - SU133	STUB-IN - SU134	STUB-IN - SU135	STUB-IN - SU136	STUB-IN - SU137	STUB-IN - SU138
STUB-IN - SU139	STUB-IN - SU140	STUB-IN - SU141	STUB-IN - SU142	STUB-IN - SU143	STUB-IN - SU144	STUB-IN - SU145	STUB-IN - SU146	STUB-IN - SU147	STUB-IN - SU148	STUB-IN - SU149	STUB-IN - SU150	STUB-IN - SU151	STUB-IN - SU152	STUB-IN - SU153
STUB-IN - SU154	STUB-IN - SU155	STUB-IN - SU156	STUB-IN - SU157	STUB-IN - SU158	STUB-IN - SU159	STUB-IN - SU160	STUB-IN - SU161	STUB-IN - SU162	STUB-IN - SU163	STUB-IN - SU164	STUB-IN - SU165	STUB-IN - SU166	STUB-IN - SU167	STUB-IN - SU168
STUB-IN - SU169	STUB-IN - SU170	STUB-IN - SU171	STUB-IN - SU172	STUB-IN - SU173	STUB-IN - SU174	STUB-IN - SU175	STUB-IN - SU176	STUB-IN - SU177	STUB-IN - SU178	STUB-IN - SU179	STUB-IN - SU180	STUB-IN - SU181	STUB-IN - SU182	STUB-IN - SU183
STUB-IN - SU184	STUB-IN - SU185	STUB-IN - SU186	STUB-IN - SU187	STUB-IN - SU188	STUB-IN - SU189	STUB-IN - SU190	STUB-IN - SU191	STUB-IN - SU192	STUB-IN - SU193	STUB-IN - SU194	STUB-IN - SU195	STUB-IN - SU196	STUB-IN - SU197	STUB-IN - SU198
STUB-IN - SU199	STUB-IN - SU200	STUB-IN - SU201	STUB-IN - SU202	STUB-IN - SU203	STUB-IN - SU204	STUB-IN - SU205	STUB-IN - SU206	STUB-IN - SU207	STUB-IN - SU208	STUB-IN - SU209	STUB-IN - SU210	STUB-IN - SU211	STUB-IN - SU212	STUB-IN - SU213
STUB-IN - SU214	STUB-IN - SU215	STUB-IN - SU216	STUB-IN - SU217	STUB-IN - SU218	STUB-IN - SU219	STUB-IN - SU220	STUB-IN - SU221	STUB-IN - SU222	STUB-IN - SU223	STUB-IN - SU224	STUB-IN - SU225	STUB-IN - SU226	STUB-IN - SU227	STUB-IN - SU228
STUB-IN - SU229	STUB-IN - SU230	STUB-IN - SU231	STUB-IN - SU232	STUB-IN - SU233	STUB-IN - SU234	STUB-IN - SU235	STUB-IN - SU236	STUB-IN - SU237	STUB-IN - SU238	STUB-IN - SU239	STUB-IN - SU240	STUB-IN - SU241	STUB-IN - SU242	STUB-IN - SU243
STUB-IN - SU244	STUB-IN - SU245	STUB-IN - SU246	STUB-IN - SU247	STUB-IN - SU248	STUB-IN - SU249	STUB-IN - SU250	STUB-IN - SU251	STUB-IN - SU252	STUB-IN - SU253	STUB-IN - SU254	STUB-IN - SU255	STUB-IN - SU256	STUB-IN - SU257	STUB-IN - SU258
STUB-IN - SU259	STUB-IN - SU260	STUB-IN - SU261	STUB-IN - SU262	STUB-IN - SU263	STUB-IN - SU264	STUB-IN - SU265	STUB-IN - SU266	STUB-IN - SU267	STUB-IN - SU268	STUB-IN - SU269	STUB-IN - SU270	STUB-IN - SU271	STUB-IN - SU272	STUB-IN - SU273
STUB-IN - SU274	STUB-IN - SU275	STUB-IN - SU276	STUB-IN - SU277	STUB-IN - SU278	STUB-IN - SU279	STUB-IN - SU280	STUB-IN - SU281	STUB-IN - SU282	STUB-IN - SU283	STUB-IN - SU284	STUB-IN - SU285	STUB-IN - SU286		

[illegible]

결과 : 본 도면은 SK HYUNIX의 기업비밀 자료로서, 어떠한 경우에도 목격과 사용, 복제, 제3자에게 공개, 누설 및 유포할 수 없으며, 회사나 유모자의 판단에 따라 필요할 때 정당한 방법으로 피행기 행위를 방지할 권리가 있음.

[illegible]

INSULATION	CODE THICK.	N	CONDITION	PRESS. (kg/cm ²)	TEMP. (°C)	AREA	W14		
		-	DESIGN	6.3	60	UNIT	1FA		
			OPERATING	4.7	AMB	REF. PLAN DWG.			
						CJ-M15W14-PI-A30-010006-B			
						REF. P & ID			
						CJ-M15W14-PR-A20-000312			
						APPROVED FOR CONSTRUCTION			
						DATE	74.12.20		
						REV.			
						DESCRIPTION			
						BY	CHK		
						APP'D			

[illegible]

CLIENT



CONTRACTOR	 SK ecoplant	PROJECT NAME	M15X P14 Project
COMMODITY	D	JOB NO.	223300
LINE NO.	00110-D-HF1-N-7034	SHT NO.	REV.
		01 / 01	0

PUNCH LIST

Project No : 22330D

Package No :

Project Title : M15X Ph3 Project

Date :

S/N	Drawing No	Description	Category A B C	Punch Clear Status			
				작성자		확인자	
				Name	Sign	Name	Sign
1							
2							
3							
4							
5							
6							
7							
8							
9							
10							
11							
12							
13							
14							
15							

Remarks

A : Before Hydro Test

B : Before M/C

C : Before Commissioning