

Indoor Units: 1 / 1 to 1
Capacity: 6 / 3 to 6 (100.0%)
* Connectable capacity is not actual capacity.
Total Pipe Length: 12.0 / 65.0 feet

Correction Factors

Temperature: 1.02 1.59
Piping Length: 1.00 1.00
Defrosting: - 1.00
User Derate: 1.00 1.00

Total Derate: 1.02 1.59
Additional Refrigerant: 0.00 lb
Total Refrigerant Amount: 2.56 lb


Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
Outdoor DB 95.0

Heating

Indoor DB 70.0
Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

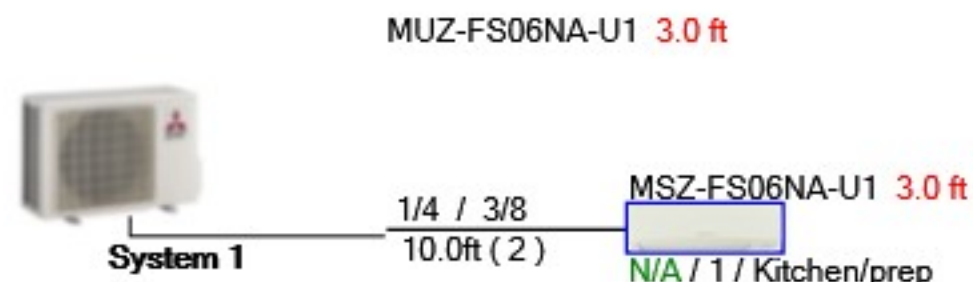

Pipe Dia. Liquid / Gas	Model Number	Elevation	Clg.Total (Sens.)
Pipe Length (Elbows)	Address/Group / Room / Tag Ref.	Htg.Total	

6,097 BTU/h (5,794 BTU/h)
13,799 BTU/h

Est. Cooling Discharge Air Temp: 67.5
Est. Heating Discharge Air Temp: 99.3

Indoor Units: 1 / 1 to 1
Capacity: 6 / 3 to 6 (100.0%)
* Connectable capacity is not actual capacity.
Total Pipe Length: 12.0 / 65.0 feet

Correction Factors

Temperature: 1.02 1.59
Piping Length: 1.00 1.00
Defrosting: - 1.00
User Derate: 1.00 1.00

Total Derate: 1.02 1.59
Additional Refrigerant: 0.00 lb
Total Refrigerant Amount: 2.56 lb


Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
Outdoor DB 95.0

Heating

Indoor DB 70.0
Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

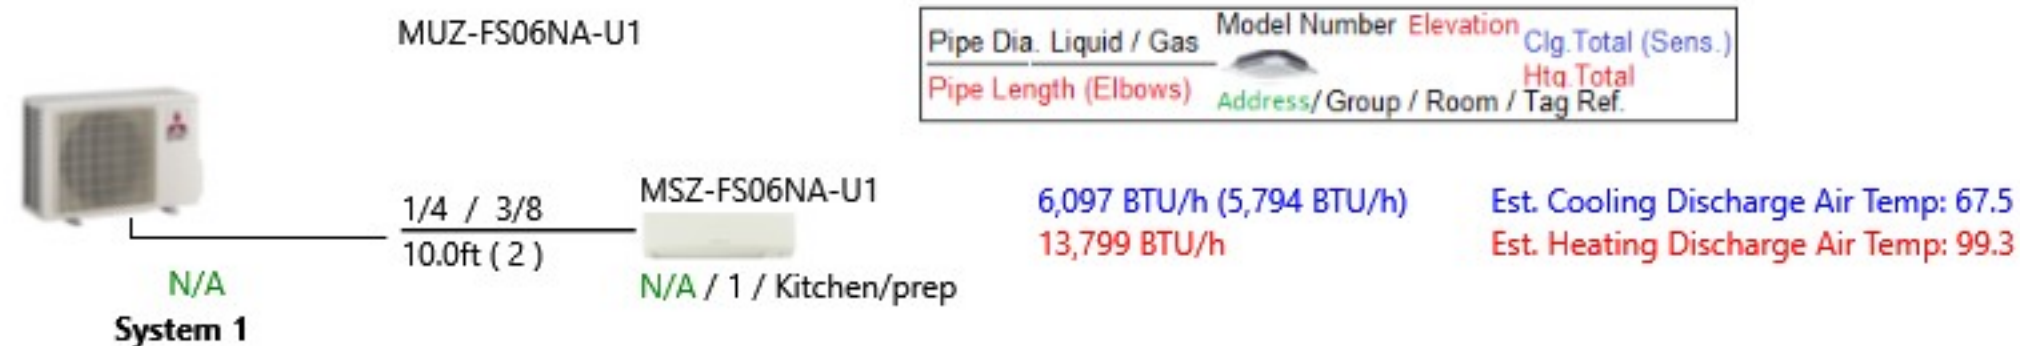

OutdoorUnit 1

Address: N/A

IndoorUnit 1

Address: N/A

Size: 6

Port: 1

Line Size:

1/4x3/8

To: OutdoorUnit 1

Indoor Units: 1 / 1 to 1
Capacity: 6 / 3 to 6 (100.0%)
* Connectable capacity is not actual capacity.
Total Pipe Length: 12.0 / 65.0 feet

Correction Factors

Temperature: 1.02 1.59
Piping Length: 1.00 1.00
Defrosting: - 1.00
User Derate: 1.00 1.00

Total Derate: 1.02 1.59
Additional Refrigerant: 0.00 lb
Total Refrigerant Amount: 2.56 lb

Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
Outdoor DB 95.0

Heating

Indoor DB 70.0
Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

Centralized System - 2		BMS Interfaces	Input/Output Devices	Accessory Panels										
Groups	Indoor/Outdoor Units Lossnays		Local Remote Controllers	System Remote Controllers										
 1 Group 1	<table><tr><td>N/A</td><td>MandS</td><td></td></tr><tr><td colspan="3">MSZ-FS06NA-U1</td></tr><tr><td>Kitchen/prep</td><td colspan="2">IndoorUnit 1</td></tr></table>		N/A	MandS		MSZ-FS06NA-U1			Kitchen/prep	IndoorUnit 1				
N/A	MandS													
MSZ-FS06NA-U1														
Kitchen/prep	IndoorUnit 1													

Indoor Units: 1 / 1 to 1
Capacity: 6 / 3 to 6 (100.0%)
* Connectable capacity is not actual capacity.
Total Pipe Length: 12.0 / 65.0 feet

Correction Factors

Temperature: 1.02 1.59
Piping Length: 1.00 1.00
Defrosting: - 1.00
User Derate: 1.00 1.00

Total Derate: 1.02 1.59
Additional Refrigerant: 0.00 lb
Total Refrigerant Amount: 2.56 lb

Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
Outdoor DB 95.0

Heating

Indoor DB 70.0
Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0



Drop PC or Switch

