

Indoor Units:	2 / 2 to 2
Capacity:	18 / 10 to 24
* Connectable capacity is not actual capacity.	
Total Pipe Length:	32.0 / 164.0 feet
Furthest Actual:	30.0 / 82.0 feet
Furthest Equiv.:	32.0 / 82.0 feet
Correction Factors	
Outdoor Unit Capacity:	1.00 1.00
Temperature:	0.99 1.00
Piping Length:	0.99 1.00
Defrosting:	- 1.00
User Derate:	1.00 1.00
Total Derate:	0.99 1.00
Additional Refrigerant:	0.00 lb
Total Refrigerant Amount:	5.93 lb

Conditions (°F)

Cooling


Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0

Outdoor DB 95.0

Heating

Indoor DB 70.0

Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

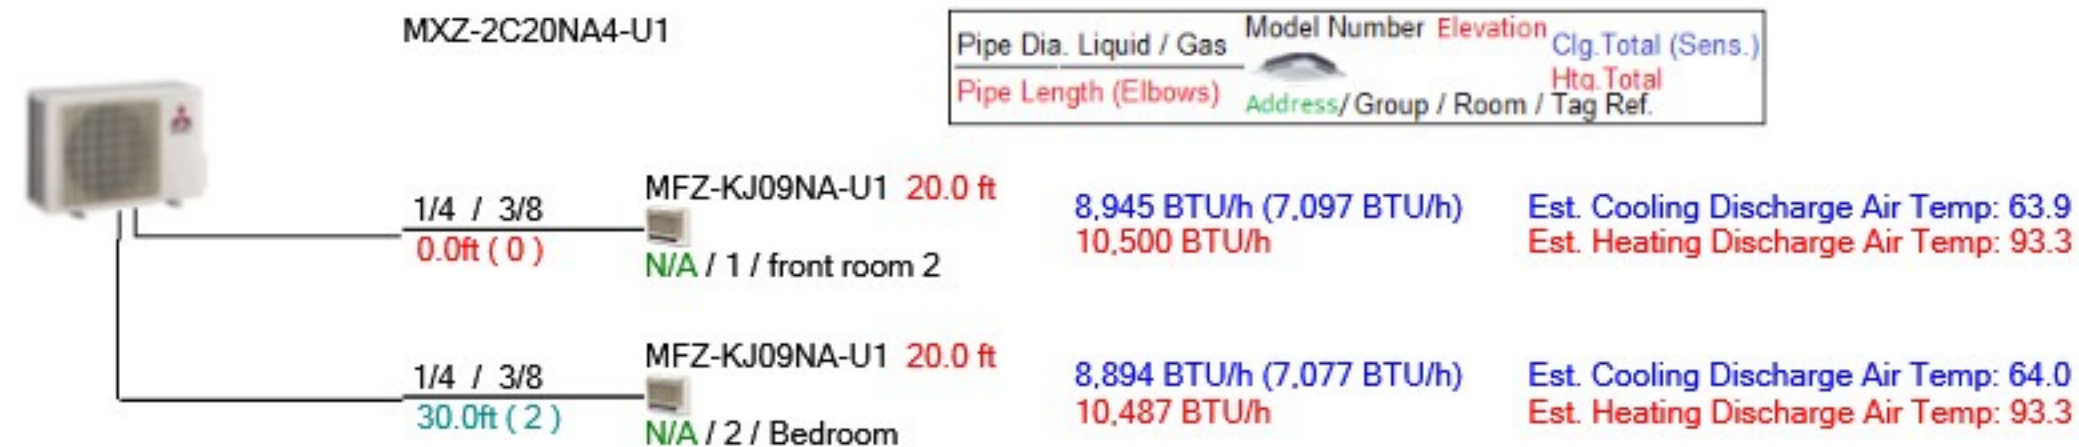

Indoor Units: 2 / 2 to 2
 Capacity: 18 / 10 to 24
 * Connectable capacity is not actual capacity.
 Total Pipe Length: 32.0 / 164.0 feet
 Furthest Actual: 30.0 / 82.0 feet
 Furthest Equiv.: 32.0 / 82.0 feet

Correction Factors

Outdoor Unit Capacity: 1.00 1.00
 Temperature: 0.99 1.00
 Piping Length: 0.99 1.00
 Defrosting: - 1.00
 User Derate: 1.00 1.00

Total Derate: 0.99 1.00
 Additional Refrigerant: 0.00 lb
 Total Refrigerant Amount: 5.93 lb


Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
 Outdoor DB 95.0

Heating

Indoor DB 70.0
 Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

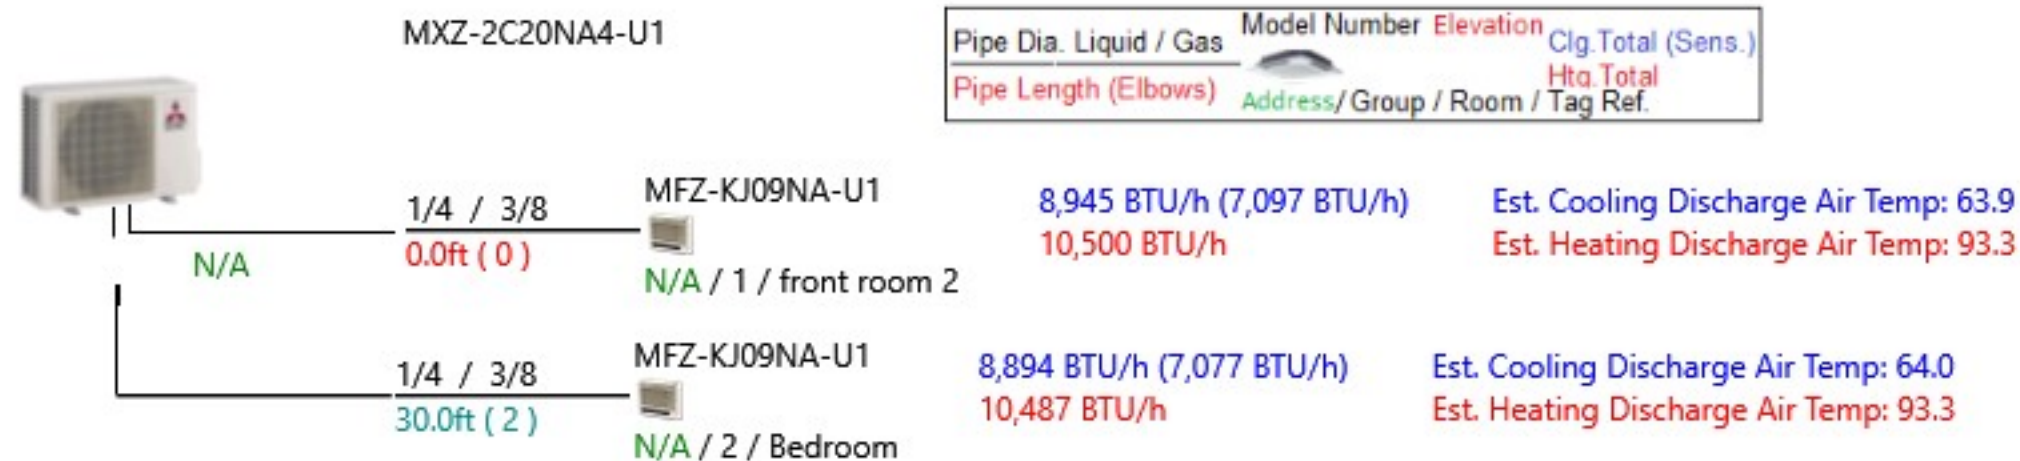

OutdoorUnit 1

Address: N/A

IndoorUnit 1

Address: N/A

Size: 9

Port: 1

Line Size:

3/8x1/4

To: OutdoorUnit 1

IndoorUnit 2

Address: N/A

Size: 9

Port: 2

Line Size:

3/8x1/4

To: OutdoorUnit 1

Indoor Units:	2 / 2 to 2	
Capacity:	18 / 10 to 24	
* Connectable capacity is not actual capacity.		
Total Pipe Length:	32.0 / 164.0	feet
Furthest Actual:	30.0 / 82.0	feet
Furthest Equiv.:	32.0 / 82.0	feet
Correction Factors		
Outdoor Unit Capacity:	1.00	1.00
Temperature:	0.99	1.00
Piping Length:	0.99	1.00
Defrosting:	-	1.00
User Derate:	1.00	1.00
Total Derate:	0.99	1.00
Additional Refrigerant:	0.00	lb
Total Refrigerant Amount:	5.93	lb

Conditions (°F)			
Cooling			
Indoor DB	80.0	Humidity	51.8%
Indoor WB	67.0		
Outdoor DB	95.0		
Heating			
Indoor DB	70.0		
Outdoor DB	47.0	Humidity	72.8%
Outdoor WB	43.0		

Centralized System - 1		BMS Interfaces	Input/Output Devices	Accessory Panels	
Groups	Indoor/Outdoor Units Lossnays	Local Remote Controllers		System Remote Controllers	
 1 Group 1	N/A MXZ  MFZ-KJ09NA-U1 front room 2 IndoorUnit 1				
 2 Group 2	N/A MXZ  MFZ-KJ09NA-U1 Bedroom IndoorUnit 2				

Indoor Units:	2 / 2 to 2	
Capacity:	18 / 10 to 24	
* Connectable capacity is not actual capacity.		
Total Pipe Length:	32.0 / 164.0	feet
Furthest Actual:	30.0 / 82.0	feet
Furthest Equiv.:	32.0 / 82.0	feet
Correction Factors		
Outdoor Unit Capacity:	1.00	1.00
Temperature:	0.99	1.00
Piping Length:	0.99	1.00
Defrosting:	-	1.00
User Derate:	1.00	1.00
Total Derate:	0.99	1.00
Additional Refrigerant:	0.00	lb
Total Refrigerant Amount:	5.93	lb

Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0

Outdoor DB 95.0

Heating

Indoor DB 70.0

Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0



Drop PC or Switch

Indoor Units: 2 / 2 to 2
Capacity: 18 / 10 to 24
* Connectable capacity is not actual capacity.
Total Pipe Length: 32.0 / 164.0 feet
Furthest Actual: 30.0 / 82.0 feet
Furthest Equiv.: 32.0 / 82.0 feet
Correction Factors
Outdoor Unit Capacity: 1.00 1.00
Temperature: 0.99 1.00
Piping Length: 0.99 1.00
Defrosting: - 1.00
User Derate: 1.00 1.00

Total Derate: 0.99 1.00
Additional Refrigerant: 0.00 lb
Total Refrigerant Amount: 5.93 lb

Conditions (°F)

Cooling

Indoor DB 80.0 Humidity 51.8% Indoor WB 67.0
Outdoor DB 95.0

Heating

Indoor DB 70.0
Outdoor DB 47.0 Humidity 72.8% Outdoor WB 43.0

Ventilation Units	Indoor Units
-------------------	--------------

