


EnerSight Period Report

Period: 2026-04-14 → 2026-05-14 · Prepared for: Housseem Ferrani


Total consumption 55,644.5 kWh	Estimated cost \$6,677.34	Average daily 1,854.8 kWh	Peak reading 99.2 kWh
-----------------------------------	------------------------------	------------------------------	--------------------------

	Current period	Previous period	Change
Total (kWh)	55,644.5	21,411.3	▲ +34,233.2 (+159.9%)
Average (kWh)	77.28	76.47	
Peak (kWh)	99.2	95.1	

Consumption trend

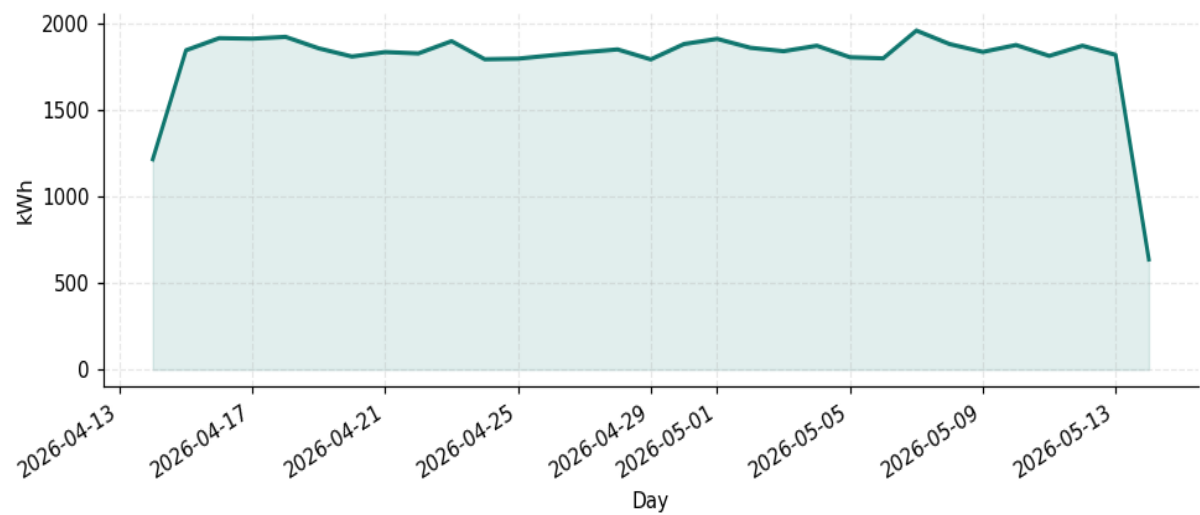

Average consumption by hour-of-day

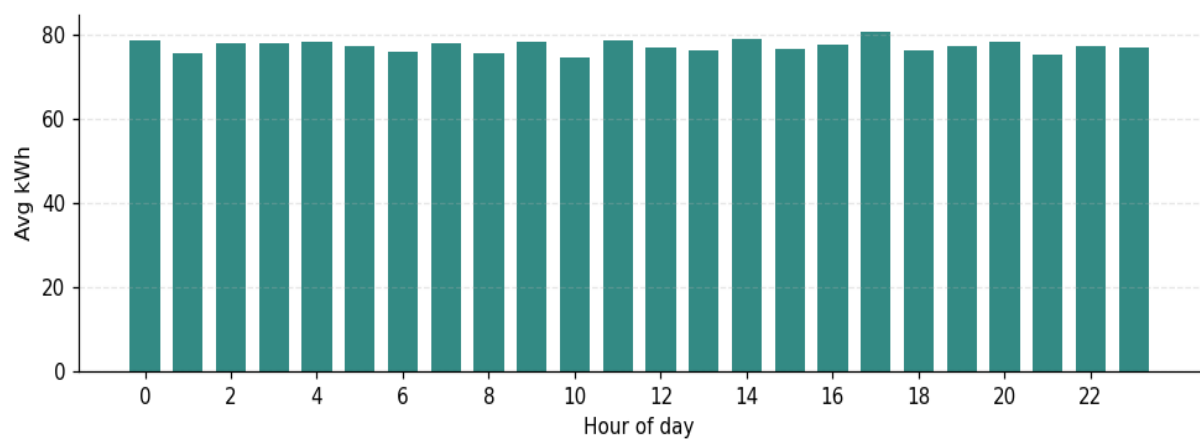

Statistical outliers

When	Consumption (kWh)	z-score	Direction
2026-04-18 23:51	99.20	+2.68	Spike ↑
2026-04-30 20:51	98.84	+2.64	Spike ↑
2026-04-30 14:51	98.76	+2.63	Spike ↑
2026-04-27 16:51	56.04	-2.60	Dip ↓
2026-04-14 23:51	56.16	-2.59	Dip ↓
2026-04-23 17:51	97.77	+2.51	Spike ↑
2026-05-04 06:51	56.85	-2.50	Dip ↓
2026-04-26 00:51	57.29	-2.45	Dip ↓
2026-05-09 00:51	96.83	+2.39	Spike ↑
2026-04-22 20:51	57.97	-2.37	Dip ↓

Optimization recommendations

Title	Category	Severity	Savings / month
HVAC is running while the building is empty	HVAC	INFO	\$300.06 (2,500 kWh)
Renewable generation is underutilised at peak production hours	RENEWABLE	INFO	\$153.99 (1,283 kWh)
Lighting is on while the building is empty	LIGHTING	INFO	\$85.04 (709 kWh)
Total projected savings			\$539.09 (4,492 kWh)