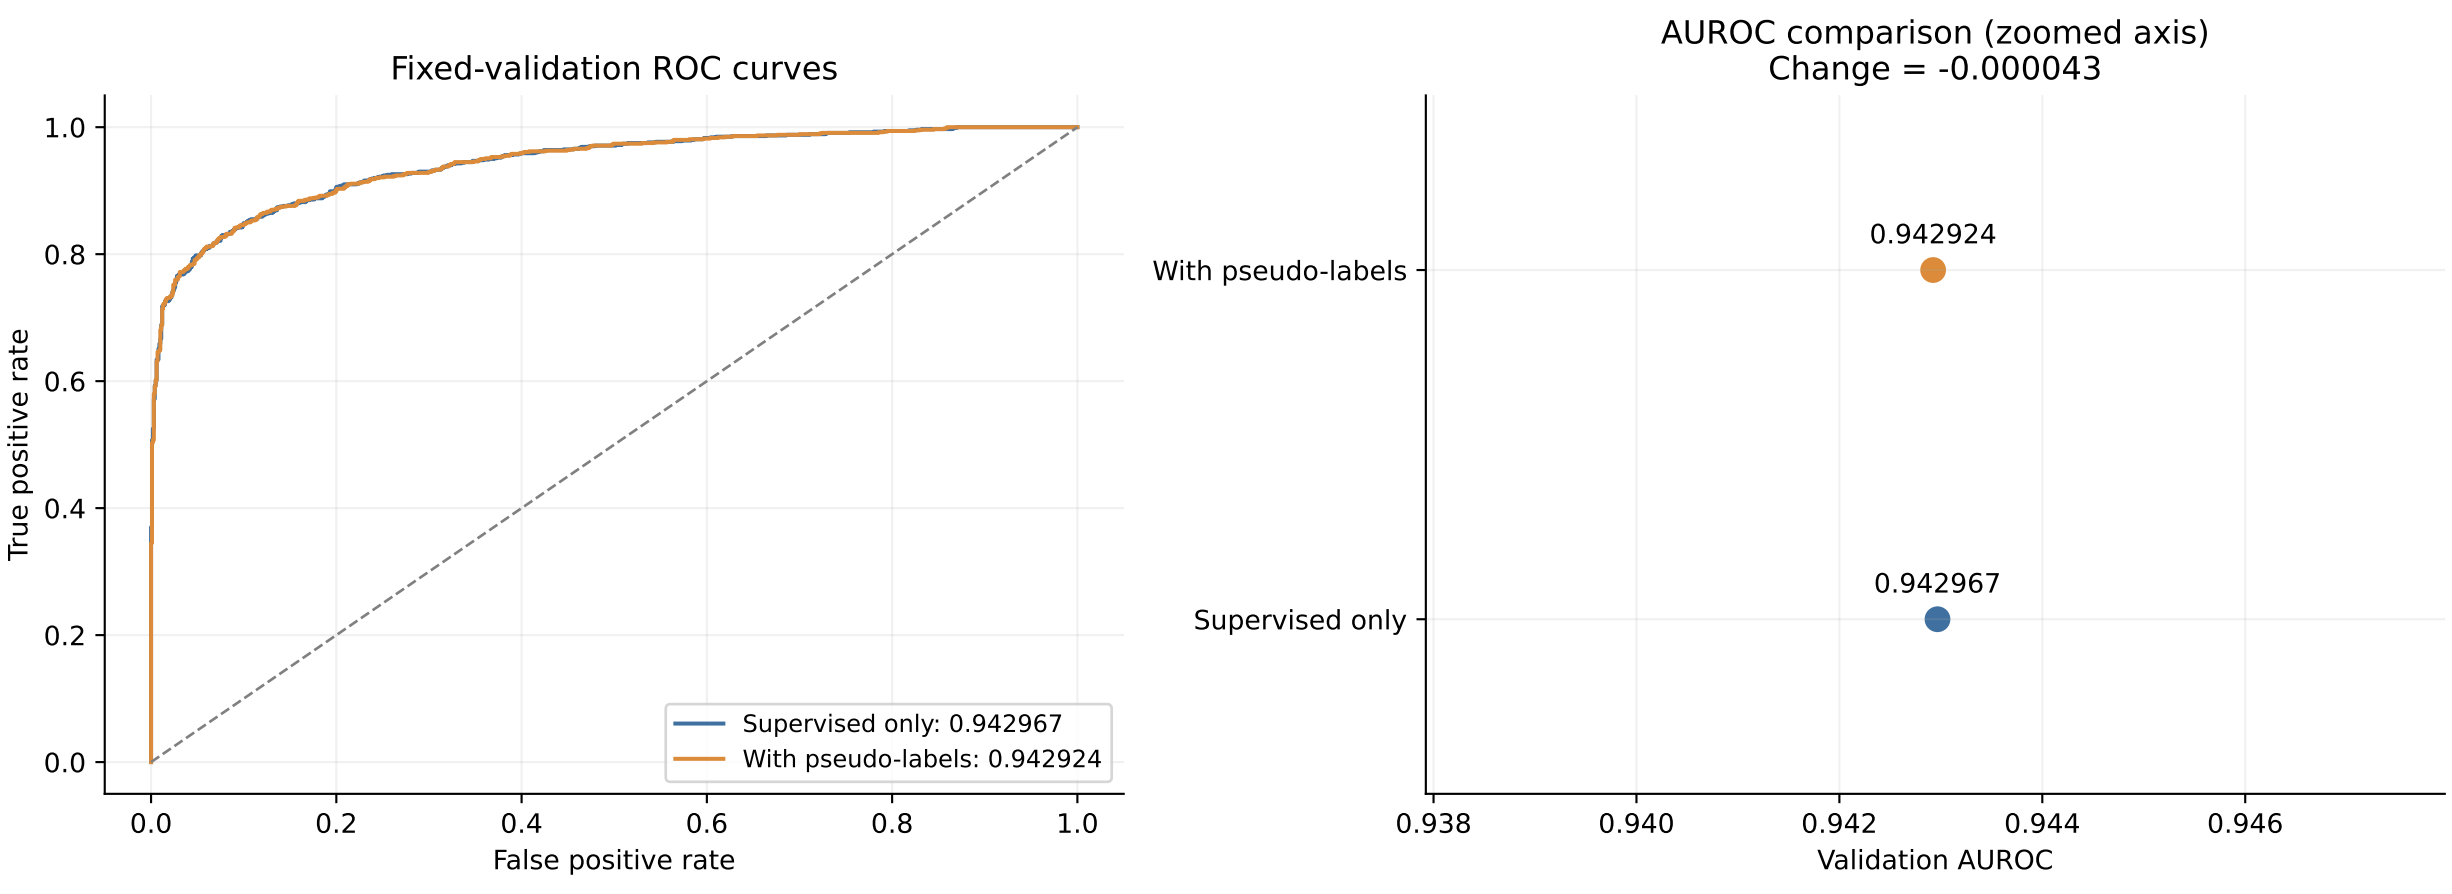
Fixed-validation ROC curves
True positive rate
False positive rate
0.0
0.2
0.4
0.6
0.8
1.0
Supervised only: 0.942967
With pseudo-labels: 0.942924
AUROC comparison (zoomed axis)
Change = -0.000043
With pseudo-labels
Supervised only
0.942924
0.942967
0.938
0.940
0.942
0.944
0.946
Validation AUROC