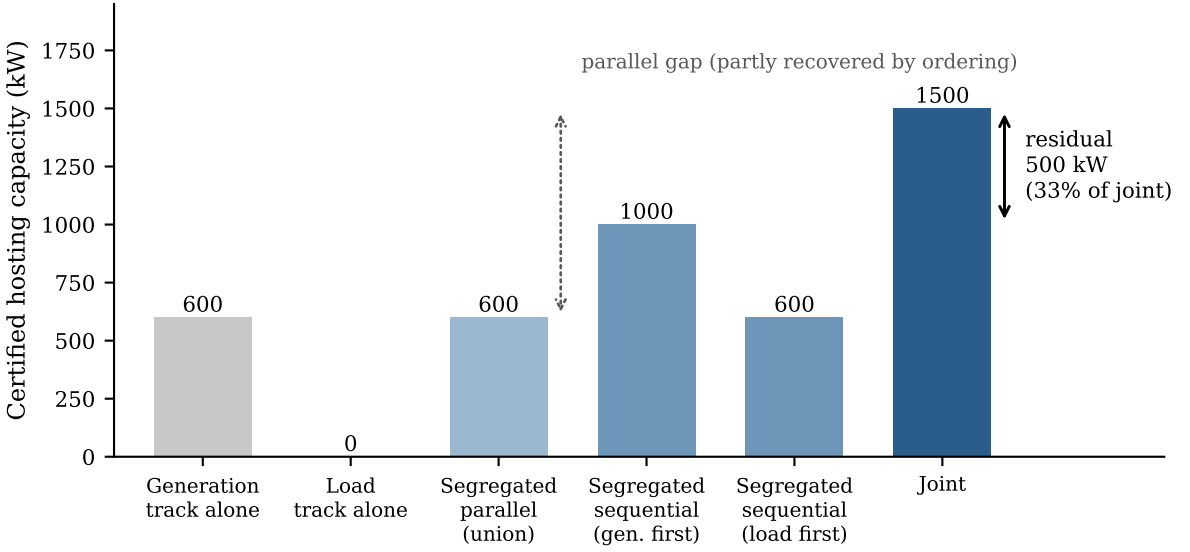
Certified hosting capacity (kW)
1750
1500
1250
1000
750
500
250
0
parallel gap (partly recovered by ordering)
600
0
600
1000
600
1500
residual
500 kW
(33% of joint)
Generation
track alone
Load
track alone
Segregated
parallel
(union)
Segregated
sequential
(gen. first)
Segregated
sequential
(load first)
Joint