



a Replacing real with synthetic: accuracy

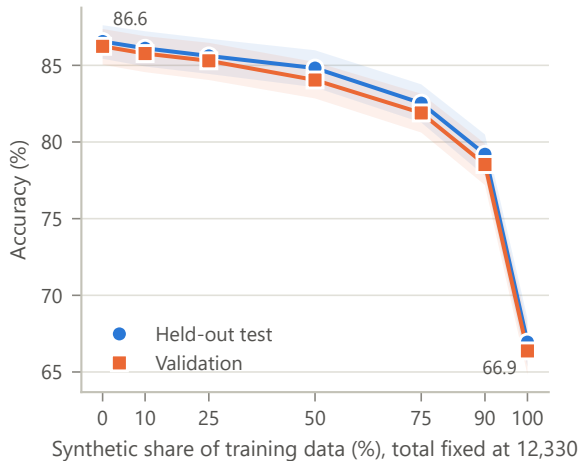

b Replacing real with synthetic: macro-F1

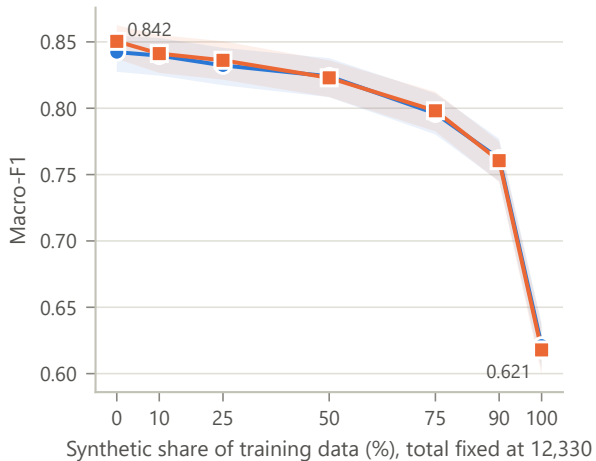

Bands: 95% bootstrap CI over evaluation images. Test: 8 seeds at 0%, 3 elsewhere. Synthetic-only reaches 77% of real-only test accuracy.