
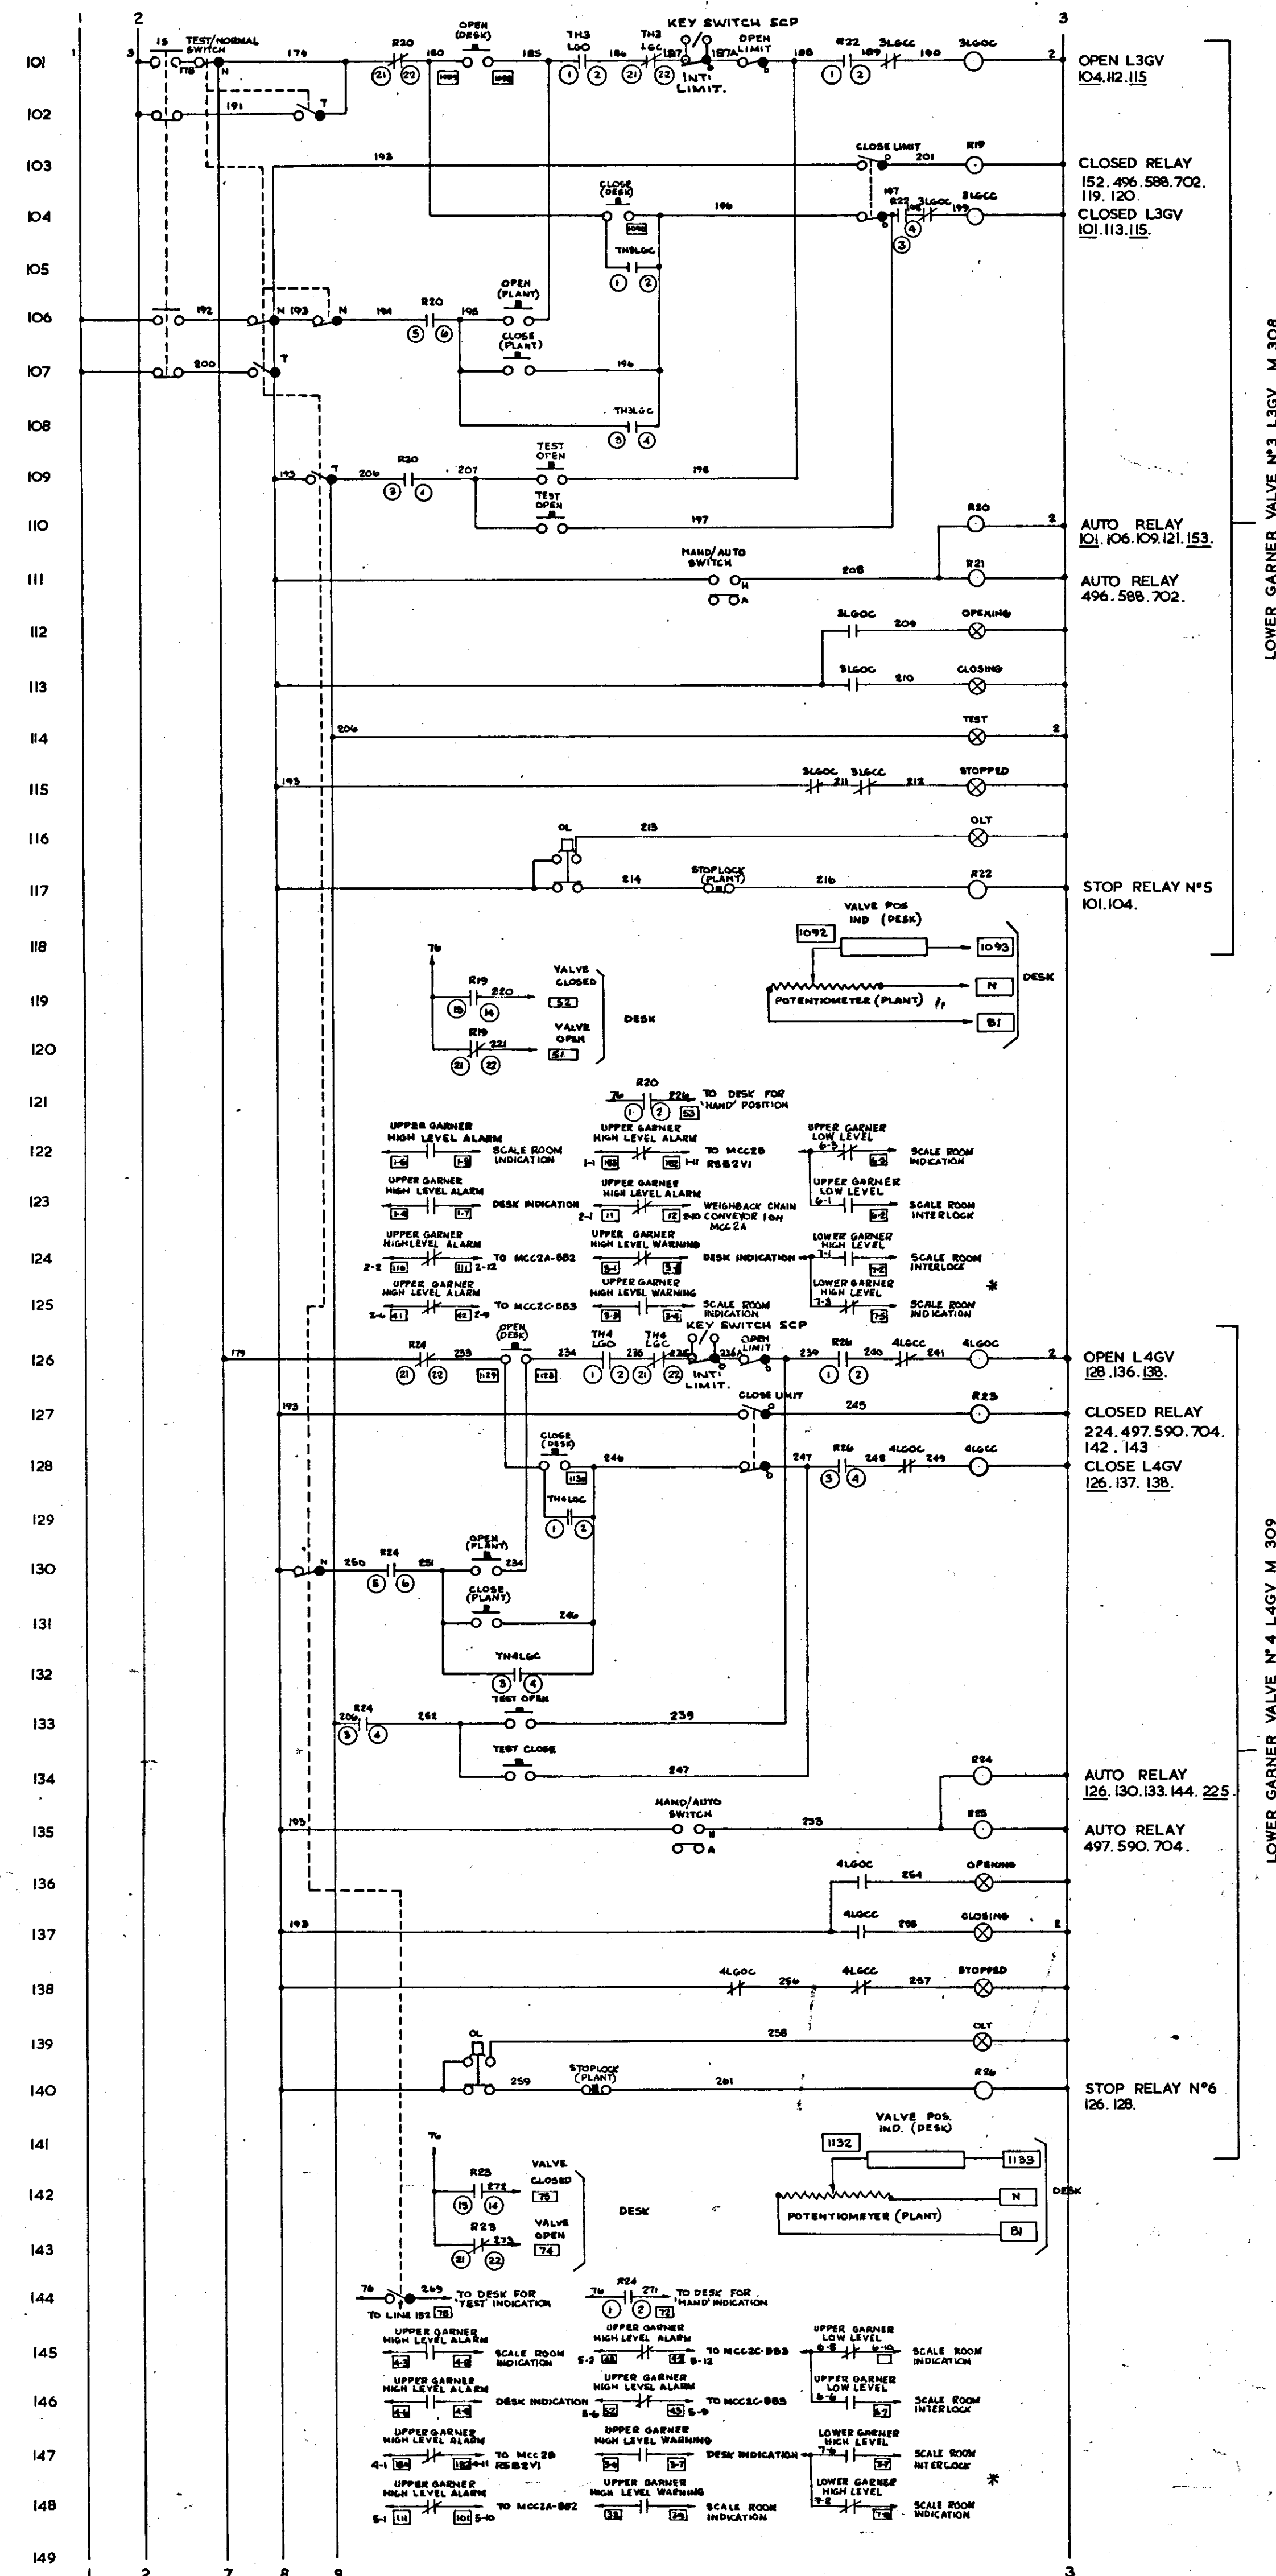
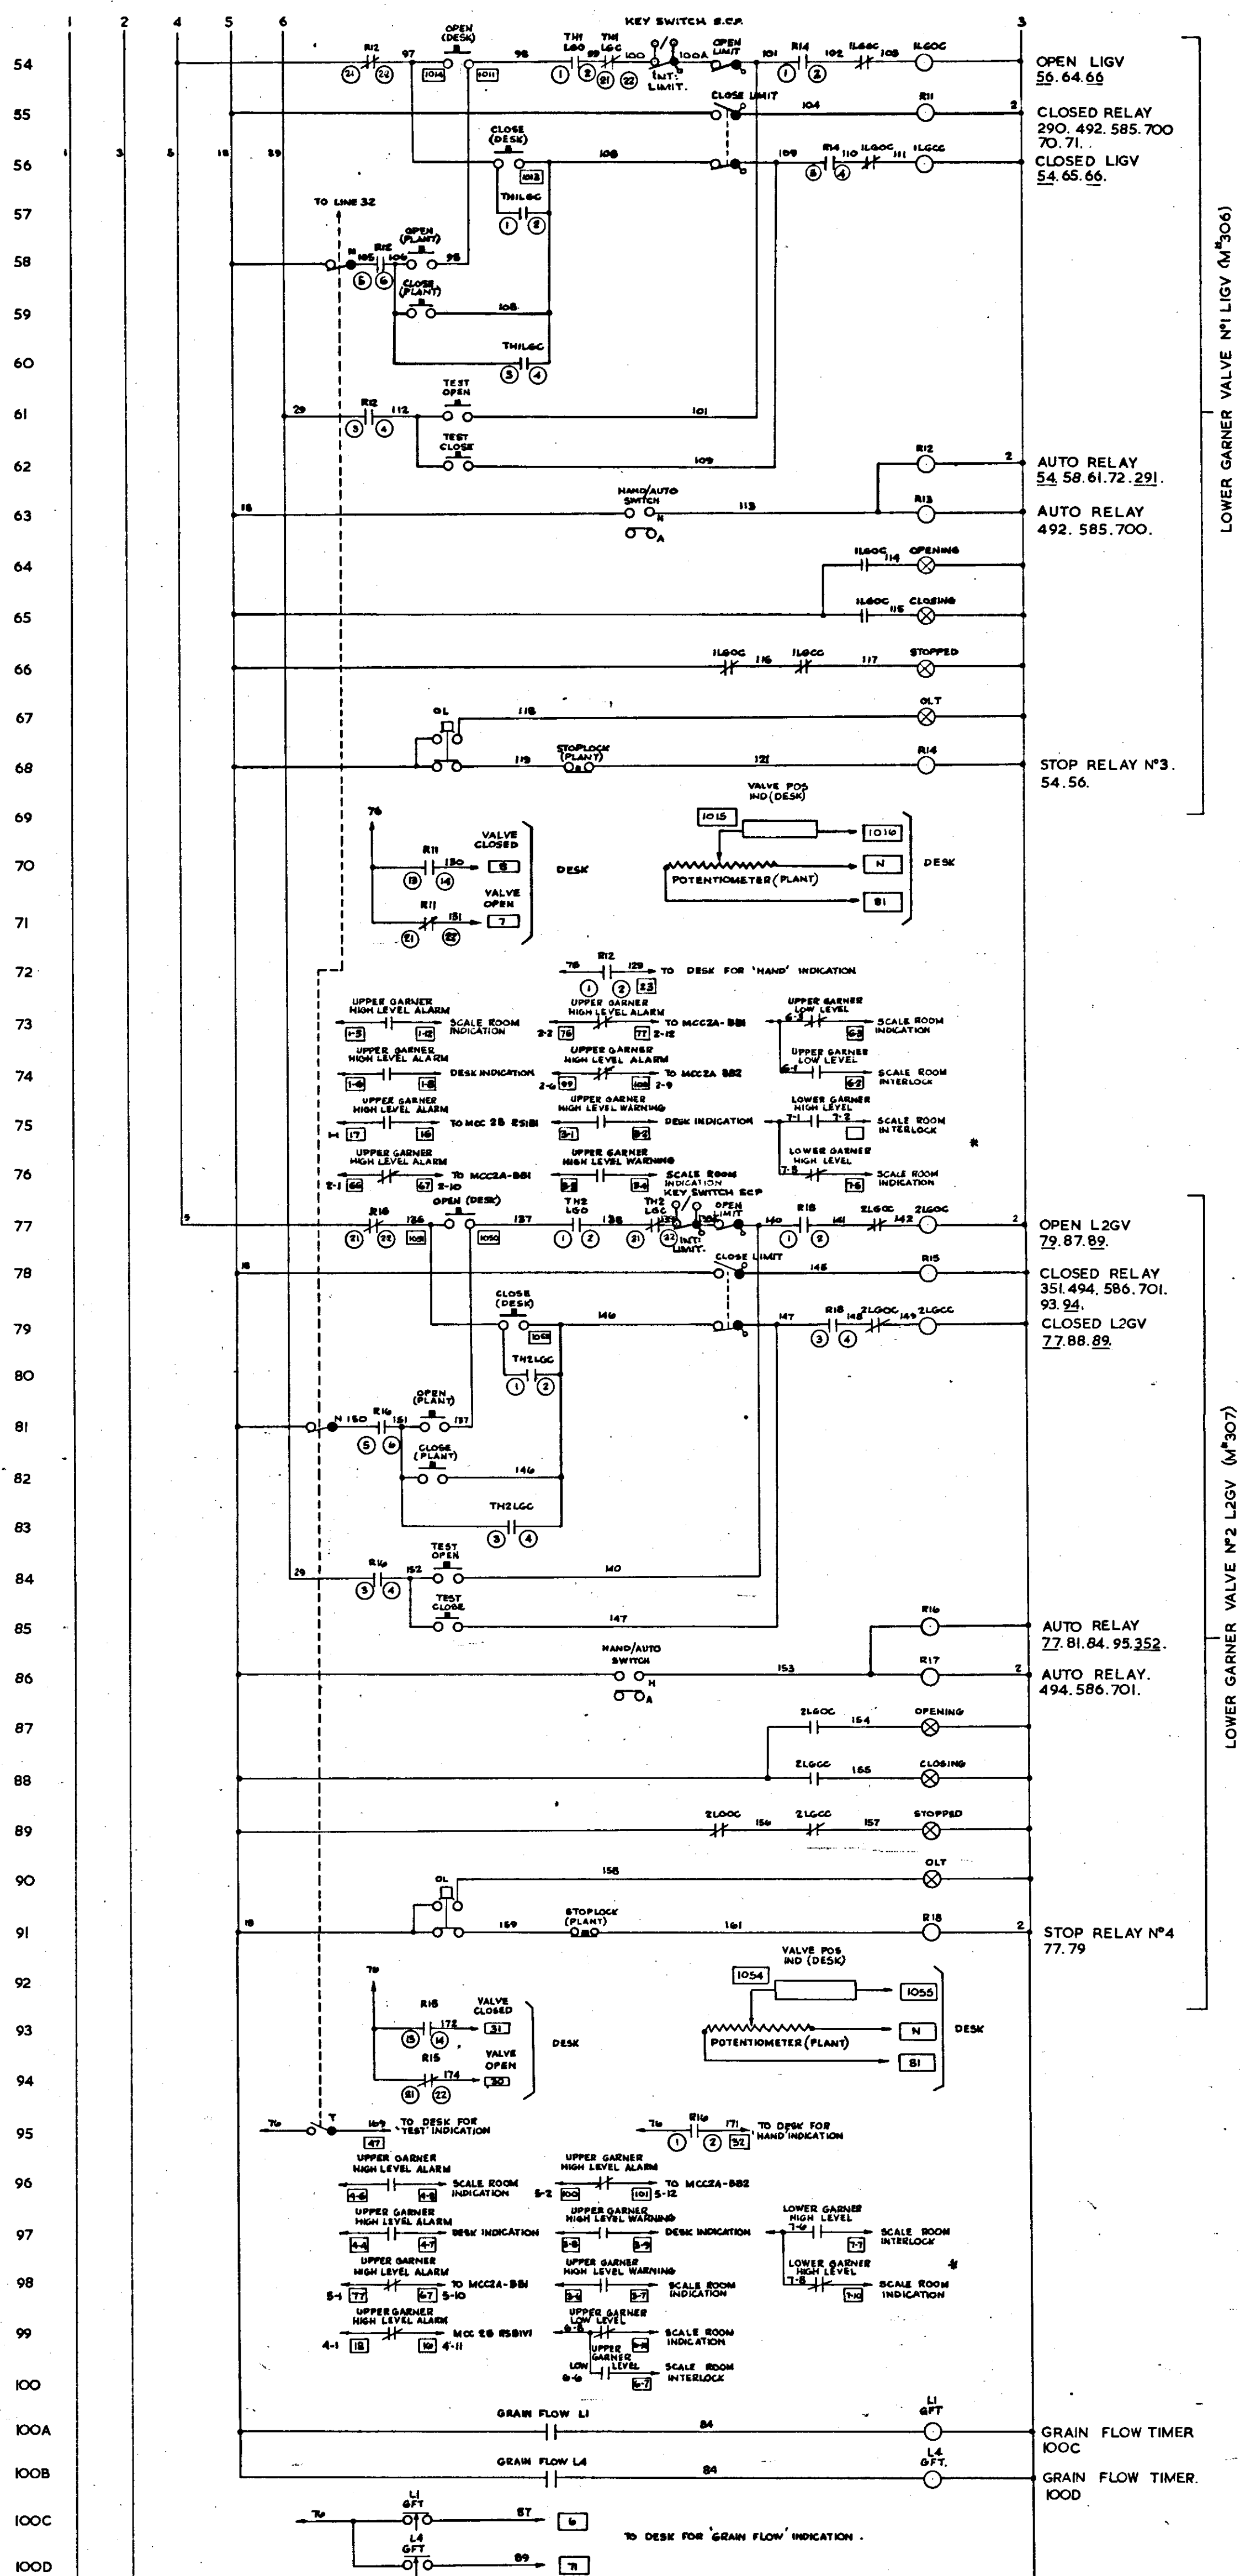


10733.

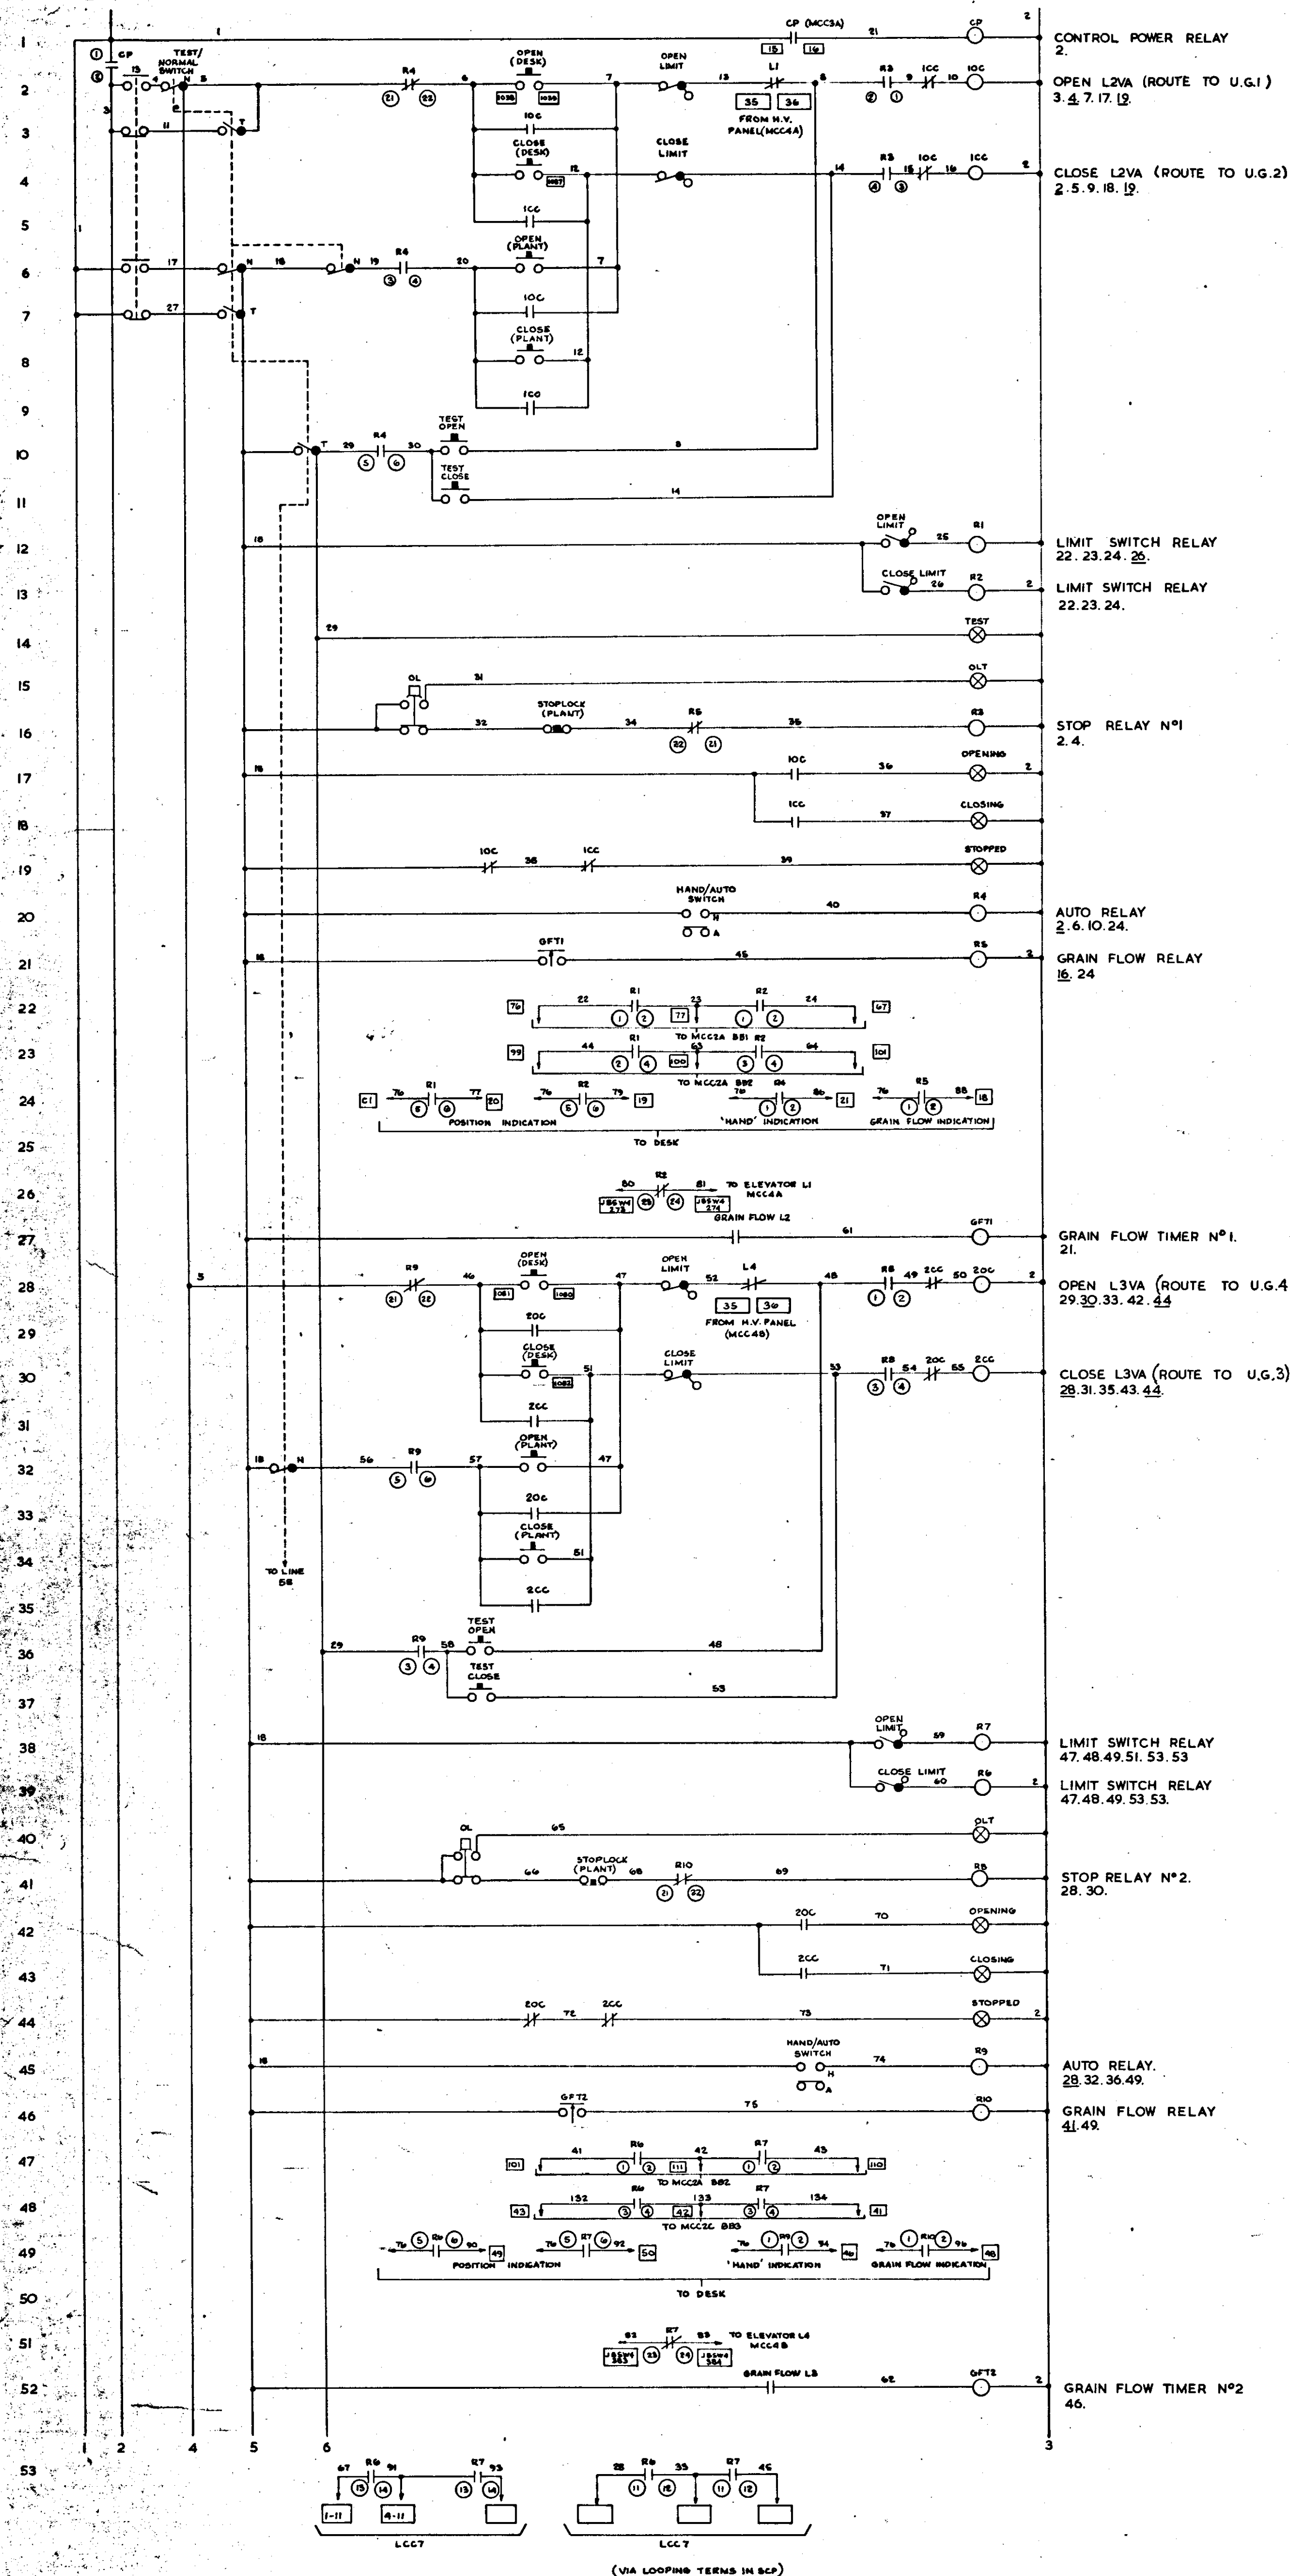

CONTINUED ON DTX 36IU/2.

10733.

SCHEME FOR MCC3B-SEAFORTH GRAIN TERMINAL

DEWHURST & PARTNER LTD.
MELBOURNE WORKS HOUNSLOW

SCHEME FOR MCC3B- SEAFORTH GRAIN TERMINAL.

REVISION: 10. ADDITIONAL CONTACTS TO RELAYS R4 + R2	REVISION: 9. ROUTING VALVES REVERSED.	REVISION: 8 ADDITIONAL CONTACTS TO RELAYS R4 + R7	REVISION: 7 DESK TERMINALS ADDED	REVISION: 6. LEVEL CONTROL TERMINALS ADDED	REVISION: 5. LIGHT + LEAST ADDED
ORIGIN: ICD. 8/1/73 ICD.	ORIGIN: SITE 27/12/72 J.S.	ORIGIN: ICD 20/11/72 J.S.	ORIGIN: 24/1/72 J.S.	ORIGIN: E15P 2/0/71 J.T.	ORIGIN: E15P 8/10/71 SCD B.J.C.

REVISION : 4 LEGY VALVE OPEN INDICATION TERMINAL WAS 17E	REVISION : 3. MEMO DESIGNATION MODS. SCALE ROOM INDICATION MOD.	REVISION : 2. CONTACTS ON ELR.DSH RD ON CH. 8-140 WEIR W/6 VALVE INDICATION ADDED TO B11, A16, R19, E23.	REVISION : 1. UPPER ORANGE CONNECTIONS TO MCGG. ADDED
ORIGIN : EISP. 10/9/71 GGD J.T.	ORIGIN : EISP. 11/9/71 GGD J.T.	ORIGIN : EISP. 1/2/71 GGD J.T.	ORIGIN : EISP. 1/9/71 GGD J.T.

DRAWN BY J.F.	KEY DIAG. N°.
DATE. 7.12.'70	EXT. DIAG. N°.
CHECKED BY	REL. DIAG. N°.
APPROVED BY.	PANEL LAYOUT N°.
DATE.	

ISSUE	H	12													
DTX36IU/I.															
DTX36IU/I															