


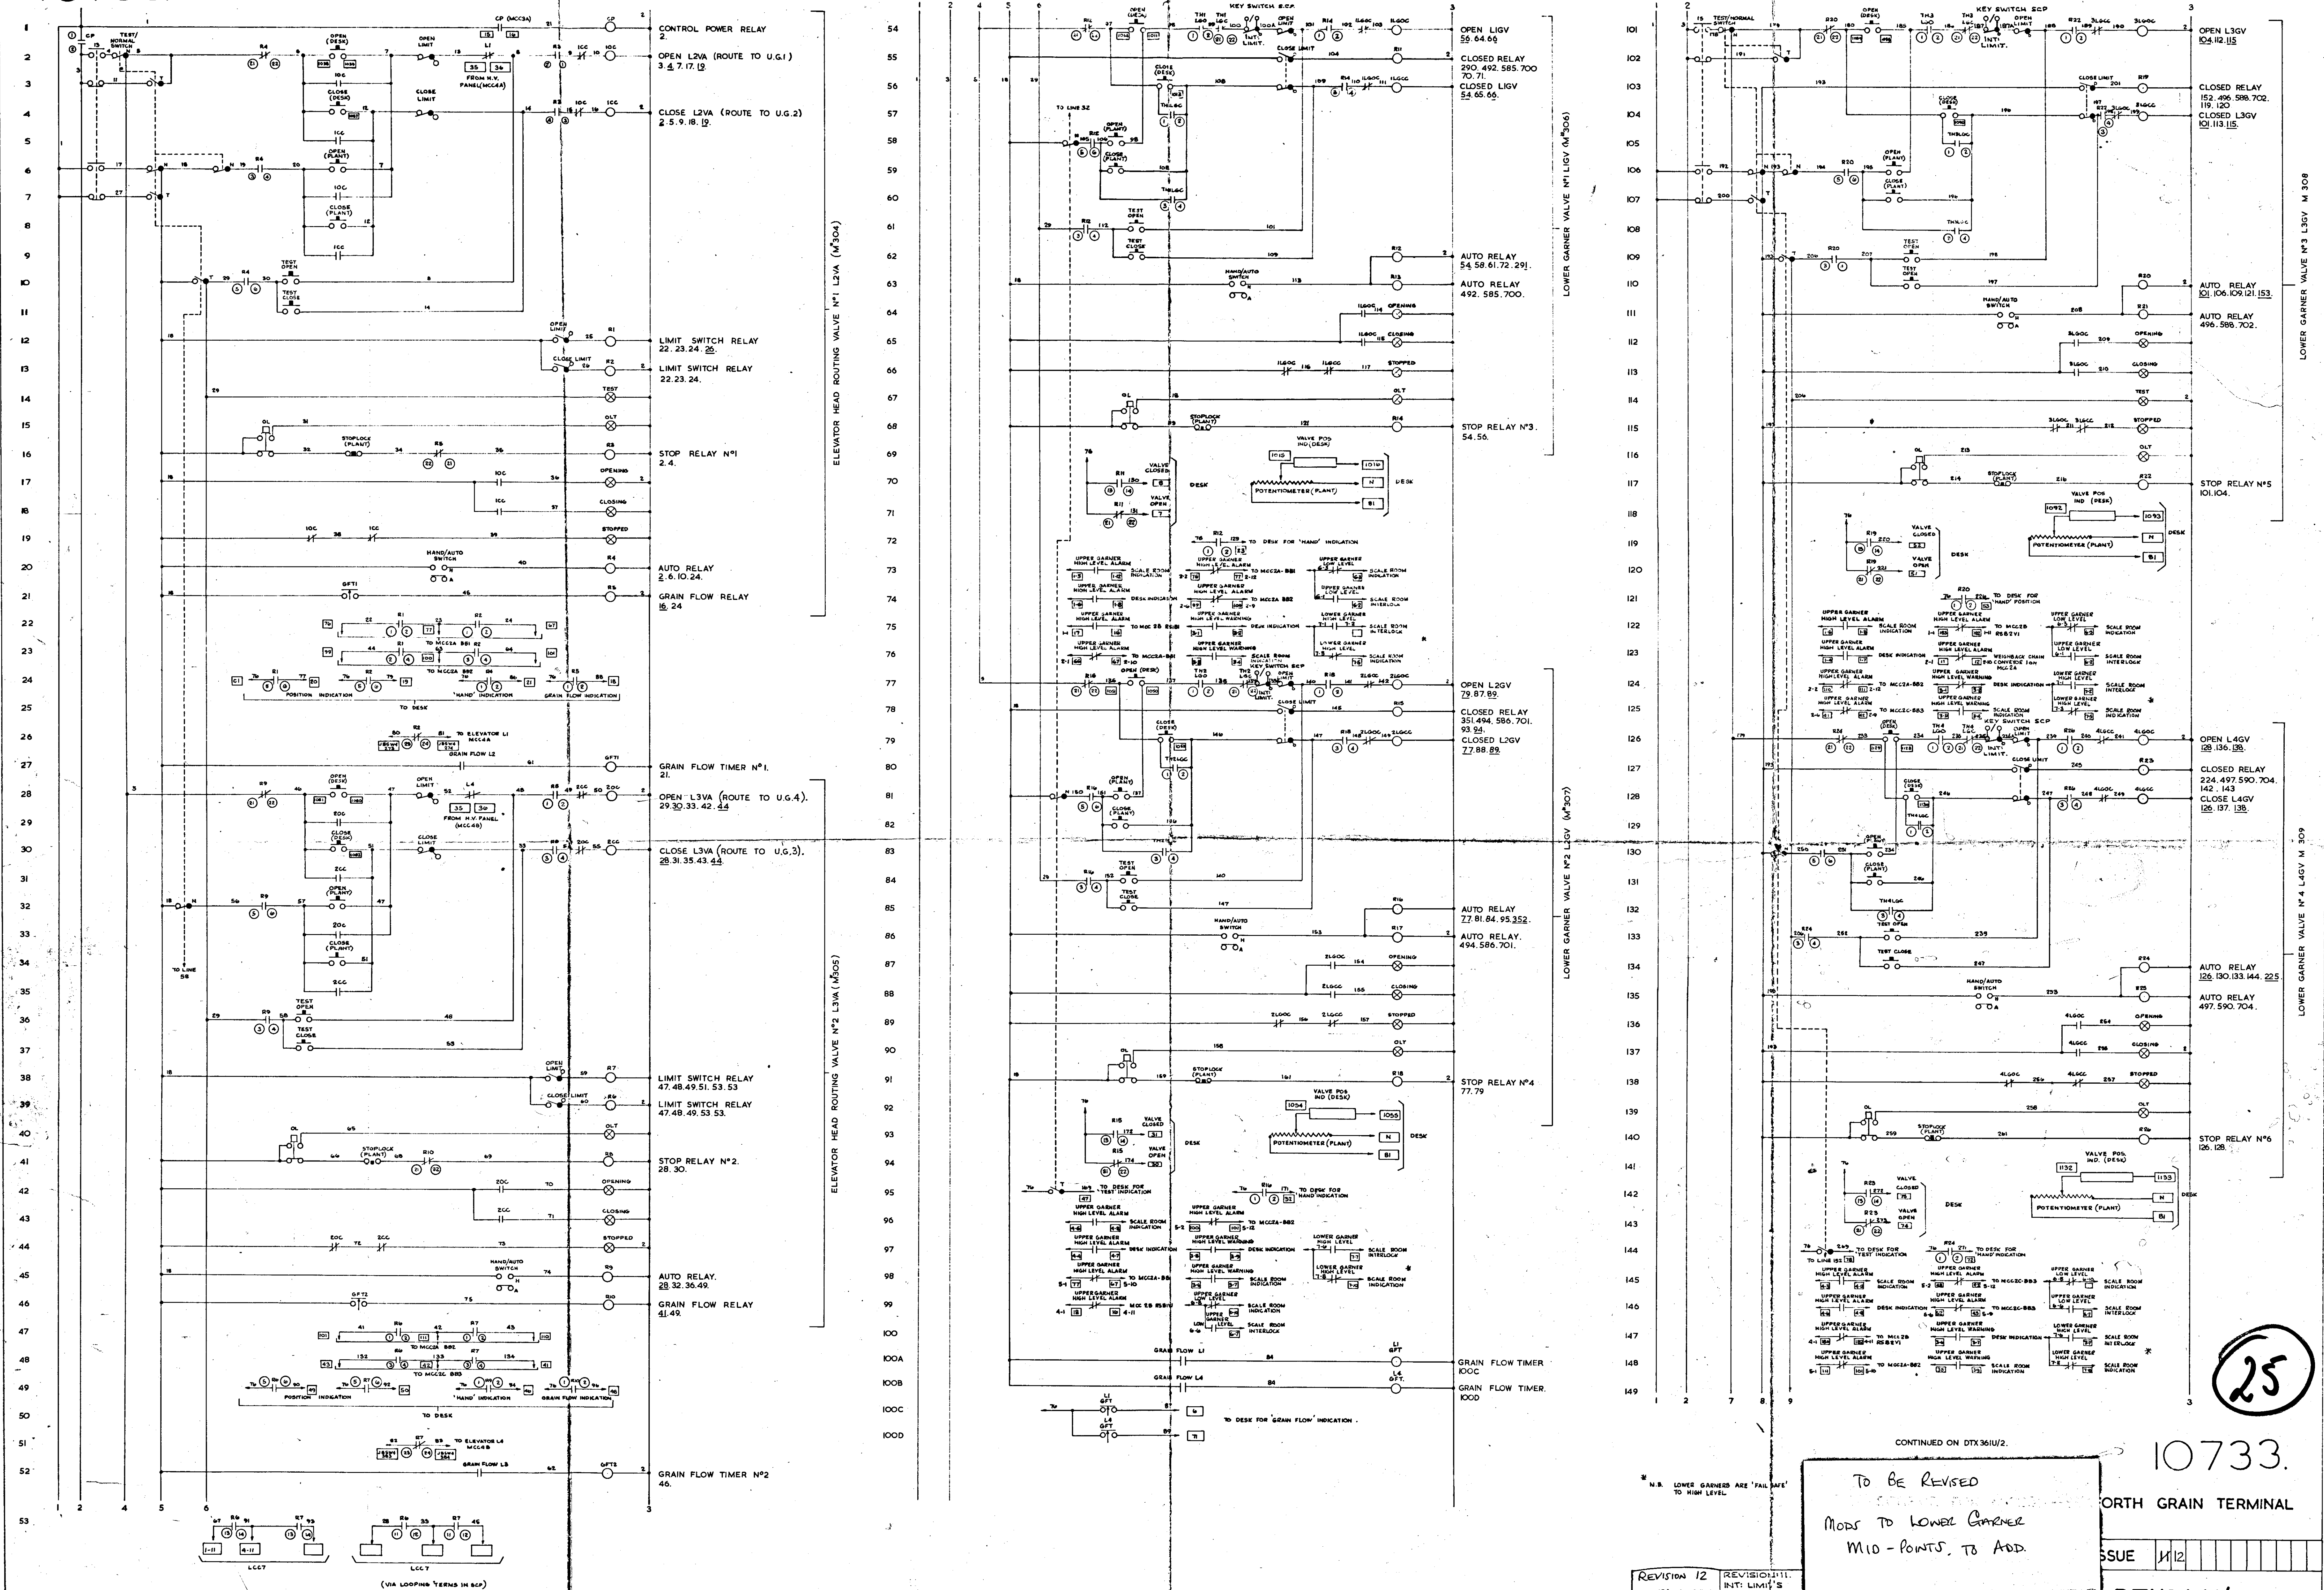

DEWHURST & PARTNER LTD.
MELBOURNE WORKS HOUNSLOW: 10

TITLE: SCHEME FOR MCC3B- SEAFORTH GRAIN TERMINAL

REVISION 10: ADDITIONAL CONTACT TO RELAYS R# 42	REVISION 9: ROUTING VALVES REVERSED.	REVISION 8: ADDITIONAL CONTACTS TO RELAYS R# 47	REVISION 7: DESK TERMINALS ADDED	REVISION 6: LEVEL CONTROL TERMINALS ADDED	REVISION 5: LIGHTS LA5FT ADDED	REVISION 4: LEaky Valve OPEN INDICATION TERMINAL WAS 17E	REVISION 3: MINOR DESIGNATION MODS, SCALE ROOM INDICATION MOD.
ORIGIN: EISP 9/1/72 ICD.	ORIGIN: SITE 27/12/72 J.S.	ORIGIN: ICD 20/10/72 J.S.	ORIGIN: EISP 24/1/72 J.S.	ORIGIN: EISP 2/9/71 J.T.	ORIGIN: EISP 2/9/71 SCD B.J.C.	ORIGIN: EISP 29/10/71 SCD J.T.	ORIGIN: EISP 19/7/71 SCD J.

REVISION 12 LOWER GARNER MID-POINTS	REVISION 11. INT: LIMIT'S ADDED TO LINE 54-77-101-122 35-11-76
REVISION 2. CONTACTS ON R122, D51 & R6 ON LINES 54-100 WERE IN VALUE INDICATION ADDED TO R11, R16, R19, R23. ORIGIN: EISP 2/2/71 SGD J.T	REVISION 1 UPPER GARNER CONNECTIONS TO MCGR ADDED ORIGIN: EISP 1/2/71 SGD J.T

2	REVISION: 11. INT: LIMIT'S ADDED TO LINE 54-77-101-128 30-11-76
10 TO	REVISION: 11 UPPER GARNER CONNECTIONS TO MCCR ADDED ORIGIN: EISP 12/2/71 SGO J3

DRAWN BY: J.P.	KEY DIAG. N°.
DATE: 7.12.70	EXT. DIAG. N°.
CHECKED BY:	REL. DIAG. N°.
APPROVED BY:	PANEL LAYOUT N°.
DATE:	

10733.
NORTH GRAIN TERMINAL

S	SUE	N	I																
DTX36IU/I.																			

DTX36IU/I.