
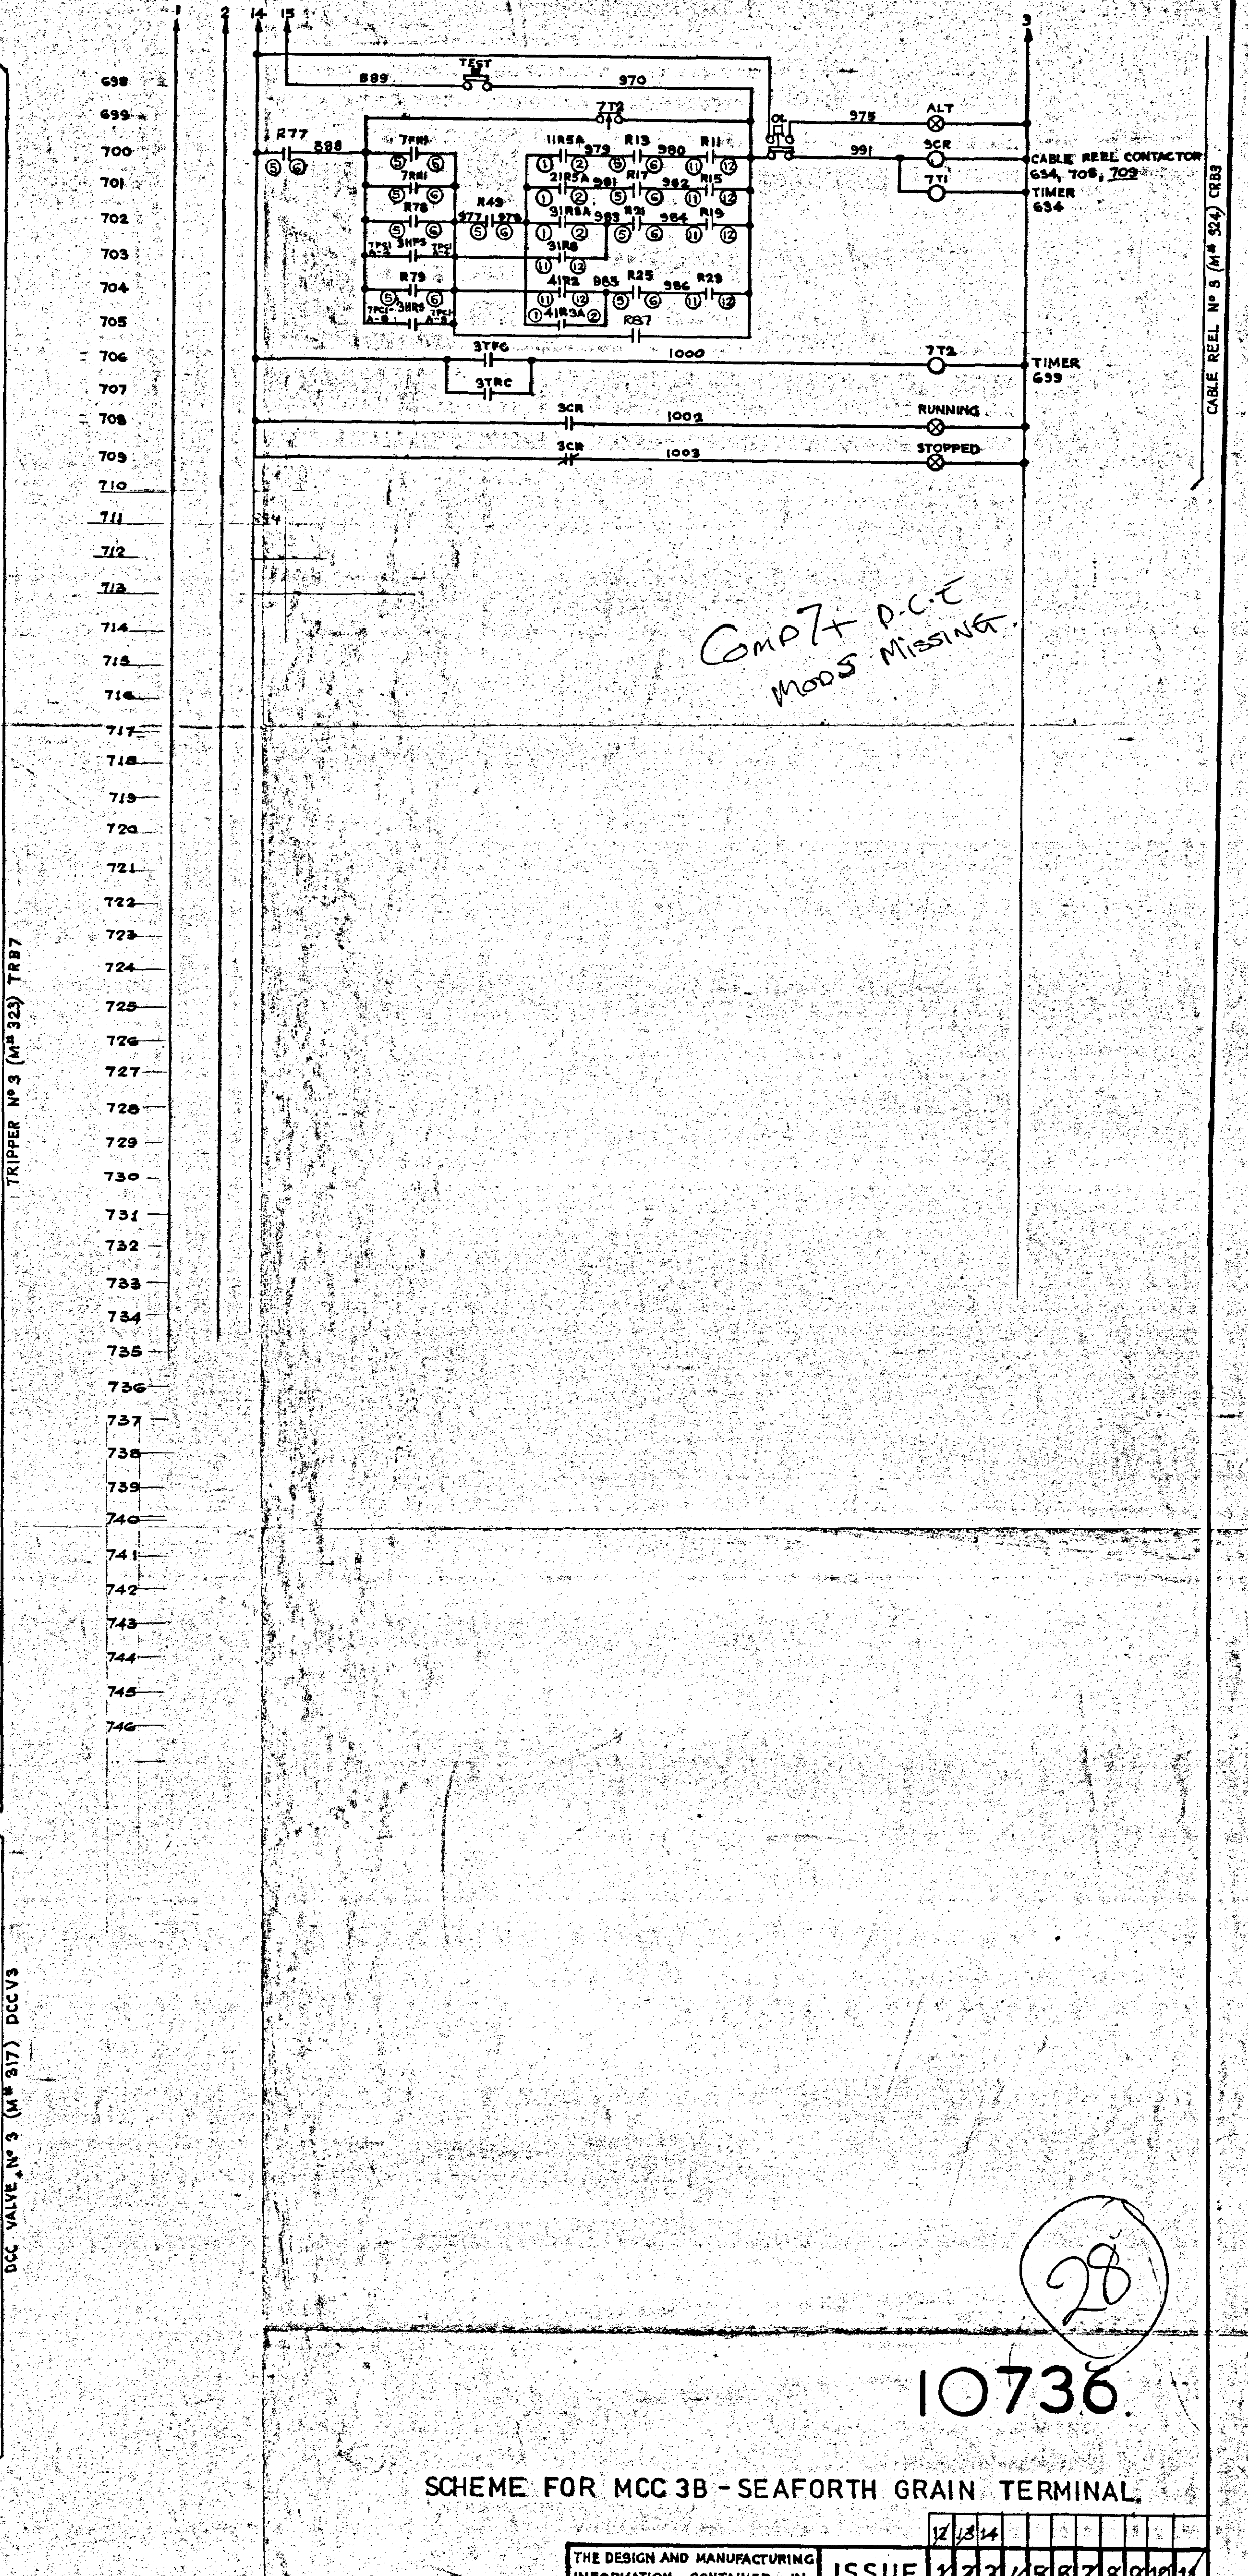
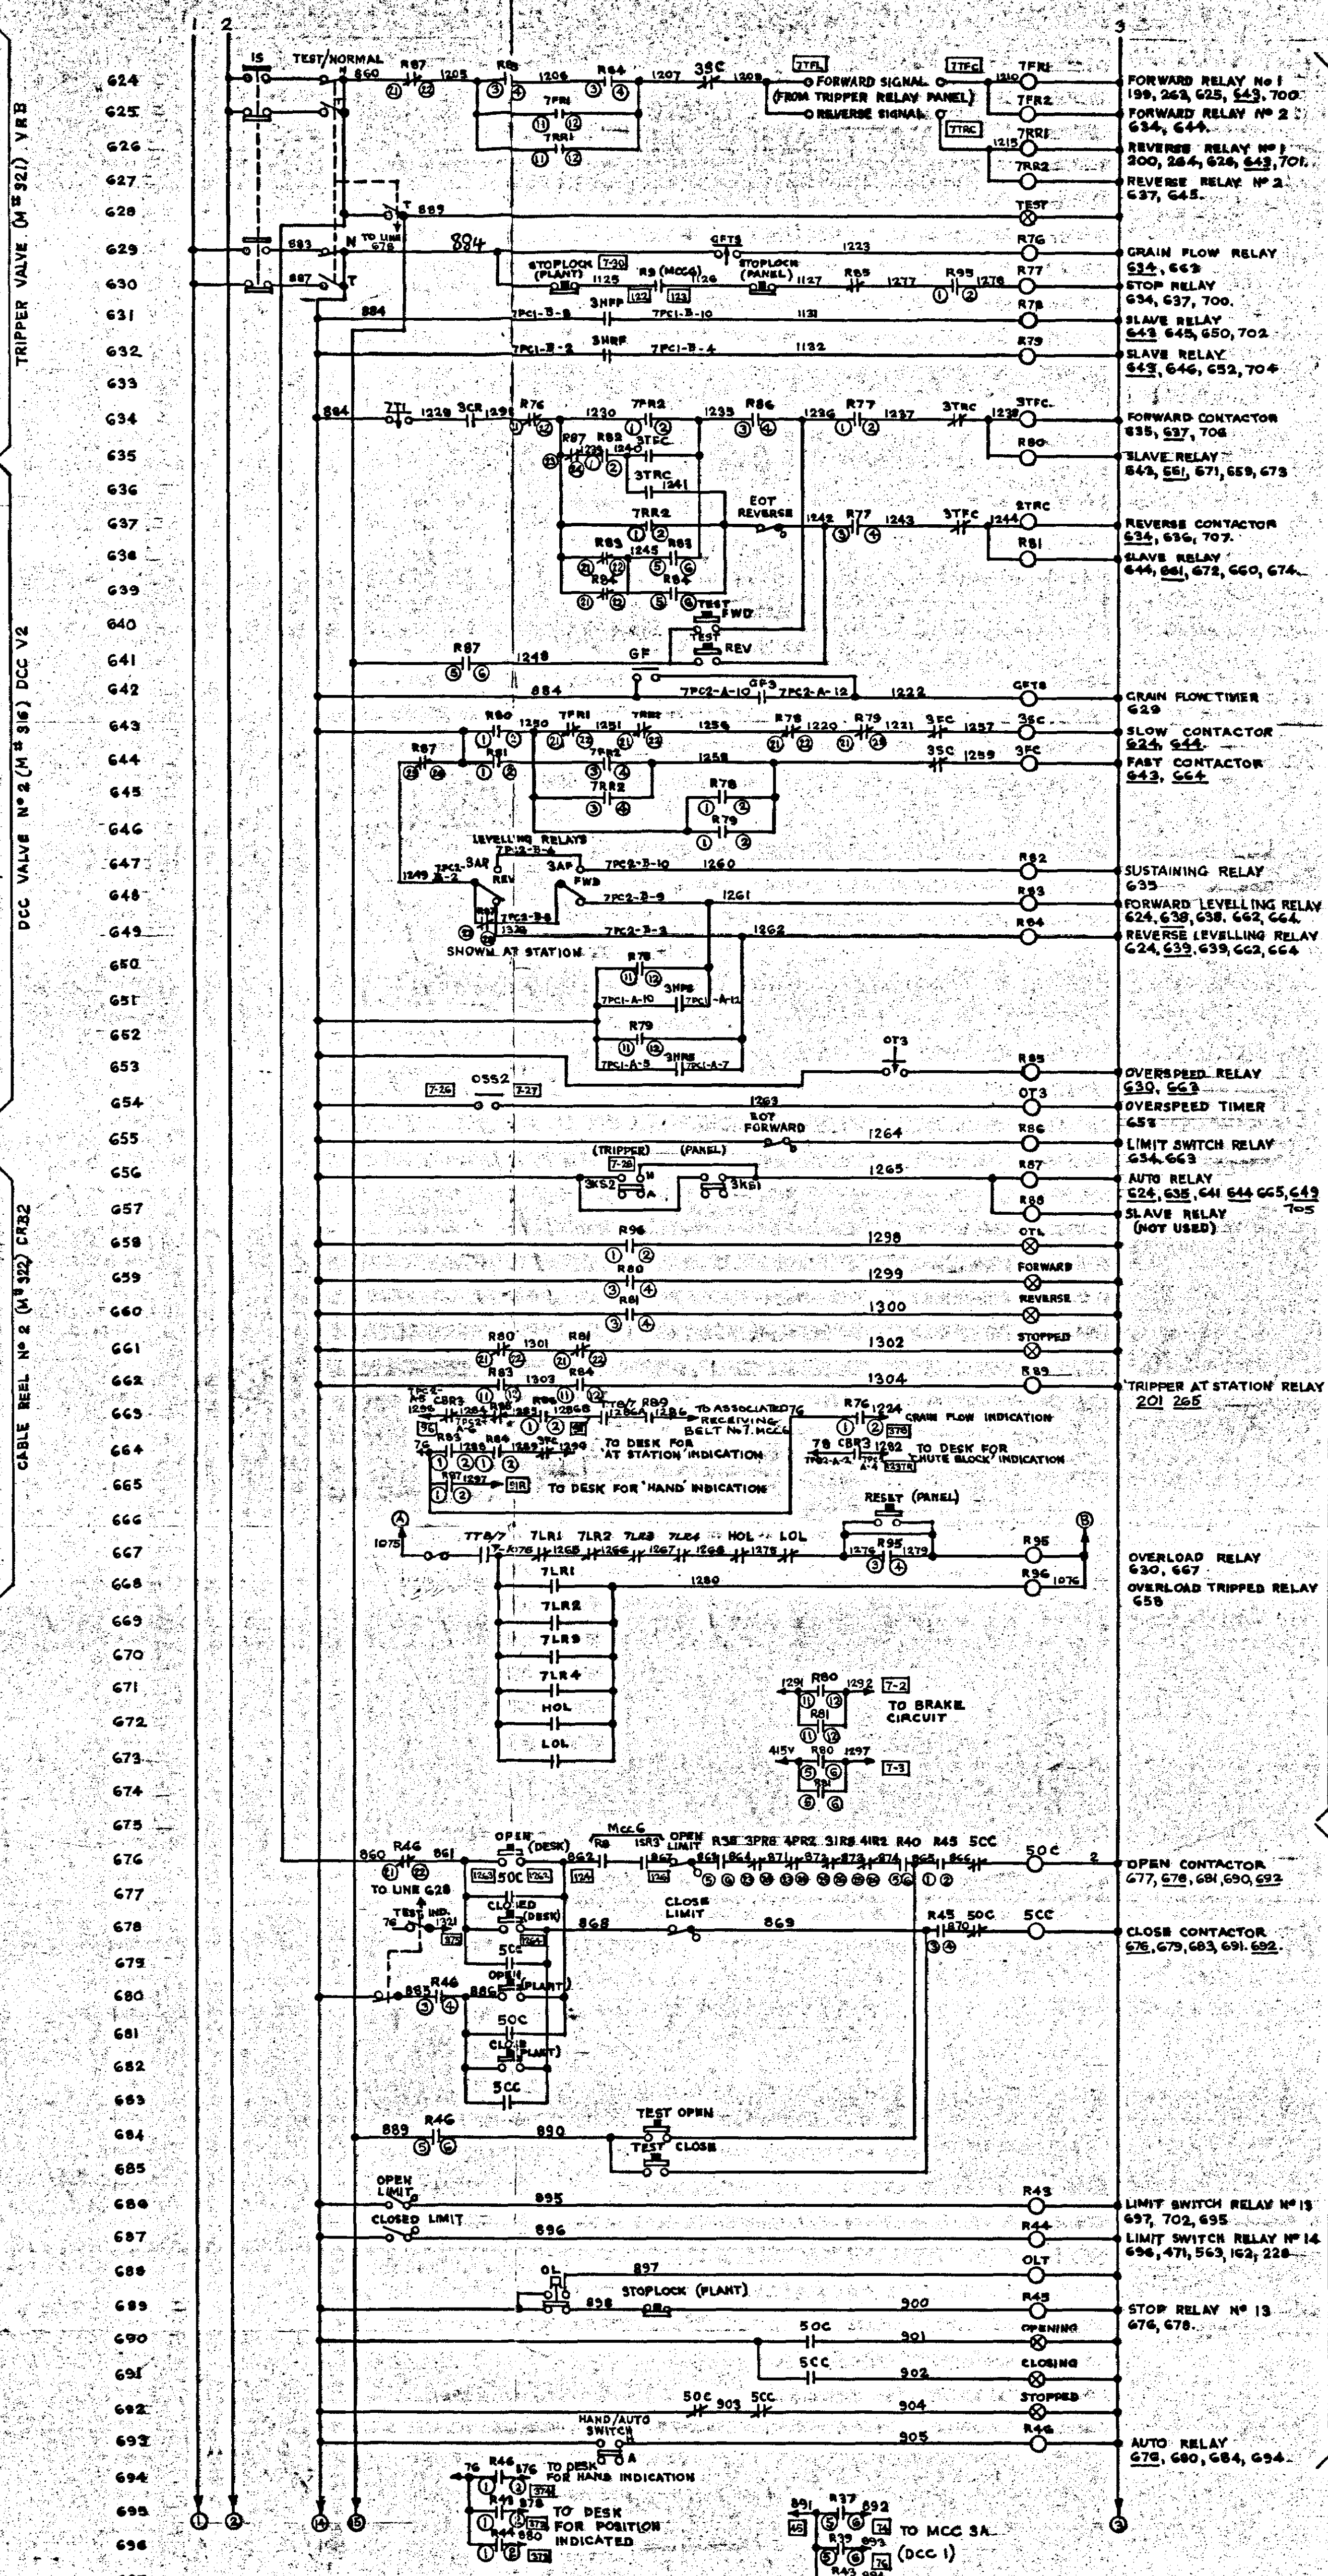


10736

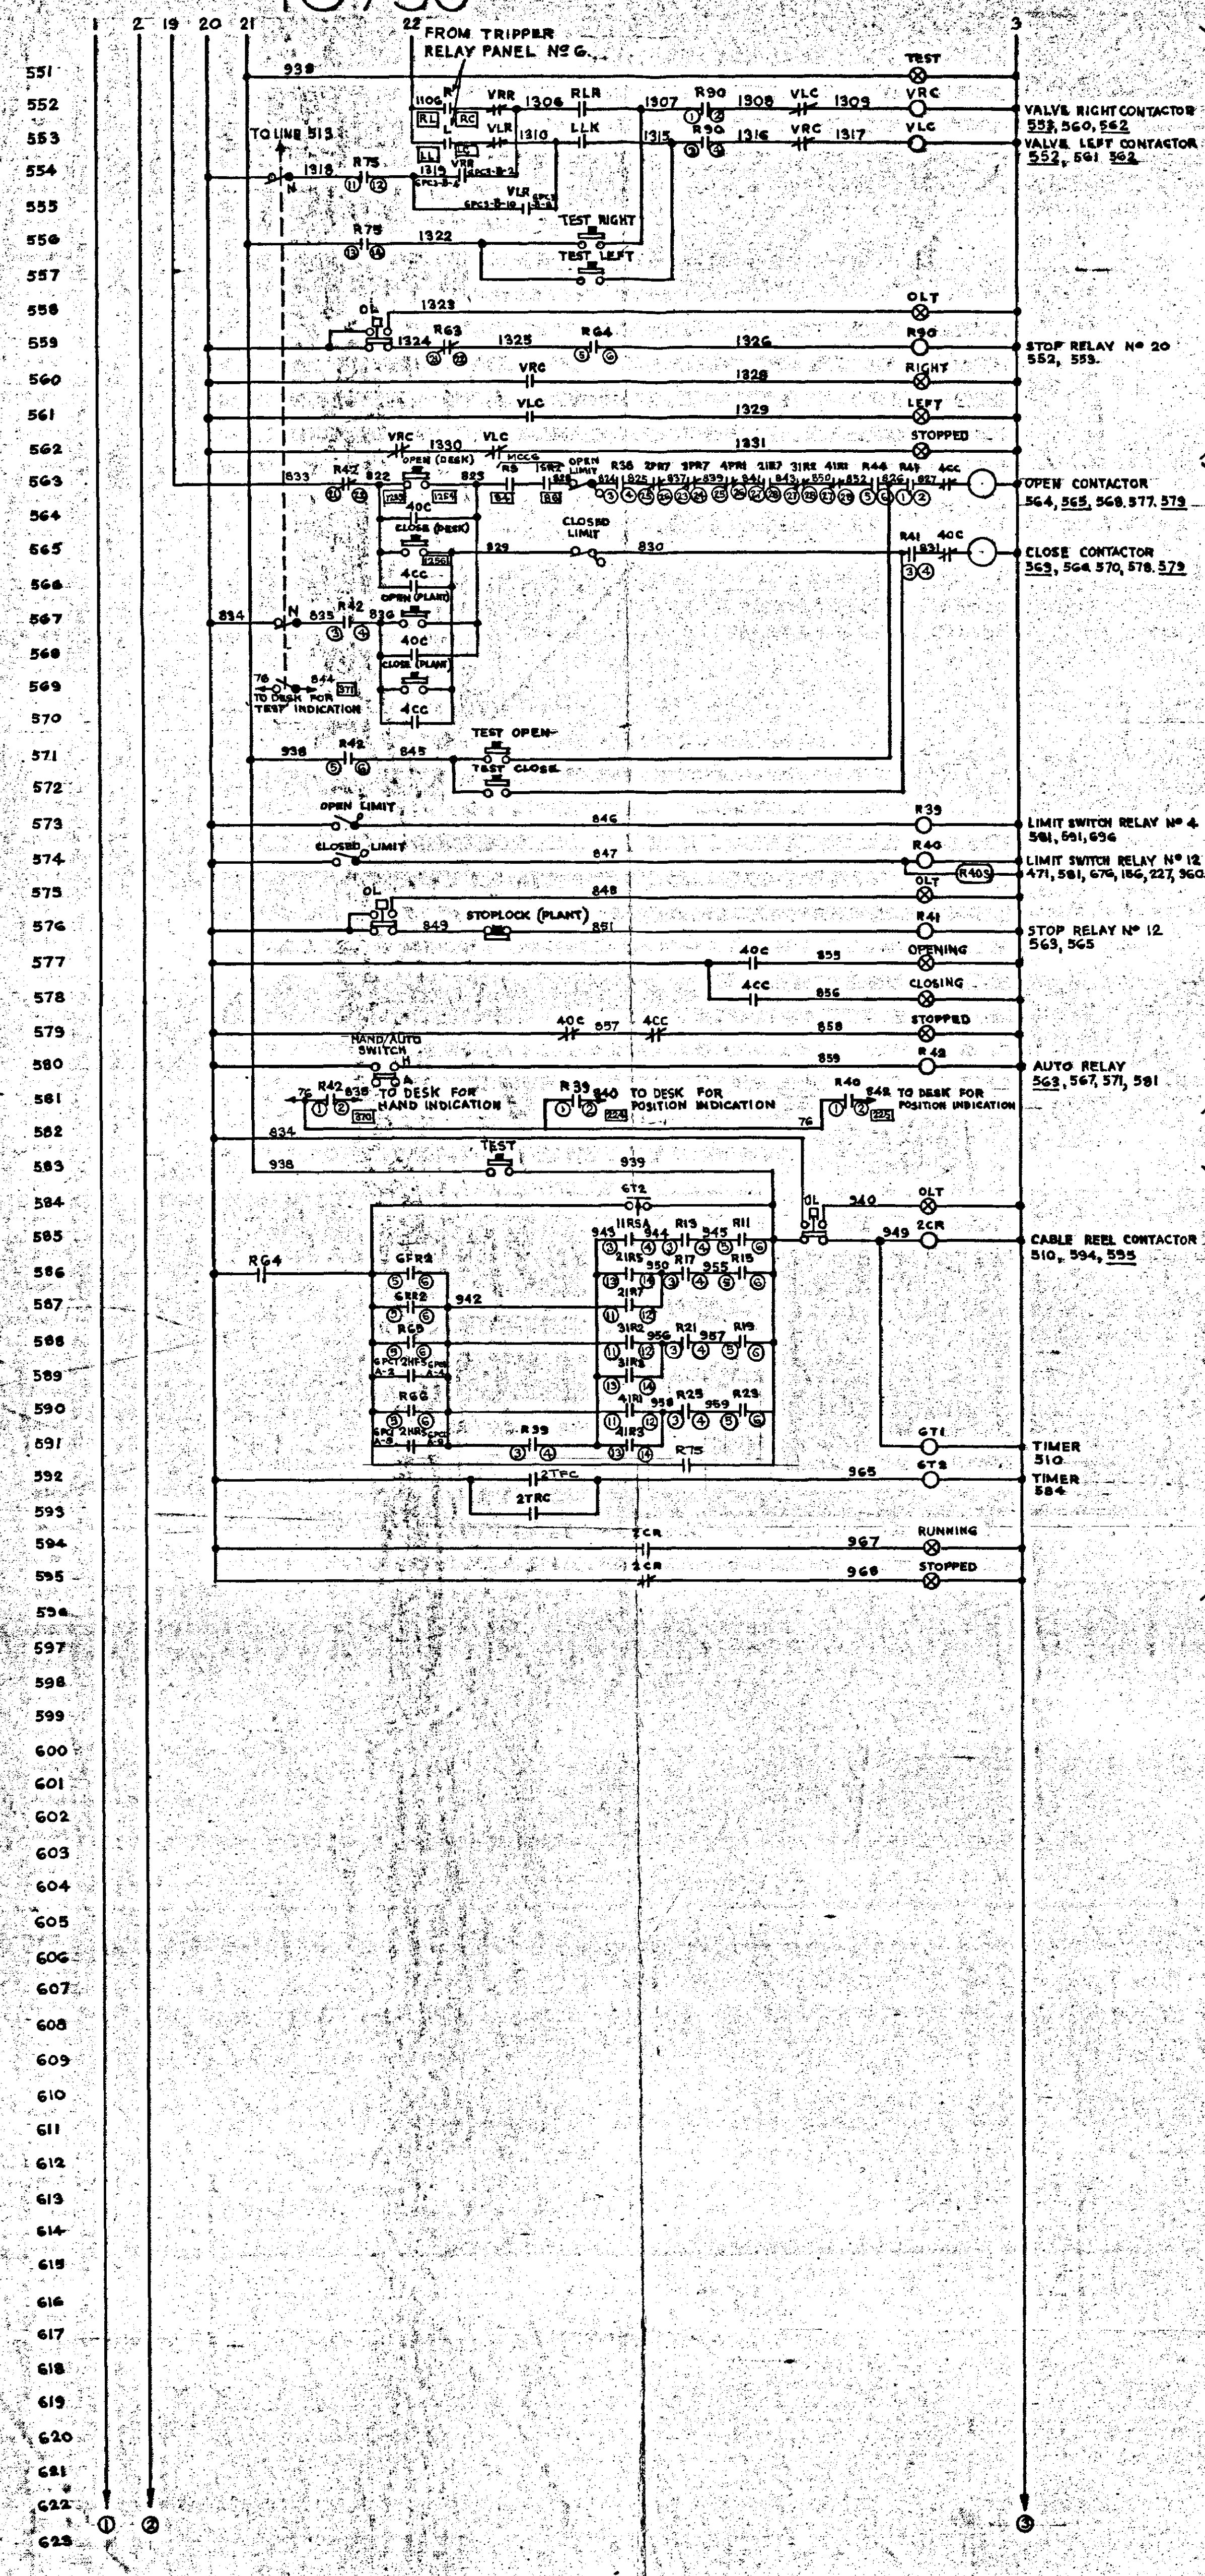

COMP. P.C.T.
MODS MISSING.

10736

SCHEME FOR MCC 3B - SEAFORTH GRAIN TERMINAL

DEWHURST & PARTNER LTD.
MELBOURNE WORKS. HOUNSLOW.

TITLE
SCHEME FOR MCC 3B SEAFORTH GRAIN TERMINAL

REVISION: 9
OVERSPEED
TIMERS ADDED
ORIGIN: ICD
16/1/79 JS

REVISION: 8
TRIPPER OVERLOADS
REPLACED BY RELAY
& HOL & LOL
ORIGIN: ICD
5/1/79 JS

REVISION: 7
INTERLOCKS FROM TRIPPER
ADDED TO OPEN CONTACTOR
& CLOSE CONTACTOR
ADDED TO CABLE REEL
CONTACTOR
ORIGIN: ICD
12/1/79 JS

REVISION: 6
TRIPPER INTERLOCK COT
ADDED TO OPEN CONTACTOR
& CLOSE CONTACTOR
ADDED TO CABLE REEL
CONTACTOR
ORIGIN: ICD
12/1/79 JS

REVISION: 5
DESK TERMINALS
ADDED
ORIGIN: ICD
1/2/72 SCD JS

REVISION: 4
CHUTE BLOCK
INDICATION WAS
ADDED TO TERM TC
ORIGIN: E1SR
10/9/71 SCD JT

REVISION: 3
QF3 3AR, 3AR, 3AR
& 3AR CONTACTS
MODIFIED
ORIGIN: E1SR
2/5/77 SCD JT

REVISION: 2
3AR & 3AR
CONTACTS MODIFIED
ORIGIN: E1SR
26/2/77 SCD JT

REVISION: 1
3AR & 3AR
CONTACTS MODIFIED
ORIGIN: E1SR
19/2/74 SCD JT

THE DESIGN AND MANUFACTURING INFORMATION CONTAINED IN THIS DRAWING IS THE EXCLUSIVE RIGHT OF DEWHURST & PARTNER LTD. AND MUST NOT BE COPIED OR USED FOR MANUFACTURING PURPOSES.		ISSUE	
DTX 361U/4		1/2/74	
DTX 361U/4		1/2/74	
DRAWN BY: A.M.		KEY DIAG. N°	
CHECKED BY: M.L.T.		EXT. DIAG. N° STX 361U	
APPROVED BY:		REL. DIAG. N°	
DATE:		PANEL LAYOUT N° HTX 361U	