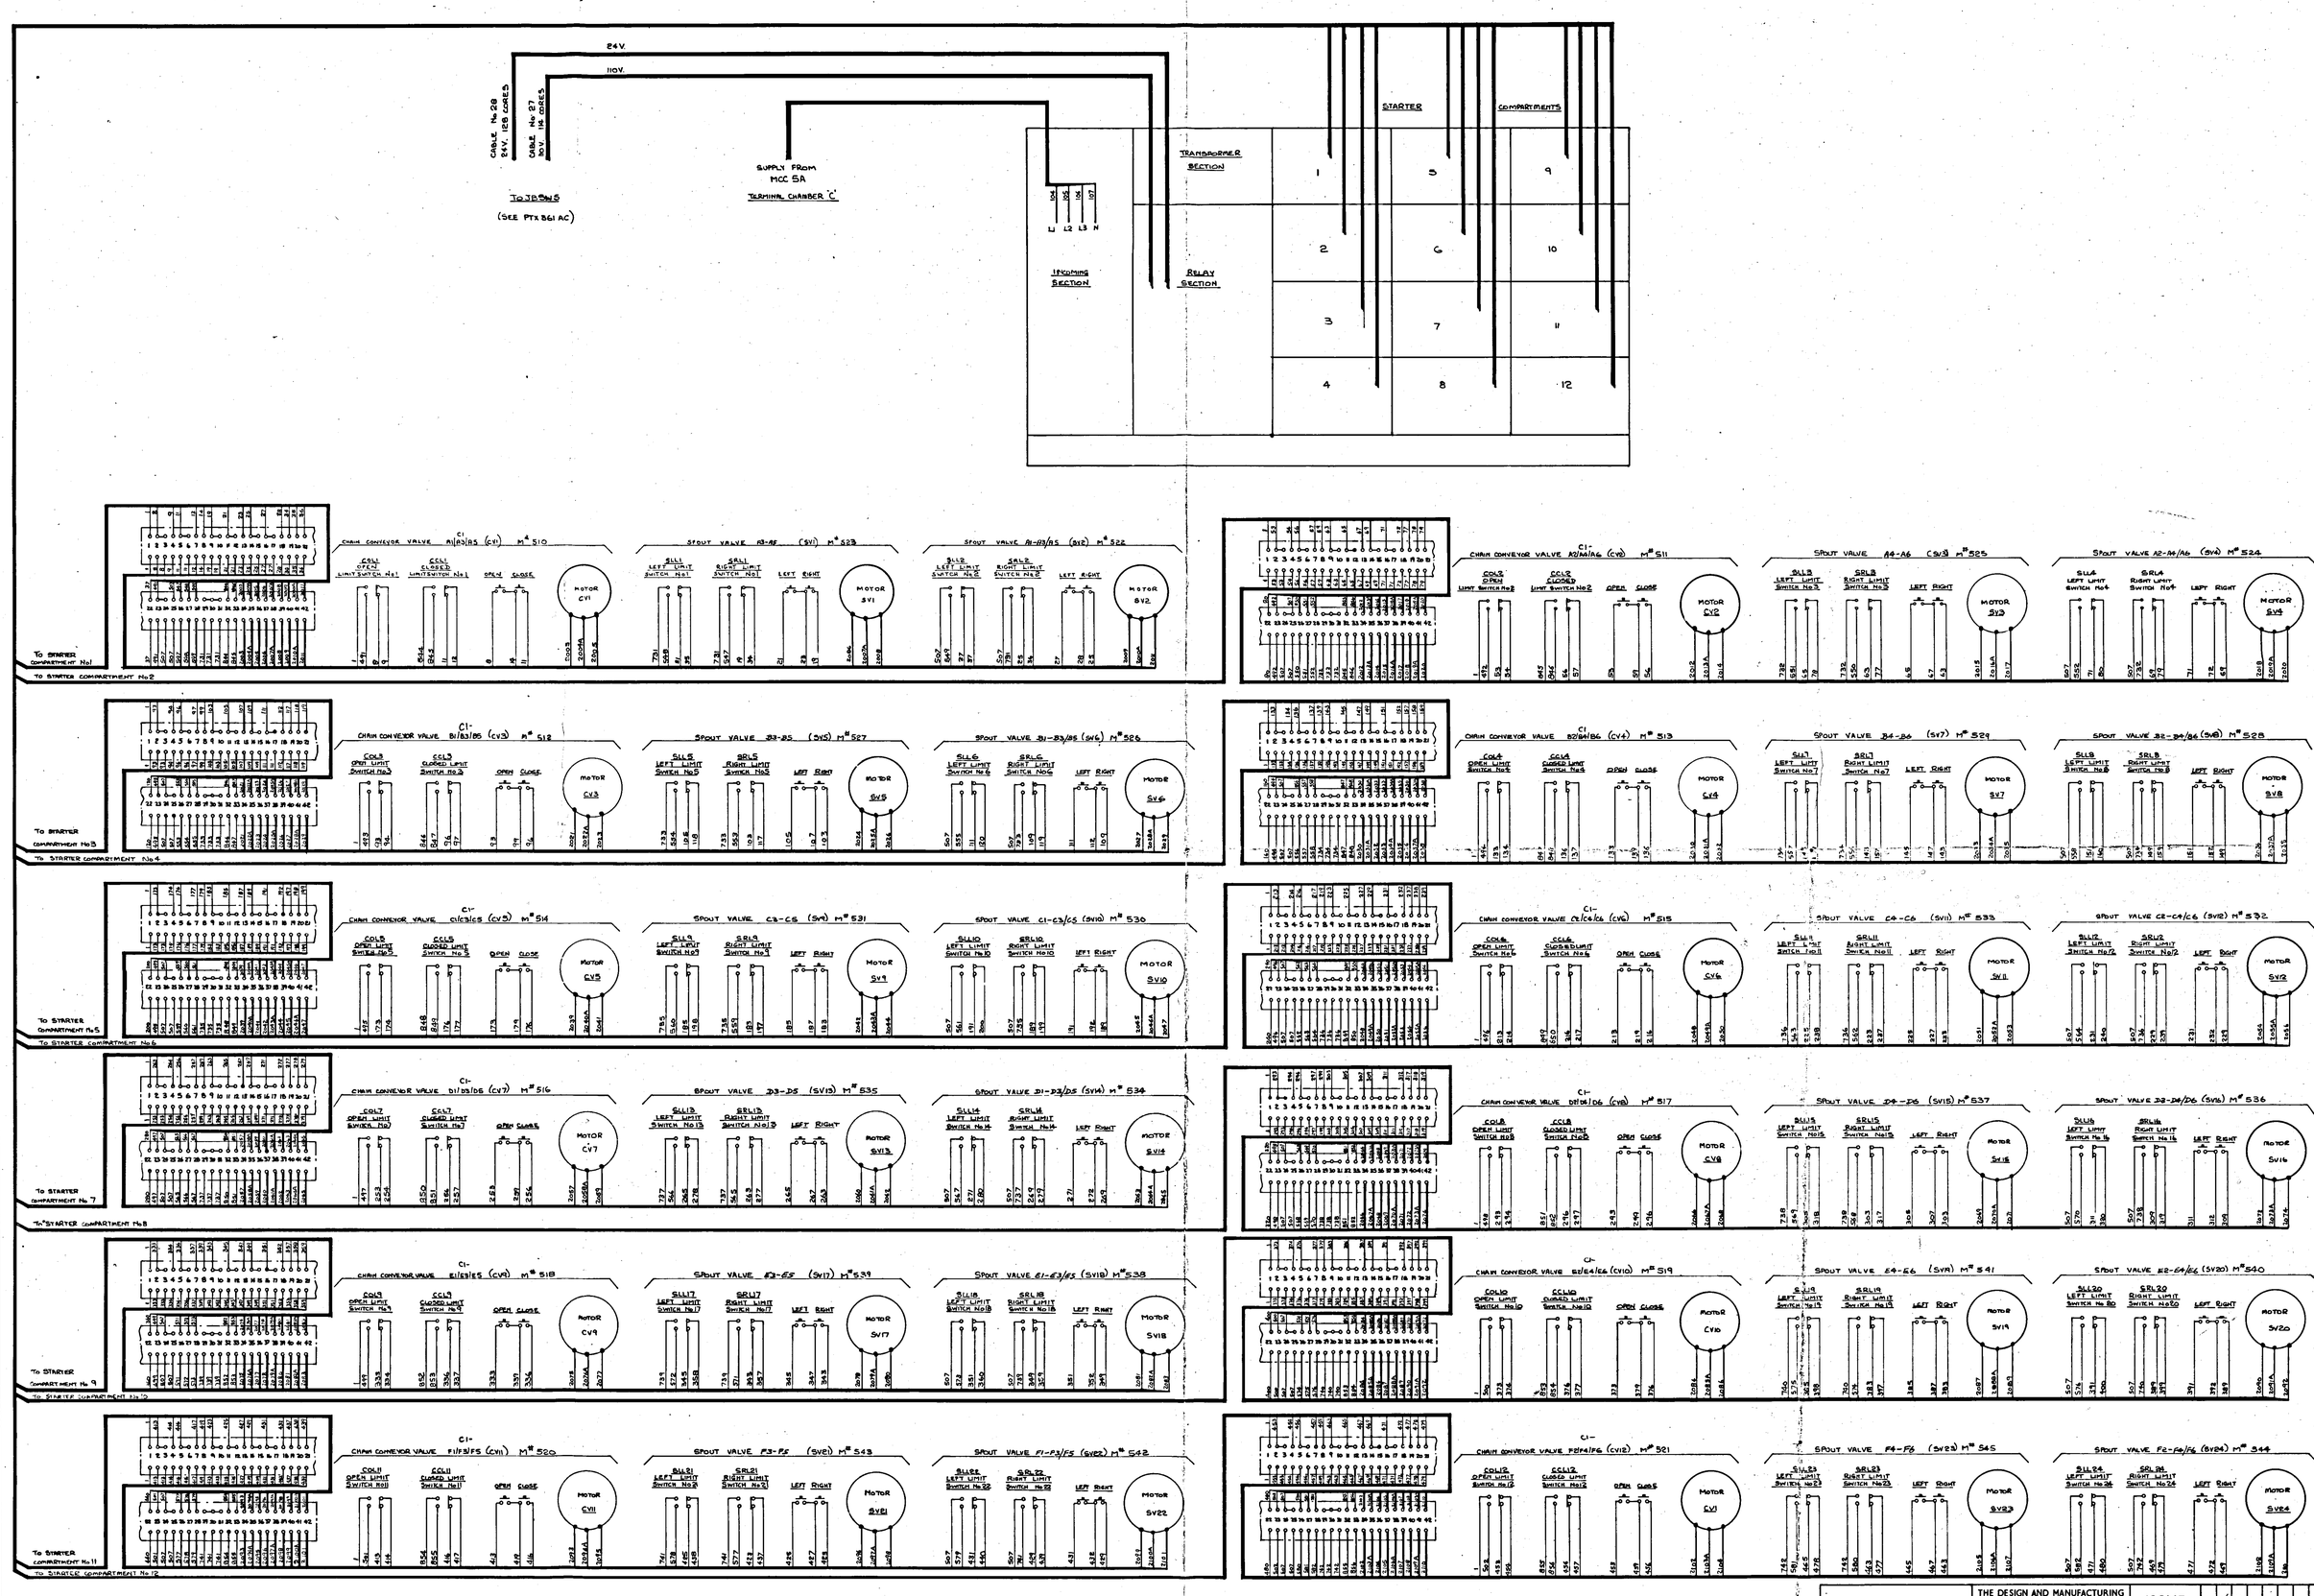


NUMBERS ADJACENT TO LOOKUS INDICATE TERMINAL DESIGNATION ONLY - NOT WIRE NUMBERS

EXTERNAL WIRING DIAGRAM FOR MCC 5 B.
SEAFORTH GRAIN TERMINAL

THE DESIGN AND MANUFACTURING INFORMATION CONTAINED IN THIS DRAWING IS THE EXCLUSIVE RIGHT OF DEWHURST & PARTNER LTD. AND MUST NOT BE COPIED OR USED FOR MANUFACTURING PURPOSES.

ISSUE X Z 3

STX 361 AC

DEWHURST & PARTNER LTD.
MELBOURNE WORKS HOUNSLOW

TITLE: EXTERNAL WIRING DIAGRAM FOR MCC 5B - SEAFORTH GRAIN TERMINAL

REVISION:	REVISION:	REVISION:	REVISION: 2 WIRES 731-742 DID GO BACK TO THE PANEL.	REVISION: 1 SPOUT VALVE DESIGNATIONS INTERCHANGED.	DRAWN BY	J. Thomas
ORIGIN: / / SGD.	ORIGIN: / / SGD.	ORIGIN: / / SGD.	ORIGIN: EHP 18/6/71 SGD JE	ORIGIN: EISP 3/5/71 SGD BSC	DATE	16/6/71
					CHECKED BY	
					APPROVED BY	
					DATE	

KEY DIAG. No.	DTX 361 AC
EXT. DIAG. No.	—
REL. DIAG. No.	
PANEL LAYOUT No.	HTX 361 AC

STX 361 AC

ADMEX 4317