


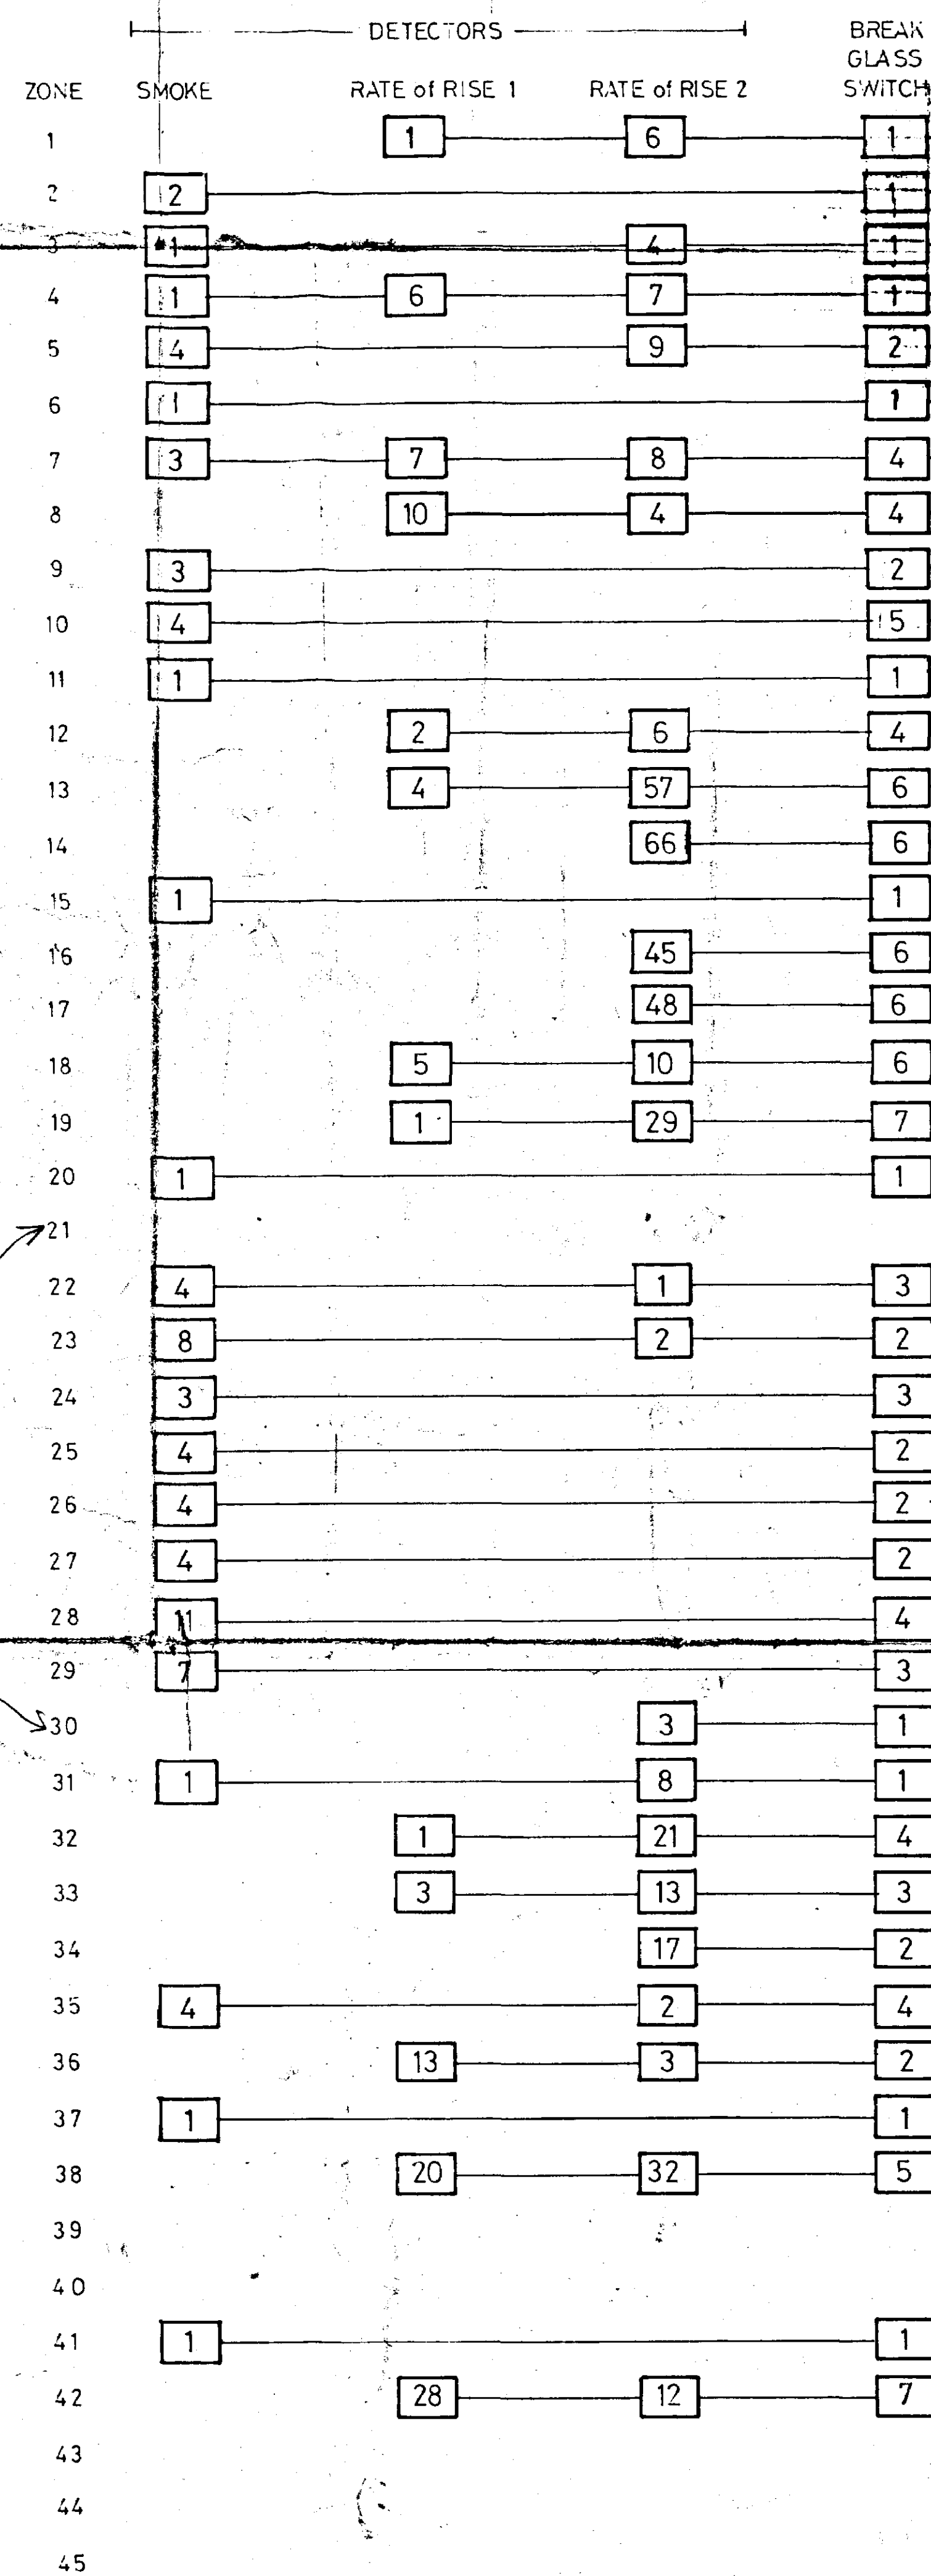

FIRE
BRIGADE
LINK UNIT

AUDIBLE
ALARMS

REPEATER
PANELS

CONTROL
UNITS

24V. DC

BATTERY
&
CHARGER

240V. AC
MAINS SUPPLY

ISS.	D. C. N.	CHANGE, DATE & SIGNATURE
A		INTRODUCED 20.1.72 DAB
B		GENERAL MODIFICATIONS 27.3.77 G.C.G.M.
C		REDESIGN TO INCLUDE ZONES 36, 37, 38, 41 & 42 D.M. 15.10.76

MATERIAL	FINISH
SPECIFICATION	
CODE No.	

DESIGN	APP.	DATE
APP.		
CKD.		
DRN.	D.M. 15.10.76	DATE 15.10.76

1/51 ON SEAFOOTH GRAY TERMINAL, LIVERPOOL

INDUSTRIAL FIRE PROTECTION DIVISION

DESCRIPTION
PROPOSED FIRE DETECTION SYSTEM
DEWHURST & PARTNER LTD.

LOGIC DIA. DRG. No. 82000-012 LD