10819

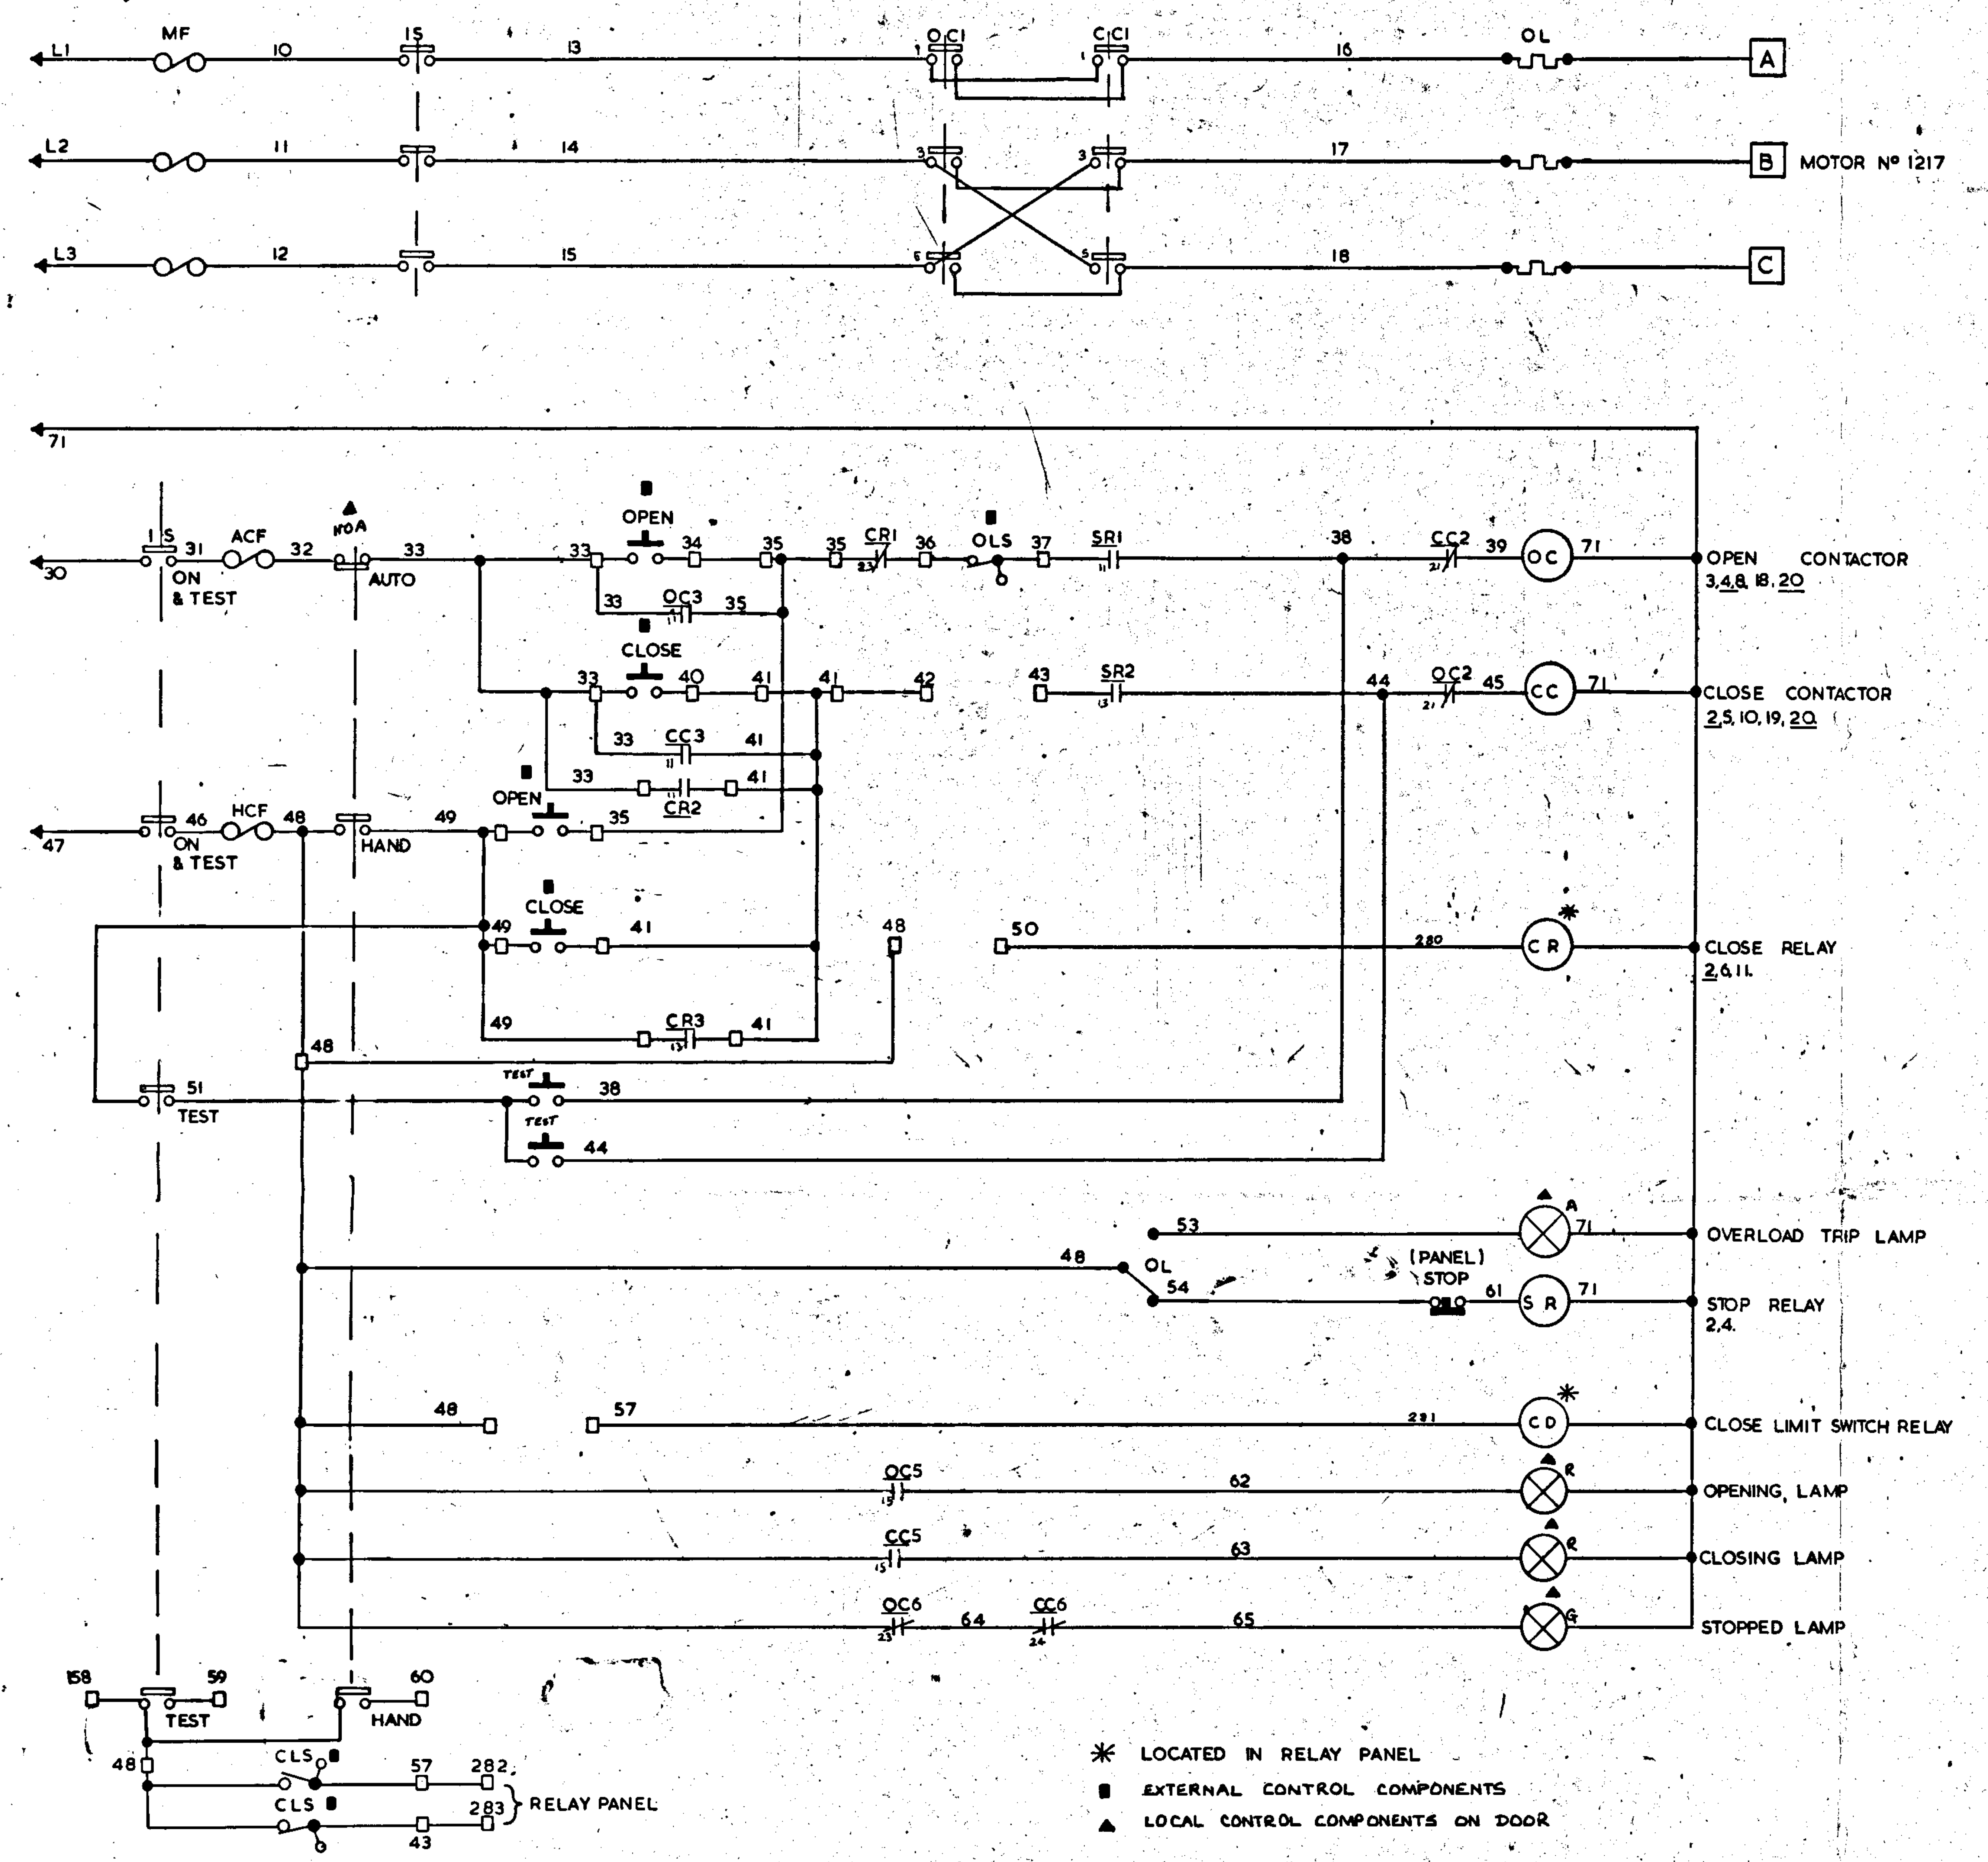
L1
MF
10
IS
13
OC1
CC1
16
OL
A
L2
11
14
17
B
MOTOR Nº 1217
L3
12
15
18
C
71
30
IS
31
ON & TEST
ACF
32
NOA
33
AUTO
OPEN
34
35
OC3
CR1
36
OLS
37
SR1
38
CC2
39
OC
OPEN CONTACTOR
3,4,8, 18, 20
CLOSE
40
41
42
43
SR2
44
OC2
45
CC
CLOSE CONTACTOR
2,5, 10, 19, 20
CC3
CR2
47
46
HCF
48
HAND
49
CR3
50
280
CR
CLOSE RELAY
2,6,11.
51
TEST
53
OVERLOAD TRIP LAMP
OL
54
(PANEL) STOP
61
SR
STOP RELAY
2,4.
57
281
CD
CLOSE LIMIT SWITCH RELAY
OC5
62
OPENING LAMP
CC5
63
CLOSING LAMP
OC6
64
CC6
65
STOPPED LAMP
158
59
60
CLS
282
283
43
RELAY PANEL
1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21

✳ LOCATED IN RELAY PANEL

▮ EXTERNAL CONTROL COMPONENTS

▲ LOCAL CONTROL COMPONENTS ON DOOR

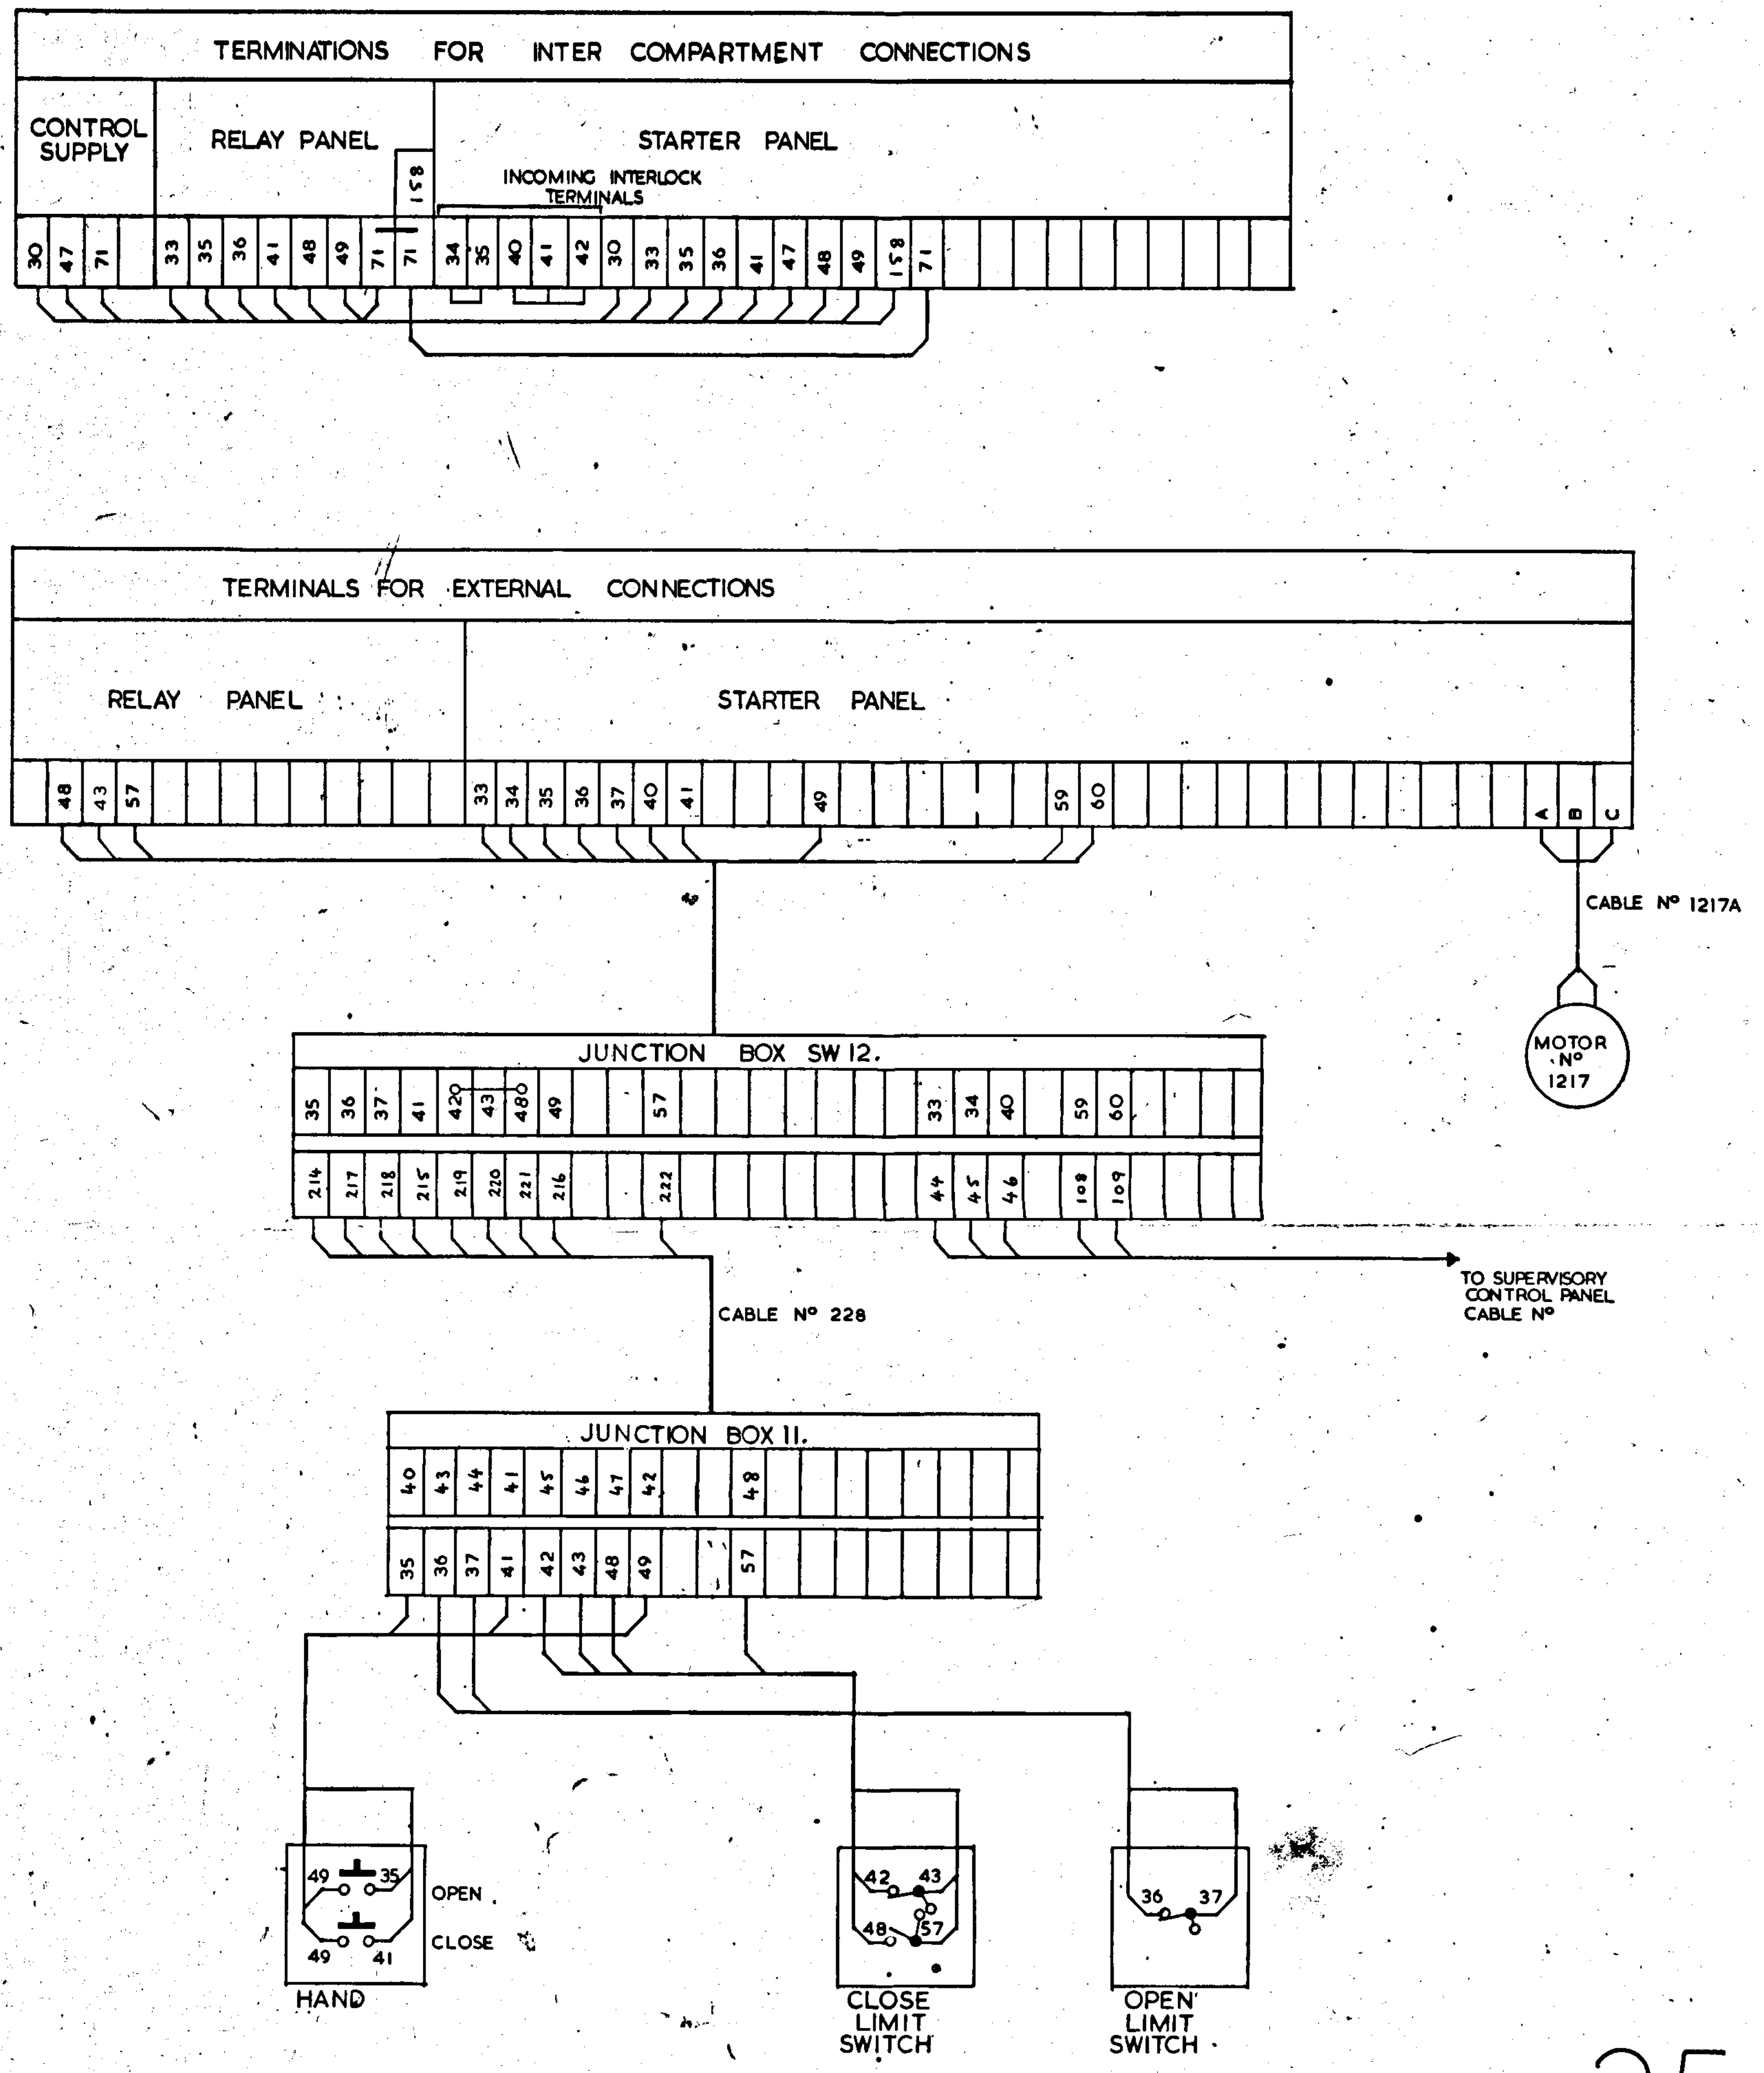
TERMINATIONS FOR INTER COMPARTMENT CONNECTIONS
CONTROL SUPPLY
RELAY PANEL
STARTER PANEL
INCOMING INTERLOCK TERMINALS
30 47 71
33 35 36 41 48 49 71 71 158
34 35 40 41 42 30 33 35 36 41 47 48 49 158 71
TERMINALS FOR EXTERNAL CONNECTIONS
RELAY PANEL
STARTER PANEL
48 43 57
33 34 35 36 37 40 41 49 59 60
A B C
CABLE Nº 1217A
MOTOR Nº 1217
JUNCTION BOX SW 12.
35 36 37 41 420 43 480 49 57 33 34 40 59 60
214 217 218 215 219 220 221 216 222 44 45 46 108 109
TO SUPERVISORY CONTROL PANEL CABLE Nº
CABLE Nº 228
JUNCTION BOX 11.
40 43 44 41 45 46 47 42 48
35 36 37 41 42 43 48 49 57
49 35
OPEN
CLOSE
49 41
HAND
42 43
48 57
CLOSE LIMIT SWITCH
36 37
OPEN LIMIT SWITCH

10819

25.

ALL CONTROL TERMINALS PREFIXED '12M4'

THE DESIGN AND MANUFACTURING INFORMATION CONTAINED IN THIS DRAWING IS THE EXCLUSIVE RIGHT OF DEWHURST & PARTNER LTD. AND MUST NOT BE COPIED OR USED FOR MANUFACTURING PURPOSES.

ISSUE	~~1~~	~~2~~	~~3~~	~~4~~	~~5~~	~~6~~	7

CTX361BW

REVISION: 6
SINCE VALVE NO LONGER MOTORISED 'CLS' LIMITS USED TO SHOW INDICATION ON S.C.P. TERMS 42&48 LINKED IN JB SW12 ALSO TERM 43 TAKEN TO R.P.
ORIGIN: ICD
16/1/78 A.L.J.B.

REVISION: 5
TERMS. TO S.C.P. ADDED + MINOR MODS
ORIGIN: ICD
29/6/77 A.L.J.B.

REVISION: 4
GEN. MODS
ORIGIN: ICD
28/3/77 A.L.J.B.

REVISION: 3.
MINOR MODS.
ORIGIN: 4/1/77 SGD. A.M.

REVISION: 2
REMOTE STOP PUSHBUTTON REMOVED.
ORIGIN: 17/1/77 SGD. A.M.

REVISION: 1
OPENING, CLOSING & STOPPED LAMPS ADDED.
ORIGIN: 3/12/76 SGD. A.M.

DRAWN BY BSS
DATE 14.10.76
CHECKED BY
APPROVED BY
DATE 3.12.76

KEY DIAG. No.
EXT. DIAG. No.
REL. DIAG. No.
PANEL LAYOUT No.

CTX361BW

DEWHURST & PARTNER LTD.
MELBOURNE WORKS HOUNSLOW

TITLE:
BASEMENT CHAIN CONVEYOR 2 VALVE 1
MCC12B
BCC2V1