

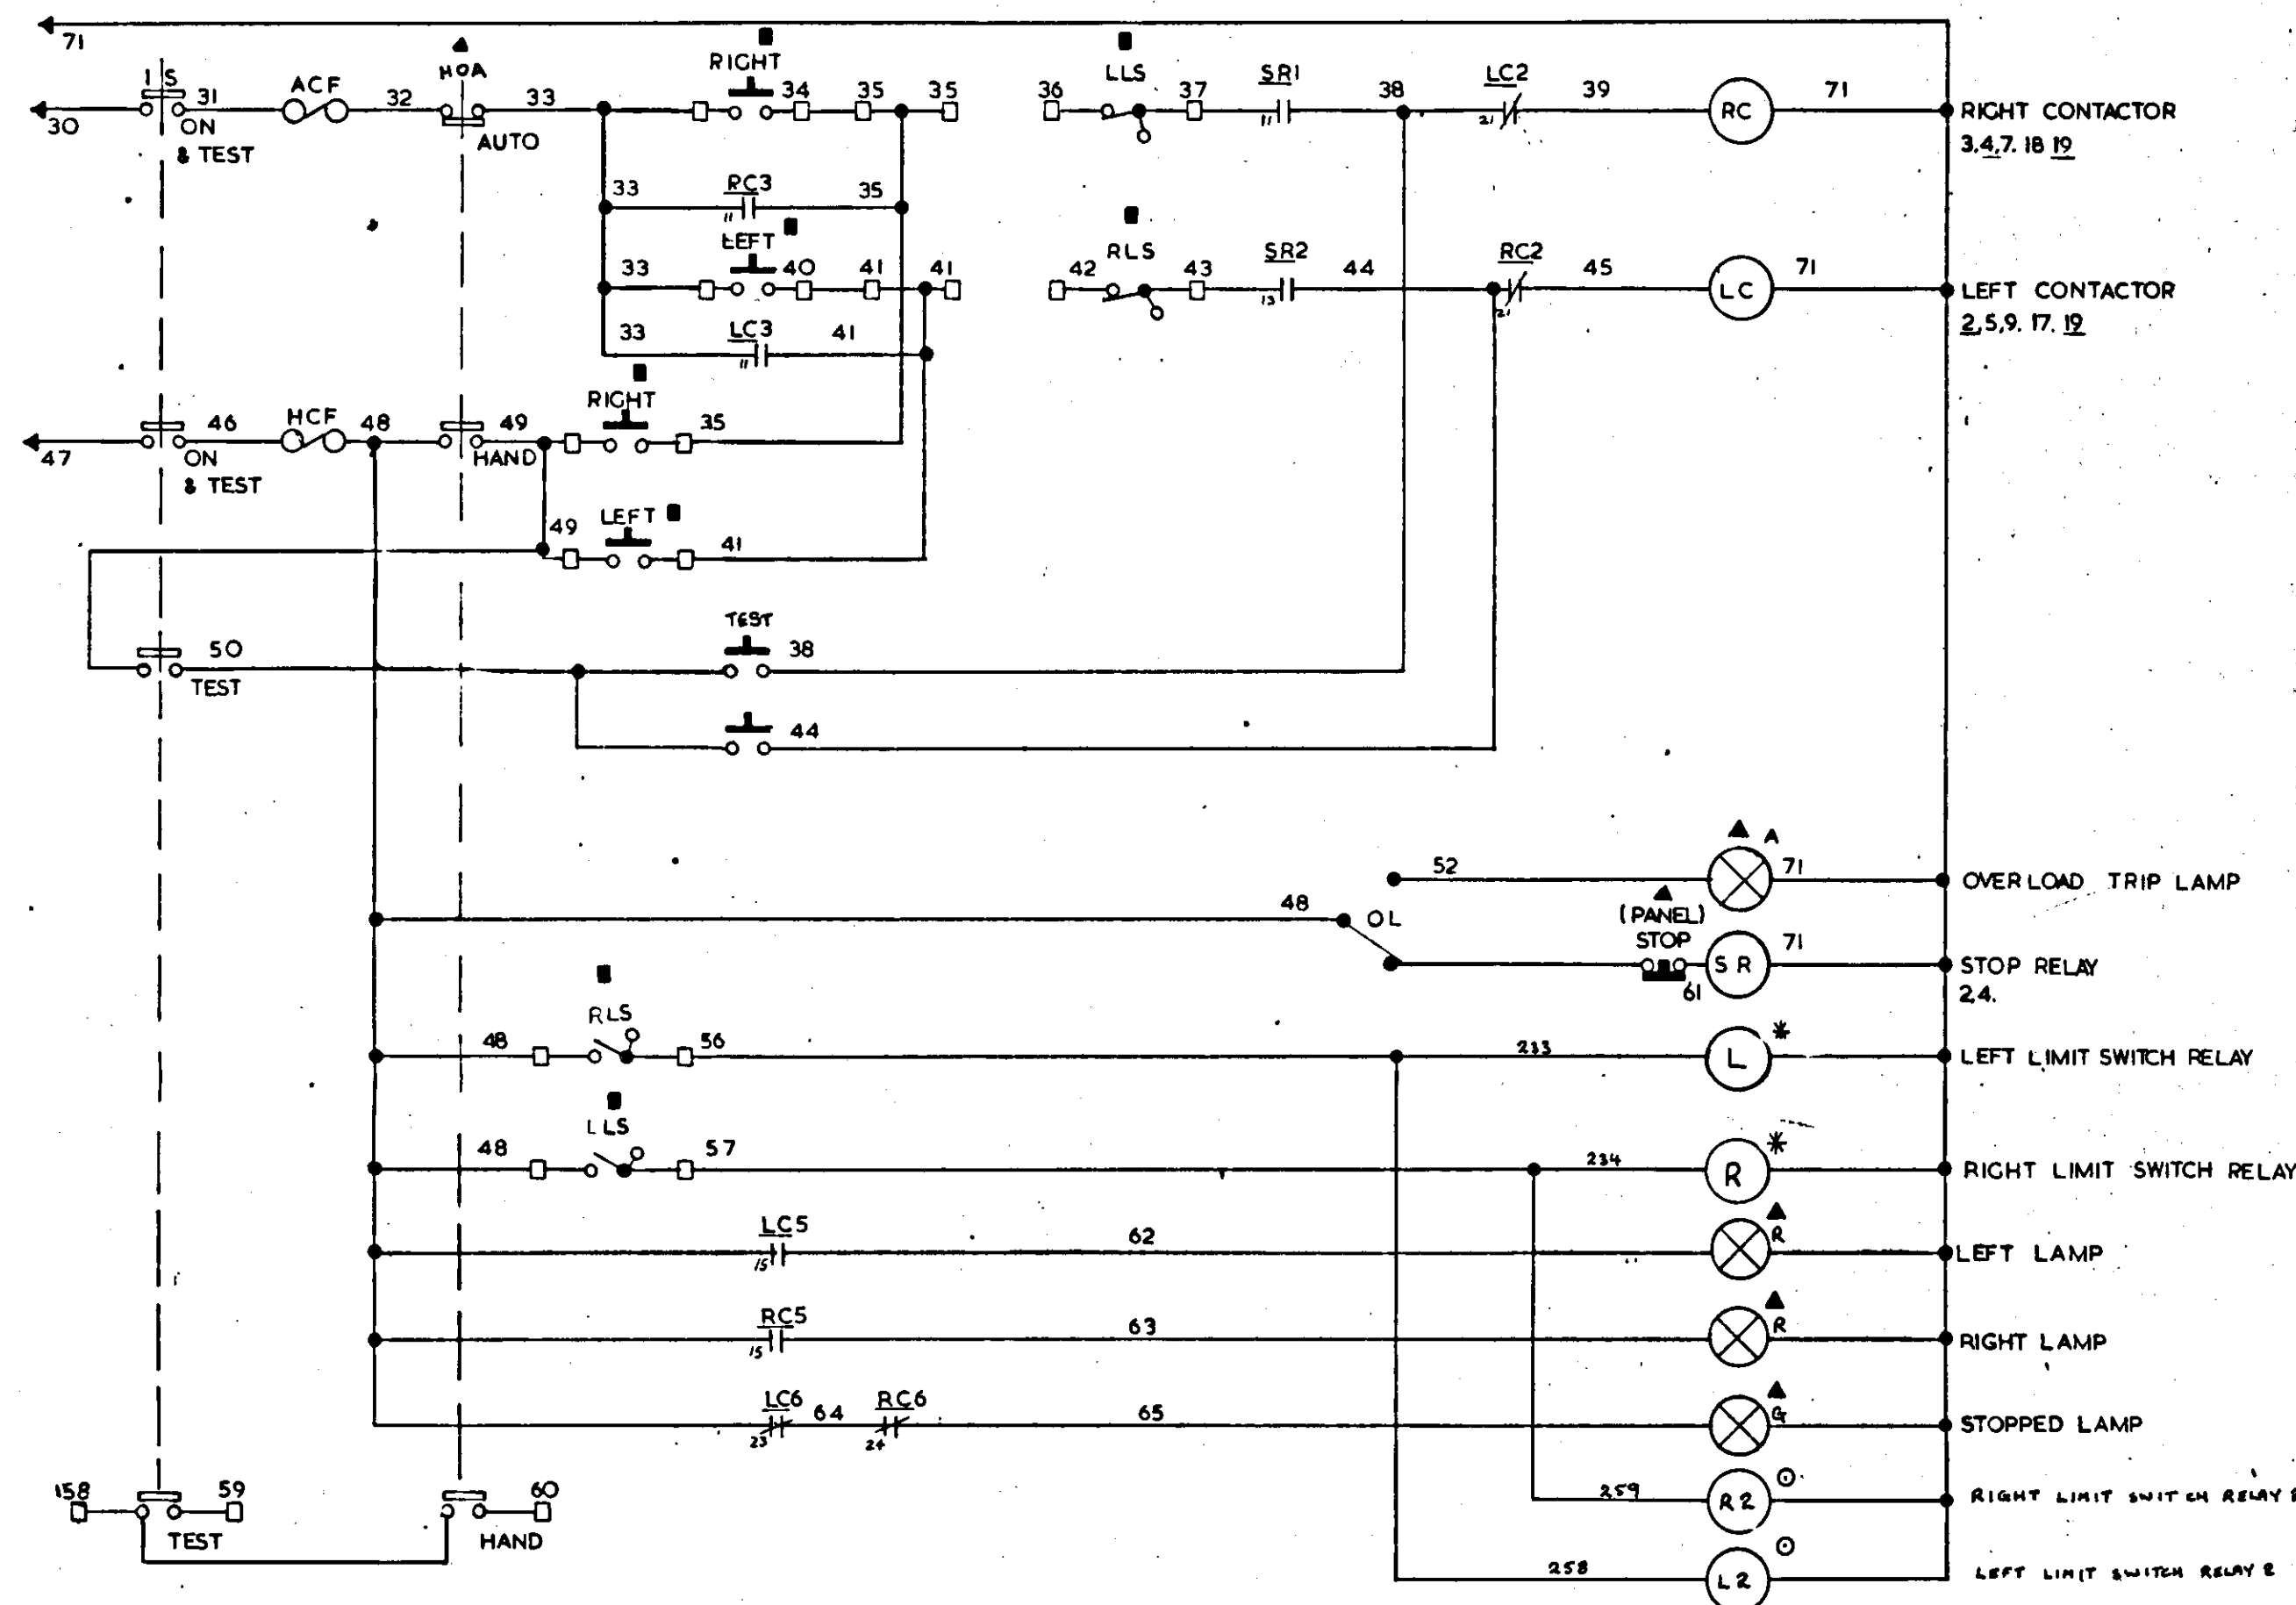
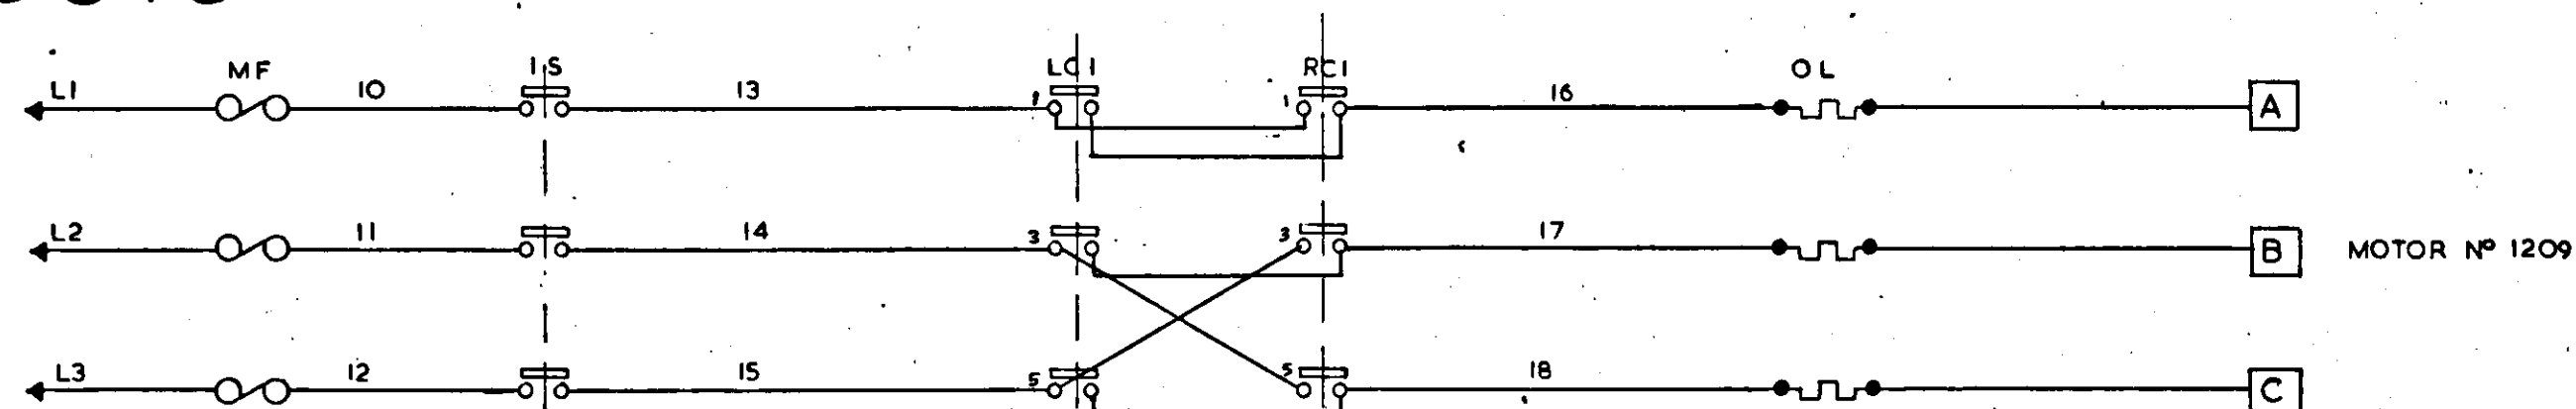
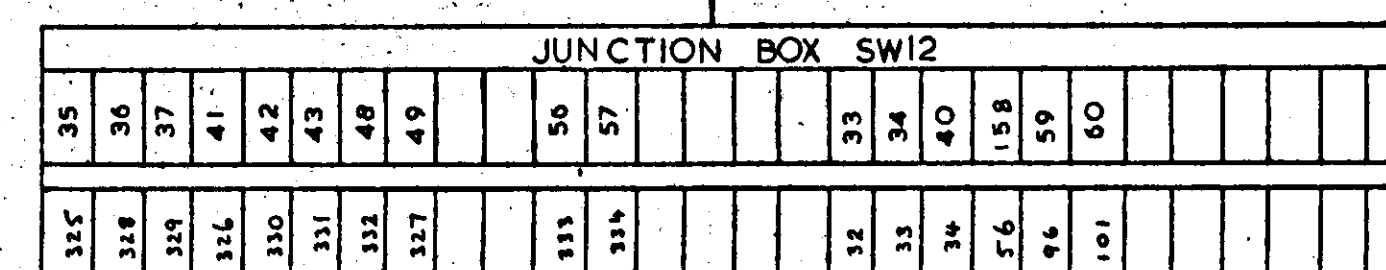


10816


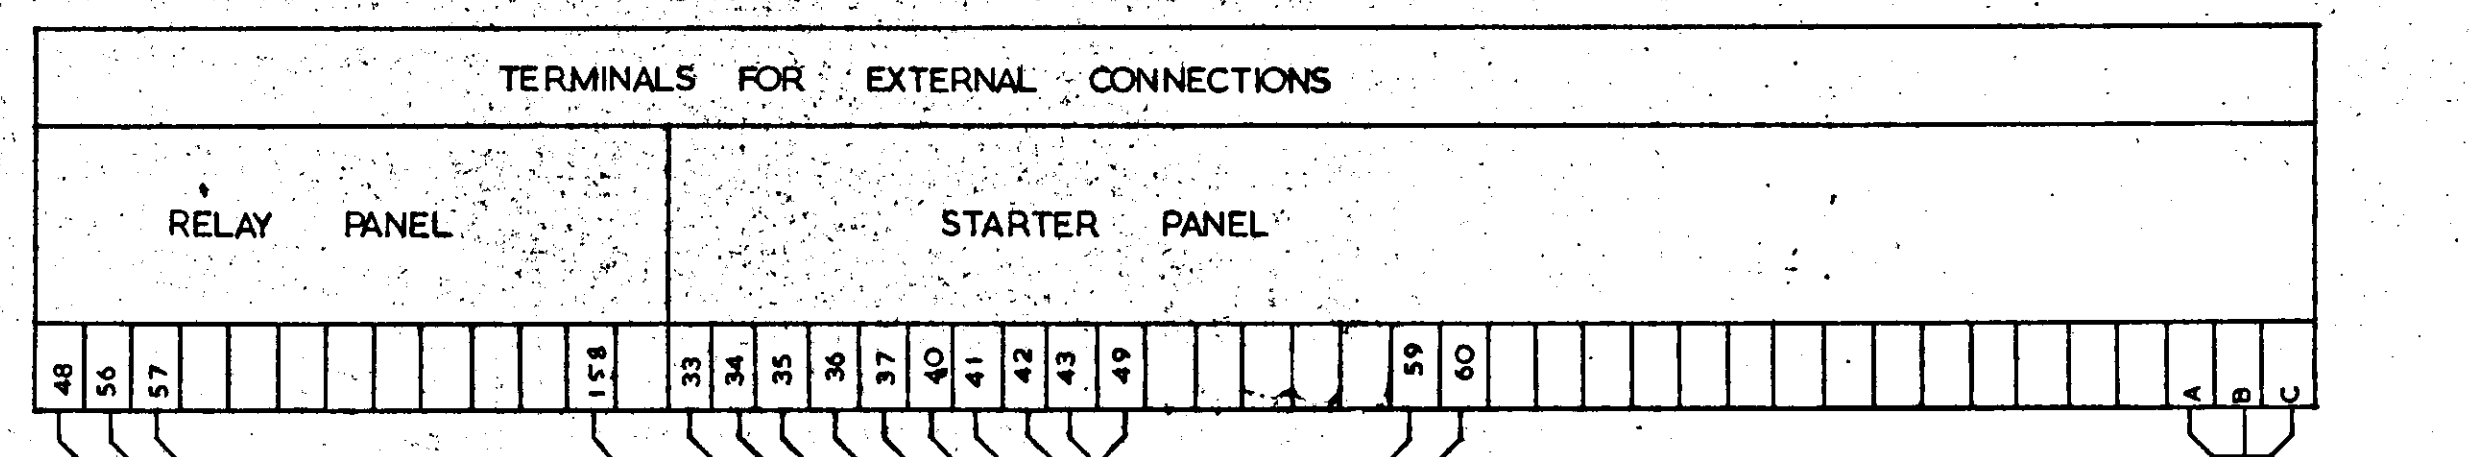


- LOCATED IN SW/RM 2 RELAY PANEL
- * LOCATED IN RELAY PANEL
- EXTERNAL CONTROL COMPONENTS
- ▲ LOCAL CONTROL COMPONENTS ON DOOR

VALVE RIGHT POSITION ROUTED TO ELEVATOR L3
VALVE LEFT POSITION ROUTED TO ELEVATOR L4

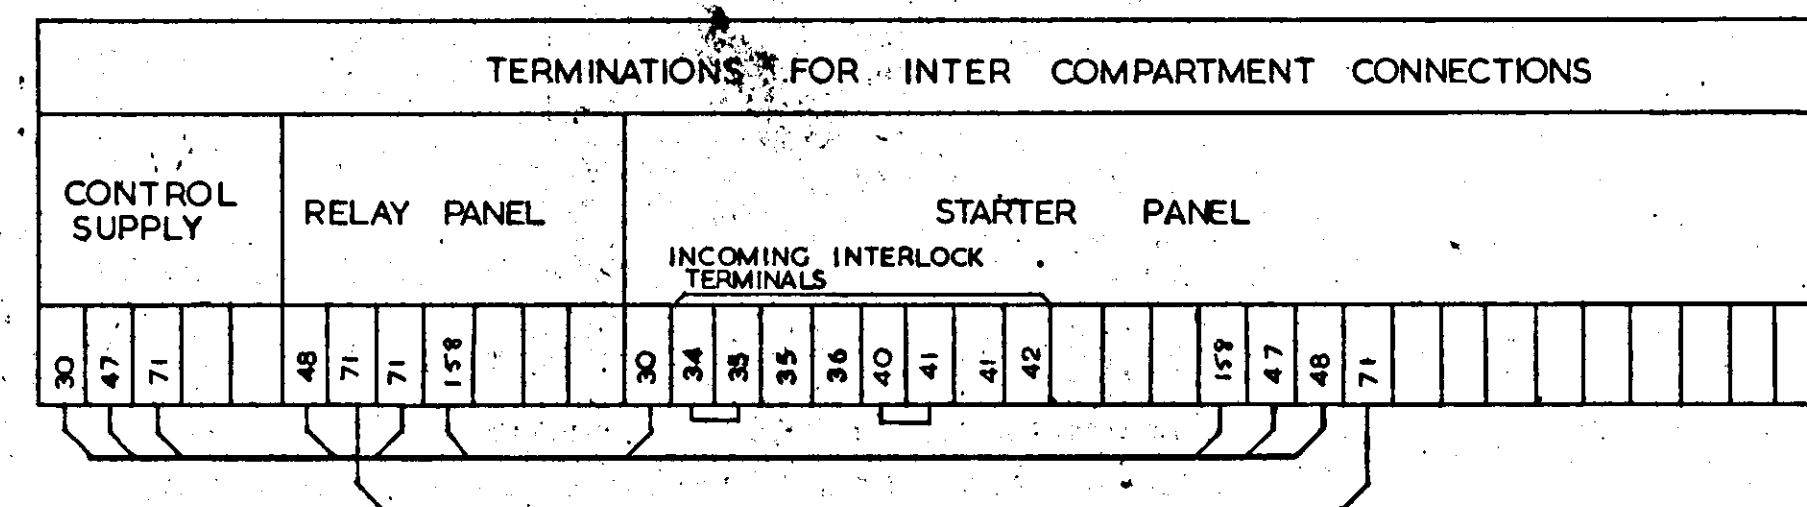

→ TO SUPERVISORY
CONTROL PANEL -
CABLE N°

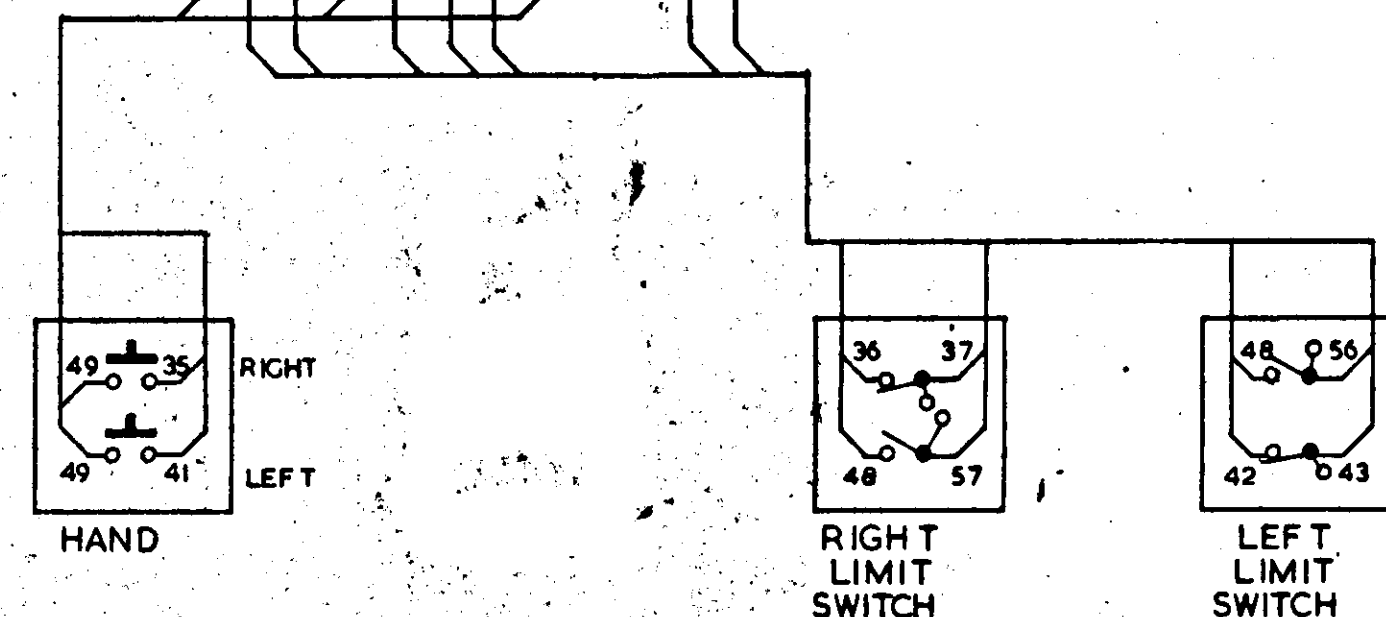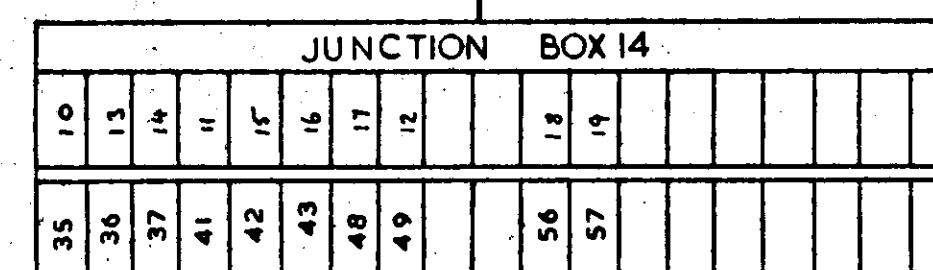

22

10816

DEWHURST & PARTNER LTD.

MELBOURNE WORKS

HOUNSLOW

TITLE :

BASEMENT BELT 6 VALVE 1

MCCI2B

BB6 VI

REVISION: 8

VALVE RIGHT POSITION
ROUTED TO ELEVATOR 1
VALVE LEFT POSITION
ROUTED TO ELEVATOR L
29/4/93 . K.

REVISION: 7.

3.	LEFT & RIGHT LIMITS REPOSITIONED. ONE TO ACTUAL POSITION OF LIMITS. ORIGIN: ICD	TERM. NO. 15 TO SCP ADDED ORIGIN: ICD
4.	9/1/77 AJTB	16/8/77 SGDA

REVISION: 5

TERMS. TO SCARRO
LE ALL AMRO
+ MINOR MODS.
ORIGIN: ICD

GEN. MODS
ORIGIN: ICD

29/1/77 A-L-J-B
28/1/77 A-L-J-B

REVISION: 4

GEN. MODS
ORIGIN: ICD
28/3/77 A-L-J-B

ALL CONTROL TERMINALS PREFIXED '12 L2'

THE DESIGN AND MANUFACTURING
INFORMATION CONTAINED IN
THIS DRAWING IS THE EXCLUSIVE
RIGHT OF DEWHURST & PARTNER
LTD. AND MUST NOT BE COPIED
OR USED FOR MANUFACTURING
PURPOSES.

ISSUE	1	2	3	4	5	6	7	8	9
-------	---	---	---	---	---	---	---	---	---

CTX361BS

CTX361BS