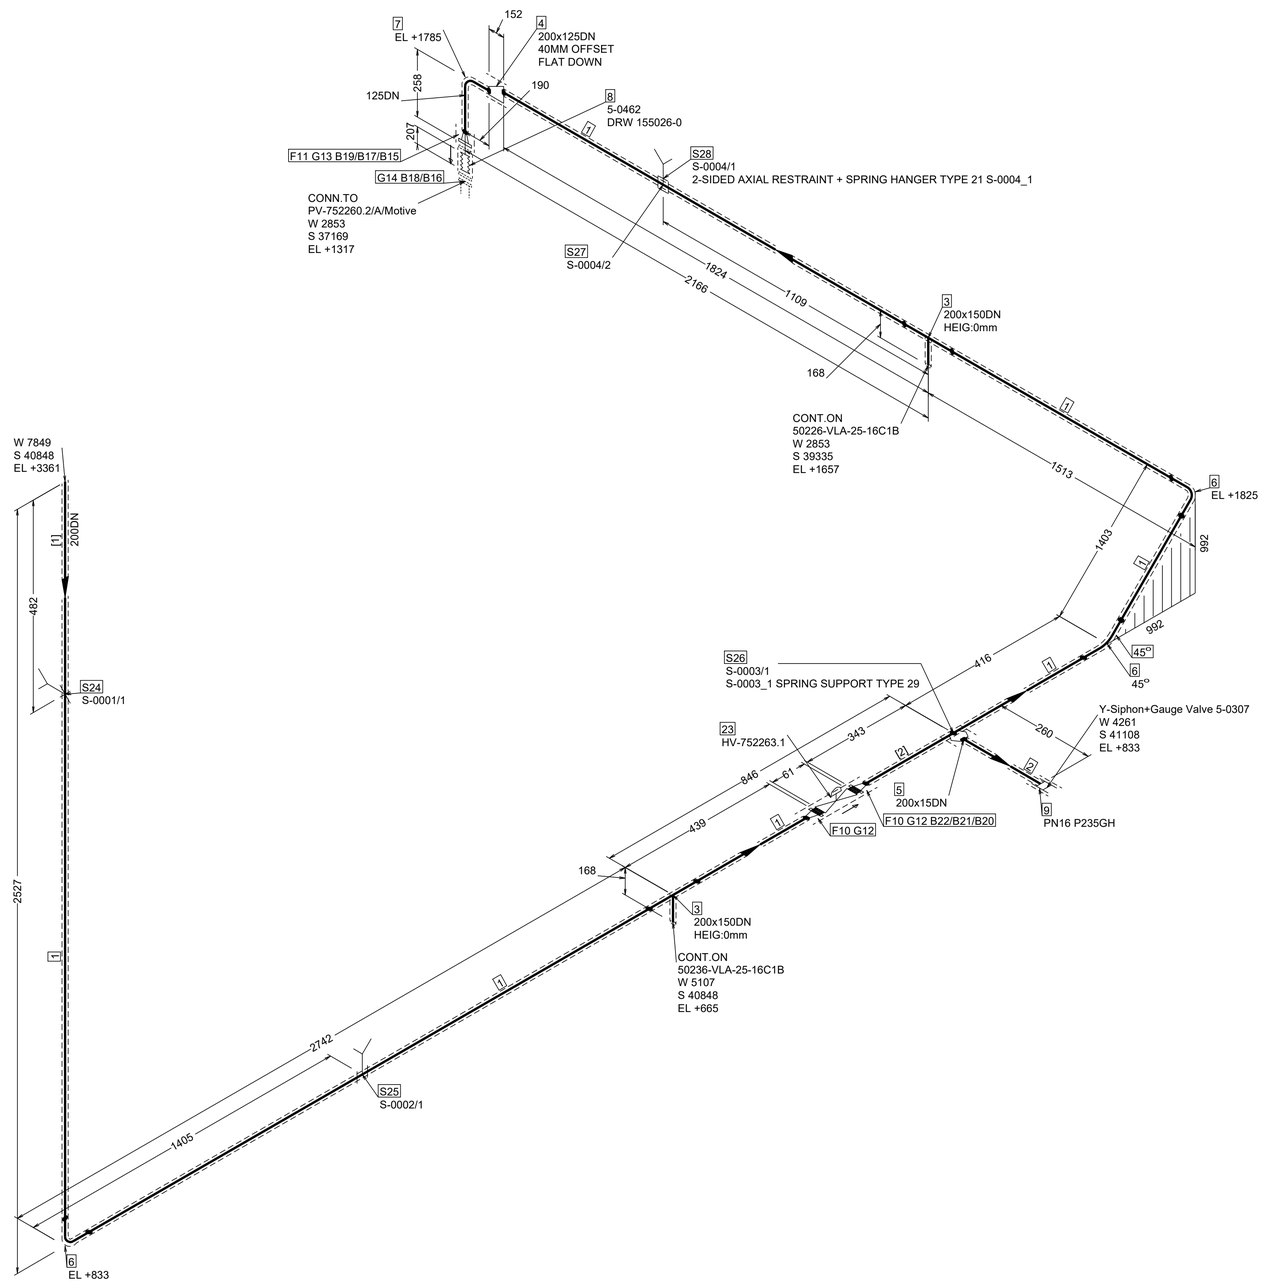

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 219.1 x 6.30 - EN 10216-2 - P235GH-TC1	200	119440-VE16C1C-R00	8899MM
2	Tube - 21.3 x 2.00 - EN 10216-2 - P235GH-TC1	15	119440-VE16C1C-R00	50MM
3	Reduced tee - EN 10253-2 - type A - 219.1 x 6.30 / 168.3 x 5.60 - P235GH-TC1	200 x 150	119440-VE16C1C-R00	2
4	Eccentric reducer - EN 10253-2 - type A - 219.1 x 6.30 / 139.7 x 4.00 - P235GH-TC1	200 x 125	119440-VE16C1C-R00	1
5	Set on Tee with Bran made of EN 10216-2 TUBE 21.3 x 5.00 H=100 - P235GH-TC1	200 x 15	119440-VE16C1C-R00	1
6	Elbow - EN 10253-2 - type A - model 3D - 90deg - 219.1 x 6.30 - P235GH-TC1	200	119440-VE16C1C-R00	3
7	Elbow - EN 10253-2 - type A - model 3D - 90deg - 139.7 x 4.00 - P235GH-TC1	125	119440-VE16C1C-R00	1
8	Expansion joint, flanged DRW 155026-0 5-0462	125	DATACOMP-TEST	1
9	HALF SOCKET FEMALE THR/BW R-203 316 PN16 P235GH	15	KBE/BBB001	1
10	Weld-neck flange - EN 1092-1 - type 11 - B1 - 219.1/DN200 - PN16 - P250GH	200	119440-VE16C1C-R00	2
11	Weld-neck flange - EN 1092-1 - type 11 - B1 - 139.7/DN125 - PN40 - P250GH	125	119440-E16C1B-R00	1

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
12	Gasket - EN 1514-1 - type IBC - OD219.1/DN200 - 1.5mm Thk - PN16 Fiber	200	119440-VE16C1C-R00	2
13	Gasket - EN 1514-1 - type IBC - OD139.7/DN125 - 1.5mm Thk - PN16 Fiber	125	119440-VE16C1C-R00	1
14	GASKET EN 1514-1 1.5mm THK PN40 RF	125	KBE/VE25C1C	1
15	100 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		8
16	80 mm Bolt EN ISO 4014 8.8 with A >=14%, Hot Dip Galvanized or 5.6, HDG	24		8
17	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		8
18	Hexagon nut EN ISO 4032 8 with A>=14%, Hot Dip Galvanized or 5, HDG	24		8
19	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	24		16
20	150 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		12
21	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		12
22	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	20		24
23	KPK BASIC BUTTERFLY VALVE WAFER PN16 SINGLE ACTING ACTUATOR HV-752263.1	200	KBE/INST01	1
	SUPPORTS			
24	1-SIDED ANCHOR PSK 7303 TYPE 9, HIGH See supportlist	200	VOFSUPP-PRIM-PSK-ATTA	1
25	1-SIDED AXIAL RESTRAINT PSK 7303 TYPE 7, HIGH See supportlist	200	VOFSUPP-PRIM-PSK-ATTA	1
26	Lisega Spring Support, drwg no S-0003_1 SPRING SUPPORT TYPE 29	200	VOFSUPP-PRIM-NON-ATTA	1
27	2-SIDED AXIAL RESTRAINT PSK 7303 TYPE 8, HIGH See supportlist	200	VOFSUPP-PRIM-PSK-ATTA	1
28	Special support 2-SIDED AXIAL RESTRAINT + SPRING HANGER TYPE 21 S-0004_1	200	VOFSUPP-PRIM-NON-ATTA	1

PIPE SPOOLS

[1] [2]

ORIGO & MARKINGS

E 18465 North East N 39915

23 U +-119 G

[1] DENOTES PARTS LIST
(1) DENOTES WELD NO.
1 DENOTES REVISION
INSULATION
INSUL. + TRACE
BRANCH START POINT

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
200	120mm	11429mm	/PSK3704-4a-good
125	120mm	658mm	/PSK3704-4a-good
15	50mm	261mm	/PSK3704-4a-good

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

				Hazardous CLP content	
		Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00
		Design press. (min)	-1bar	PED Category	I
		Design temp. (min)	-	Media	
		Max. allow. press. (PS)	-	Standard	
		Operating press.	8.5bar	P&ID	RAU8F00303
Welding factor	Acc. to pipe class	Operating temp.	198degC	Design press.	10.7bar
Effiency of long. weld	Acc. to pipe class	PED Module	-	Design temp.	250degC
NDT circ. weld %	-	PED Group	-	Test press.	-
NDT long. weld %	-	Wind loads	-	Pipe list doc. ID	RAUAF04300
Welding list see doc.	-	External loads	-	Valve list doc. ID	RAUAF04301

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	29/4/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50156-HVP-200-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1/ 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/A/DESI/PIPE/HVP MDB: /119440.005 DB: PREPAA/PREPAASession: 4689 28/05/2026