


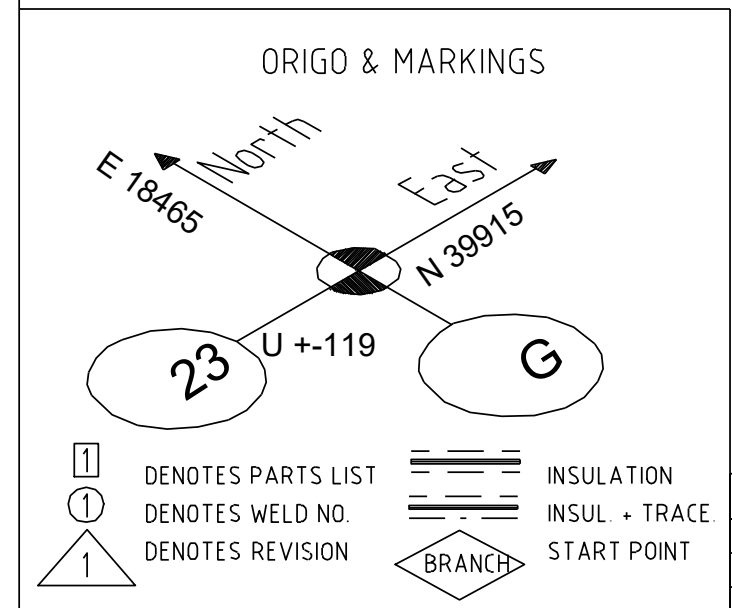

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.

Piping contractor is responsible for final routing and supporting.

		Hazardous CLP content	
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00
Design press. (min)	-1bar	PED Category	I
Design temp. (min)	-	Media	
Max. allow. press. (PS)	-	Standard	
Operating press.	5.9bar	P&ID	RAU8F00303
Operating temp	181degC	Design press.	6bar
PED Module	-	Design temp.	220degC
PED Group	-	Test press.	-
Wind loads	-	Pipe list doc. ID	RAUAF04300
External loads	-	Valve list doc. ID	RAUAF04301

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 88.9 x 3.20 - EN 10216-2 - P235GH-TC1	80	119440-VE16C1C-R00	1798MM
2	HOSE	80	HOSES	300MM
3	Elbow - EN 10253-2 - type A - model 3D - 90deg - 88.9 x 3.20 - P235GH-TC1	80	119440-VE16C1C-R00	3
4	HOSE PROVIDED BY KADANT	80	HOSES	1
5	HOSE	80	HOSES	1
6	Weld-neck flange - EN 1092-1 - type 11 - B1 - 88.9/DN80 - PN16 - P250GH	80	119440-VE16C1C-R00	3
7	Dummy wn flange - DIN 2633 80x88.9 PN16 Delivered with component	80	DUMMY-FLANGES	2
NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
8	Gasket - EN 1514-1 - type IBC - OD88.9/DN80 - 1.5mm Thk - PN40 Fiber	80	119440-VE16C1C-R00	4
9	70 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		32
10	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		32
11	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	16		64
12	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0330	80	KBE/ALV01	1
	<u>SUPPORTS</u>			
13	SLIDE SUPPORT PSK 7303 TYPE 1, LOW See supportlist	80	VOFSUPP-PRIM-PSK-AT TA	1

[1] [2] [3]

Project: VKB Zone: PD1-BM/A/DESI/PIPE/HMP