

A

B

C

D


E

F

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 168.3 x 4.50 - EN 10216-2 - P235GH-TC1	150	119440-VE16C1C-R00	150MM
2	Tube - 33.7 x 2.60 - EN 10216-2 - P235GH-TC1	25	119440-VE16C1C-R00	4917MM
3	Equal tee - EN 10253-2 - type A - 33.7 x 2.60 - P235GH-TC1	25 x 25	119440-VE16C1C-R00	1
4	Elbow - EN 10253-2 - type A - model 3D - 90deg - 33.7 x 2.60 - P235GH-TC1	25	119440-VE16C1C-R00	10
5	Weld-neck flange - EN 1092-1 - type 11 - B1 - 168.3/DN150 - PN16 - P250GH	150	119440-VE16C1C-R00	1
6	Blind flange - EN 1092-1 - type 05 - B1 - 168.3/DN150 - PN16 P265GH	150	119440-VE16C1C-R00	1
7	Weld-neck flange - EN 1092-1 - type 11 - B1 - 33.7/DN25 - PN40 - P250GH	25	119440-VE16C1C-R00	4
NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
8	Gasket - EN 1514-1 - type IBC - OD168.3/DN150 - 1.5mm Thk - PN16 Fiber	150	119440-VE16C1C-R00	1
9	Gasket - EN 1514-1 - type IBC - OD33.7/DN25 - 1.5mm Thk - PN40 Fiber	25	119440-VE16C1C-R00	6
10	80 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
11	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
12	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	20		16
13	55 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		24
14	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		24
15	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	12		48
16	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0364	25	KBE/VALV01	1
17	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0361	25	KBE/VALV01	1
18	KPK BASIC STEAM TRAP FLANGED PN40 5-0362	25	KBE/VALV01	1
19	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0363	25	KBE/VALV01	1
	<u>SUPPORTS</u>			
20	SPECIAL SUPPORT See supportlist CLAMP	25	VOFSUPP-PRIM-PSK-AT TA	4

PIPE SPOOLS

[1] [2] [3]

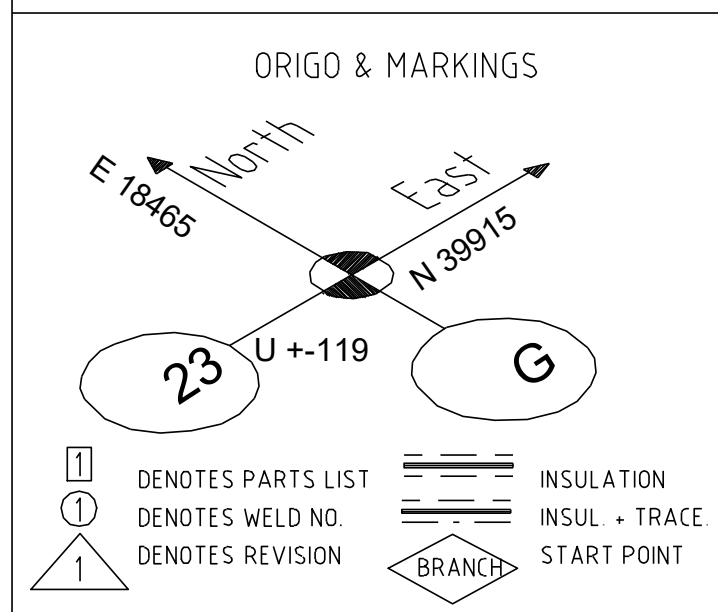

Insulation table (lengths according SSG 7645 Al(t2)			
Bore	Thickness	Length	Insulation spec name
150	60mm	397mm	/PSK3704-6a-Prot-alum
25	30mm	6688mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Efficiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content		Legal responsibility to be decided by customer.					
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00	Rev/ Revision Note		Created by	Checked by	Approved by	Date
Design press. (min)	-1bar	PED Category	1/ SEP	0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026
Design temp. (min)	-	Media		Site Tervasaari, Valkeakoski		Equipment Type Höyry- ja lauhdejärjestelmä			Equipment ID
Max. allow. press. (PSI)	-	Standard		Project Key TERFMS_NS265A		Project Name Ter PM 5 Safe Future			Project Number NS265A
Operating press.	5.9bar	P&ID	RAUF00303	Projection Method Welding Symbols ISO 2553		General Tolerances ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E			Scale A1
Operating temp.	181degC	Design press.	6bar	 This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.					
PED Module	-	Design temp.	220degC	Title 50213-VLA-25-16C1B					
PED Group	-	Test press.	-						
Wind loads	-	Pipe list doc. ID	RAUAF04300	Status CERTIFIED		Document ID			Sheet 1 / 1
External loads	-	Valve list doc. ID	RAUAF04301	Security Classification Internal					Revision 0