



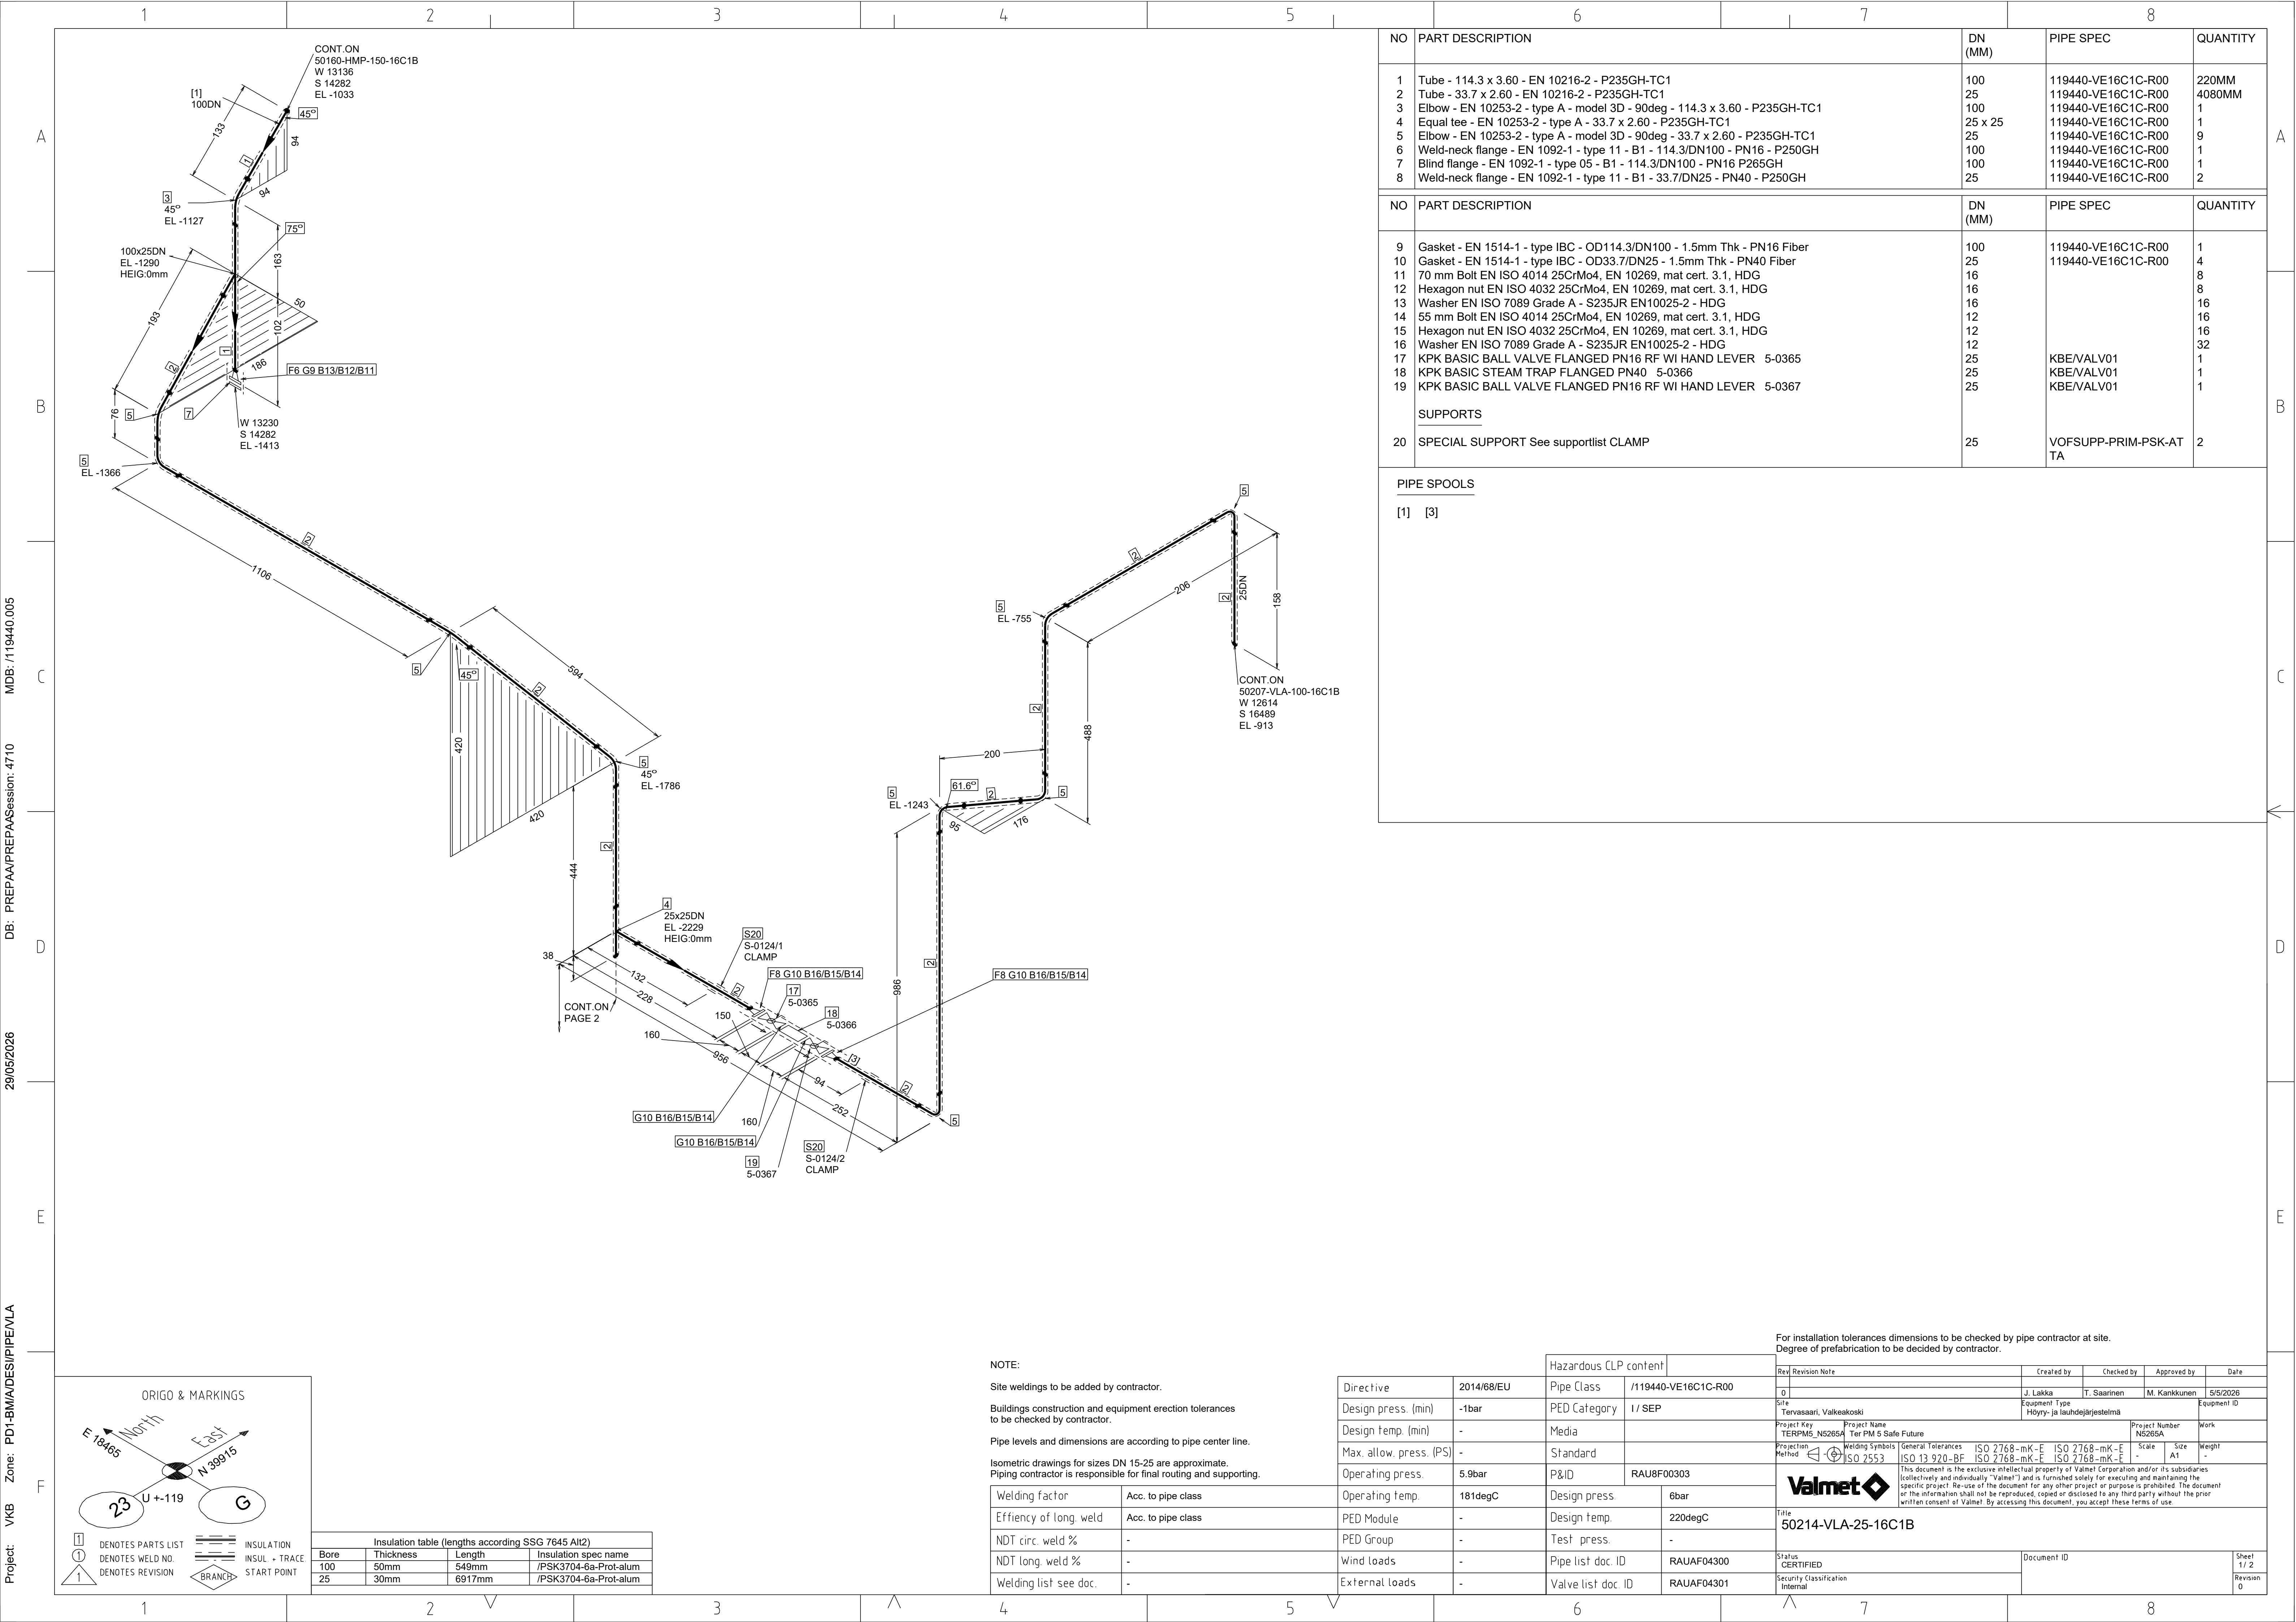


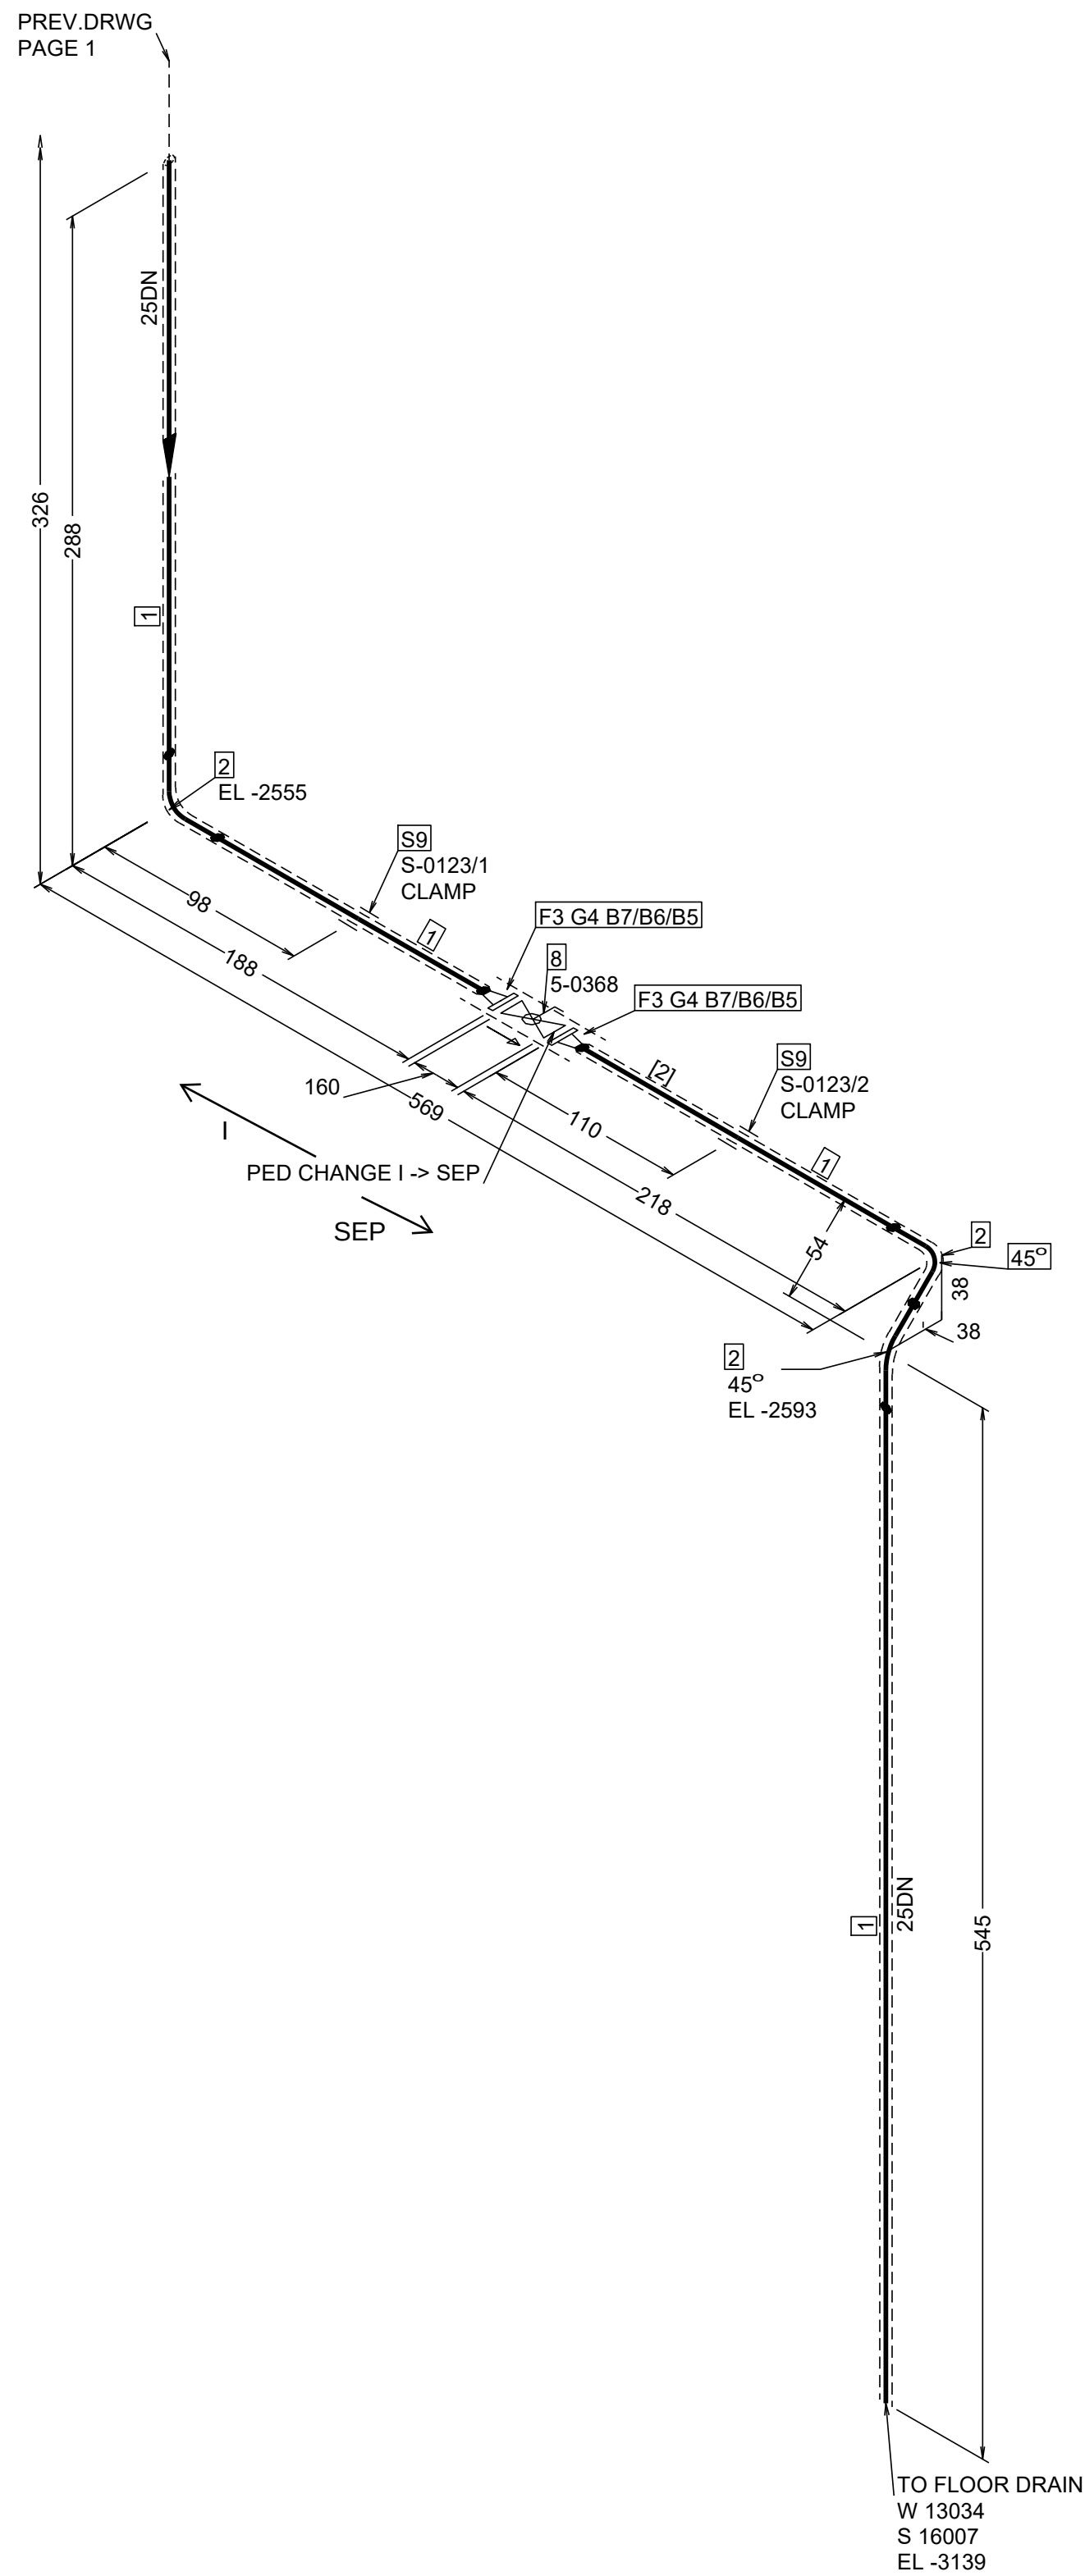

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 33.7 x 2.60 - EN 10216-2 - P235GH-TC1	25	119440-VE16C1C-R00	1030MM
2	Elbow - EN 10253-2 - type A - model 3D - 90deg - 33.7 x 2.60 - P235GH-TC1	25	119440-VE16C1C-R00	3
3	Weld-neck flange - EN 1092-1 - type 11 - B1 - 33.7/DN25 - PN40 - P250GH	25	119440-VE16C1C-R00	2
NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
4	Gasket - EN 1514-1 - type IBC - OD33.7/DN25 - 1.5mm Thk - PN40 Fiber	25	119440-VE16C1C-R00	2
5	55 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		8
6	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		8
7	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	12		16
8	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0368	25	KBE/VALV01	1
	<u>SUPPORTS</u>			
9	SPECIAL SUPPORT See supportlist CLAMP	25	VOFSUPP-PRIM-PSK-AT TA	2

PIPE SPOOLS

[2]

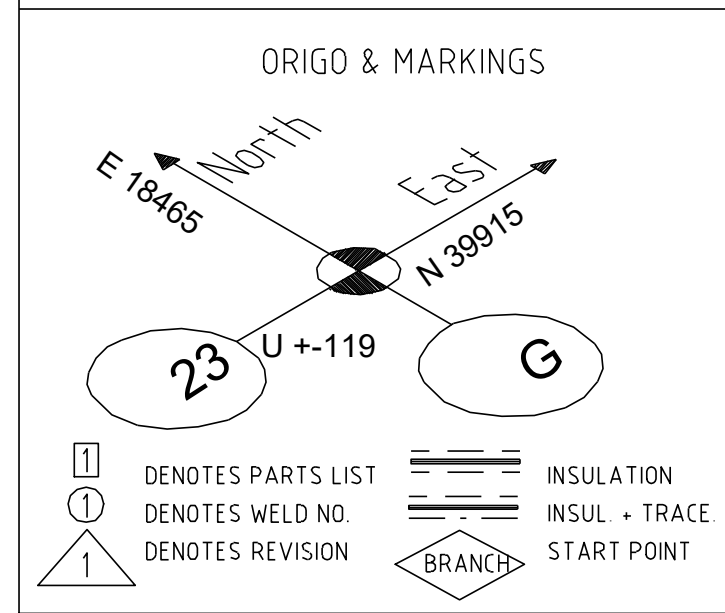

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
100	50mm	549mm	/PSK3704-6a-Prot-alum
25	30mm	6917mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Efficiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content		Legal responsibility to be accepted by customer					
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00	Rev/ Revision Note		Created by	Checked by	Approved by	Date
Design press. (min)	-1bar	PED Category	1/ SEP	0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026
Design temp. (min)	-	Media		Site Tervasaari, Valkeakoski		Equipment Type Höyry- ja lauhdejärjestelmä		Equipment ID	
Max. allow. press. (PS)	-	Standard		Project Key TERPM5_N5265A		Project Name Ter PM 5 Safe Future		Project Number N5265A	Work
Operating press.	5.9bar	P&ID	RAUF00303	Projection Method  ISO 2553		General Tolerances ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E		Scale -	Size A1
Operating temp.	181degC	Design press.	6bar	 This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.					
PED Module	-	Design temp.	220degC	Title 50214-VLA-25-16C1B					
PED Group	-	Test press.	-						
Wind loads	-	Pipe list doc. ID	RAUAF04300	Status CERTIFIED		Document ID			Sheet 2/ 2
External loads	-	Valve list doc. ID	RAUAF04301	Security Classification Internal					Revision 0