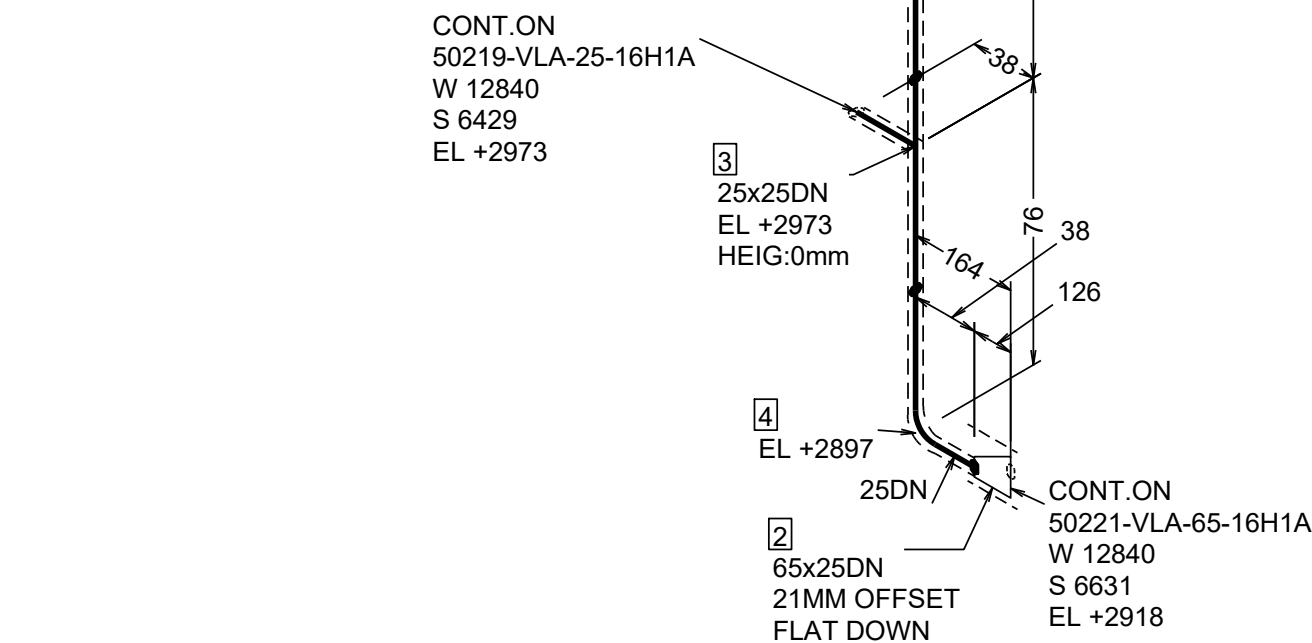



Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
65	30mm	166mm	/PSK3704-6a-Prot-alum
25	30mm	904mm	/PSK3704-6a-Prot-alum

Pipe levels and dimensions are according to pipe center line.
Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Efficiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content		Legal prohibition is to be decided by competent.	
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00	Rev/ Revision Note	Created by
Design press. (min)	-1bar	PED Category	SEP	0	T. Saarinen
Design temp. (min)	-	Media		Site Tervasaari, Valkeakoski	M. Kankkunen
Max. allow. press. (PS)	-	Standard		Project Key TERPM5_N5265A	Equipment Type Höyry- ja lauhdejärjestelmä
Operating press.	3.5bar	P&ID	RAUF003003	Project Name Ter PM 5 Safe Future	Equipment ID
Operating temp	156degC	Design press.	6bar	General Tolerances ISO 2768 -mK-E ISO 13 920 -BF ISO 2768 -mK-E ISO 2768 -mK-E	Project Number N5265A
PED Module	-	Design temp.	220degC	Welding Symbols ISO 2553	Work
PED Group	-	Test press.	-		Scale -
Wind loads	-	Pipe list doc. ID	RAUAF04300	 This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.	
External loads	-	Valve list doc. ID	RAUAF04301	Title 50218-VLA-25-16H1A	Size A1
				Status CERTIFIED	Weight -
				Document ID	Sheet 1 / 1
				Security Classification Internal	Revision 0