


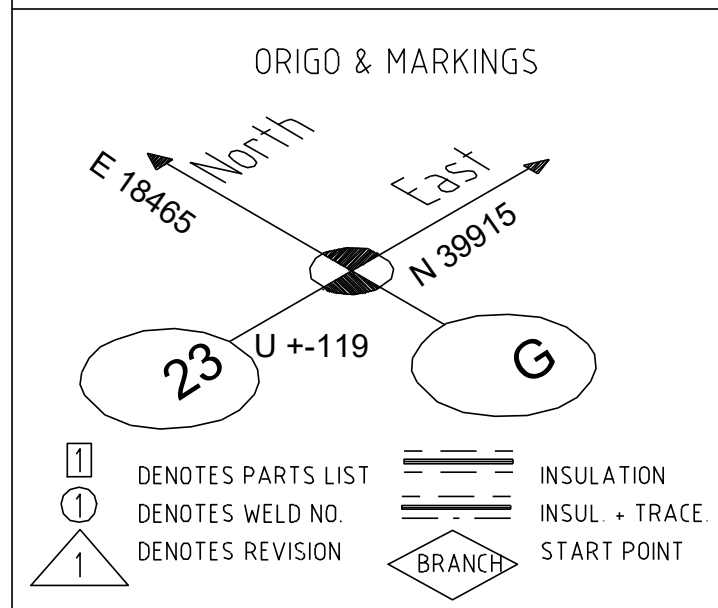

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
80	20mm	878mm	/PSK3704-6a-Prot-alum
15	20mm	177mm	/PSK3704-6a-Prot-alum

Welding list see doc	-
----------------------	---

		Hazardous CLP content		Legal representation to be decided by customer						
Directive	2014/68/EU	Pipe Class	/I19440-VE16C1C-R00	Rev/ Revision Note		Created by		Checked by	Approved by	Date
Design press. (min)	-1bar	PED Category	SEP	0		J. Lakka	T. Saarinen	M. Kankkunen		5/5/2026
Design temp. (min)	-	Media		Site Tervasaari, Valkeasoski		Equipment Type Höyry- ja lauhdejärjestelmä			Equipment ID	
Max. allow. press. (PS)	-	Standard		Project Key TERFMS_N5265A		Project Name Ter PM 5 Safe Future			Project Number N5265A	
Operating press.	0.3bar	P&ID	RAUF00303	Projection Method ISO 5553		Welding Symbols ISO 5553		General Tolerances ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E		Scale A1
Operating temp.	107degC	Design press	6bar	 This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.						
PED Module	-	Design temp.	220degC	Title 50222-HMP-80-16C1B						
PED Group	-	Test press.	-							
Wind loads	-	Pipe list doc. ID	RAUAF04300	Status CERTIFIED		Document ID			Sheet 1 / 1	
External loads	-	Valve list doc. ID	RAUAF04301	Security Classification Internal					Revision 0	

Connection to existing pipe to be checked on site
For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.