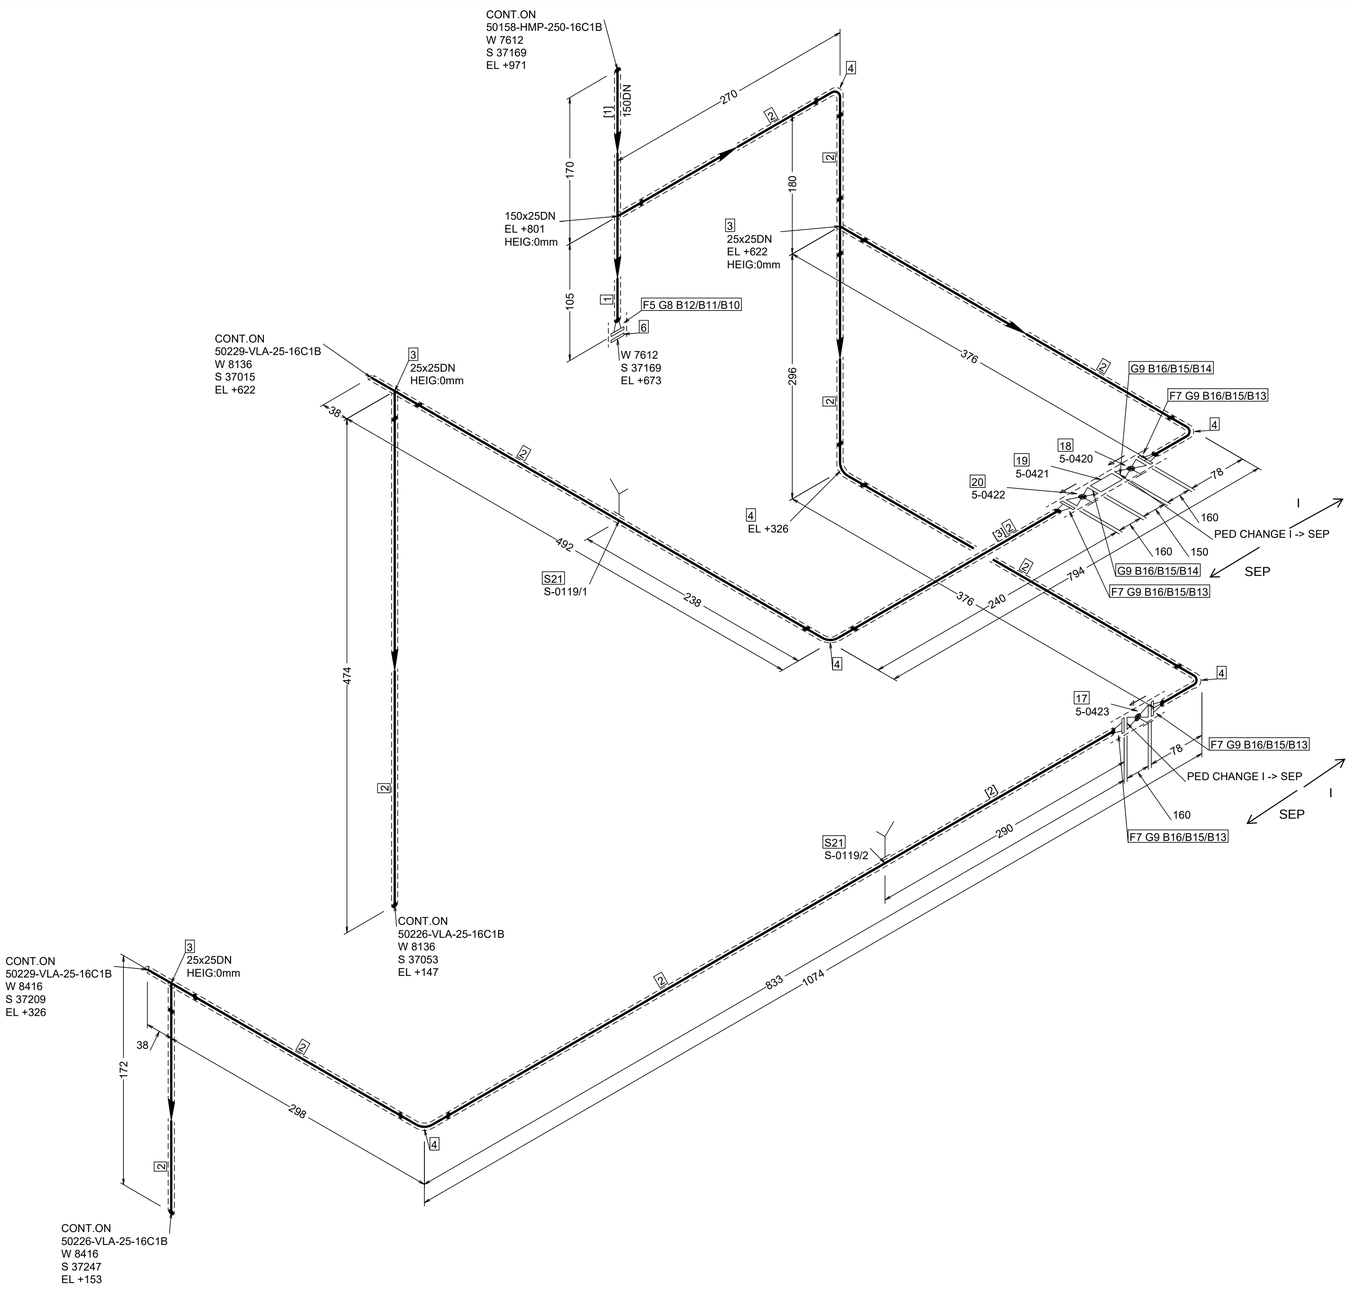

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 168.3 x 4.50 - EN 10216-2 - P235GH-TC1	150	119440-VE16C1C-R00	220MM
2	Tube - 33.7 x 2.60 - EN 10216-2 - P235GH-TC1	25	119440-VE16C1C-R00	3199MM
3	Equal tee - EN 10253-2 - type A - 33.7 x 2.60 - P235GH-TC1	25 x 25	119440-VE16C1C-R00	3
4	Elbow - EN 10253-2 - type A - model 3D - 90deg - 33.7 x 2.60 - P235GH-TC1	25	119440-VE16C1C-R00	6
5	Weld-neck flange - EN 1092-1 - type 11 - B1 - 168.3/DN150 - PN16 - P250GH	150	119440-VE16C1C-R00	1
6	Blind flange - EN 1092-1 - type 05 - B1 - 168.3/DN150 - PN16 P265GH	150	119440-VE16C1C-R00	1
7	Weld-neck flange - EN 1092-1 - type 11 - B1 - 33.7/DN25 - PN40 - P250GH	25	119440-VE16C1C-R00	4

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
8	Gasket - EN 1514-1 - type IBC - OD168.3/DN150 - 1.5mm Thk - PN16 Fiber	150	119440-VE16C1C-R00	1
9	Gasket - EN 1514-1 - type IBC - OD33.7/DN25 - 1.5mm Thk - PN40 Fiber	25	119440-VE16C1C-R00	6
10	80 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
11	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
12	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	20		16
13	60 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		16
14	55 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		8
15	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		24
16	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	12		48
17	BASIC GLOBE VALVE FLANGED PN40 WI HAND WHEEL 5-0423	25	KBE/VALV01	1
18	BASIC GLOBE VALVE FLANGED PN40 WI HAND WHEEL 5-0420	25	KBE/VALV01	1
19	KPK BASIC FILTER FLANGED PN40 5-0421	25	KBE/VALV01	1
20	BASIC GLOBE VALVE FLANGED PN40 WI HAND WHEEL 5-0422	25	KBE/VALV01	1
	SUPPORTS			
21	SLIDE SUPPORT PSK 7303 TYPE 1, HIGH See supportlist	25	VOFSUPP-PRIM-PSK-ATTA	2

PIPE SPOOLS

[1] [2] [3]

ORIGO & MARKINGS

North E 18465 East N 39915 23 U +-119 G

[1] DENOTES PARTS LIST
(1) DENOTES WELD NO.
1 DENOTES REVISION
INSULATION
INSUL. + TRACE
BRANCH START POINT

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
150	120mm	493mm	/PSK3704-4a-good
25	80mm	4874mm	/PSK3704-4a-good

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Effiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content	
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00
Design press. (min)	-1bar	PED Category	I / SEP
Design temp. (min)	-	Media	
Max. allow. press. (PS)	-	Standard	
Operating press.	5.9bar	P&ID	RAU8F00303
Operating temp.	181degC	Design press.	6bar
PED Module	-	Design temp.	220degC
PED Group	-	Test press.	-
Wind loads	-	Pipe list doc. ID	RAUAF04300
External loads	-	Valve list doc. ID	RAUAF04301

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50232-VLA-25-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1 / 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/A/DESI/PIPE/VLA MDB: /119440.005 DB: PREPAA/PREPAA Session: 4710 29/05/2026