NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 273 x 6.30 - EN 10216-2 - P235GH-TC1	250	119440-VE16C1C-R00	582MM
2	Elbow - EN 10253-2 - type A - model 3D - 90deg - 273 x 6.30 - P235GH-TC1	250	119440-VE16C1C-R00	3
3	Weld-neck flange - EN 1092-1 - type 11 - B1 - 273/DN250 - PN16 - P250GH	250	119440-VE16C1C-R00	3

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
4	Gasket - EN 1514-1 - type IBC - OD273/DN250 - 1.5mm Thk - PN16 Fiber	250	119440-VE16C1C-R00	3
5	220 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		12
6	100 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		12
7	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		24
8	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	24		48
9	KPK BASIC CHECK VALVE WAFER PN16 5-0309	250	KBE/VALV01	1

PIPE SPOOLS

[1]

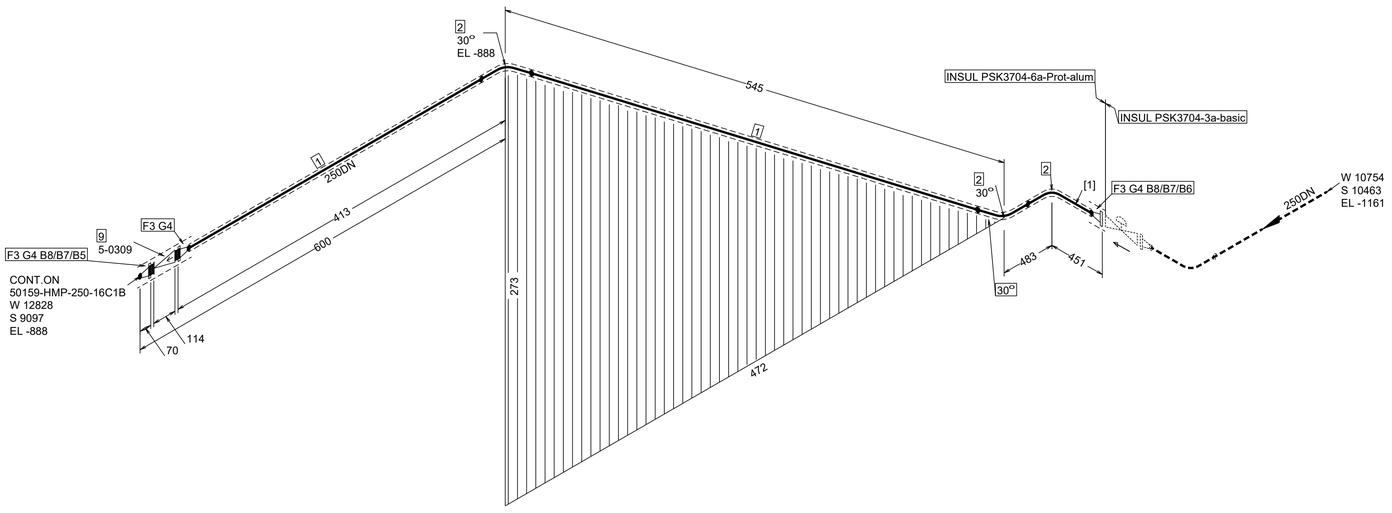

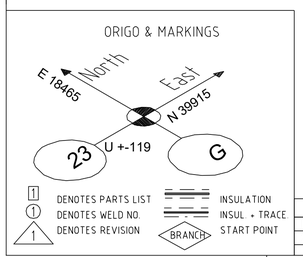

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
250	60mm	2297mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class	Operating temp.	156degC	Design press.	6bar
Effiency of long. weld	Acc. to pipe class	PED Module	-	Design temp.	220degC
NDT circ. weld %	-	PED Group	-	Test press.	-
NDT long. weld %	-	Wind loads	-	Pipe list doc. ID	RAUAF04300
Welding list see doc.	-	External loads	-	Valve list doc. ID	RAUAF04301

Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00
Design press. (min)	-1bar	PED Category	I
Design temp. (min)	-	Media	
Max. allow. press. (PS)	-	Standard	
Operating press.	3.5bar	P&ID	RAU8F00303

Hazardous CLP content

Connection to existing pipe to be checked on site

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50155-HMP-250-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1 / 1
Security Classification: Internal
Revision: 0