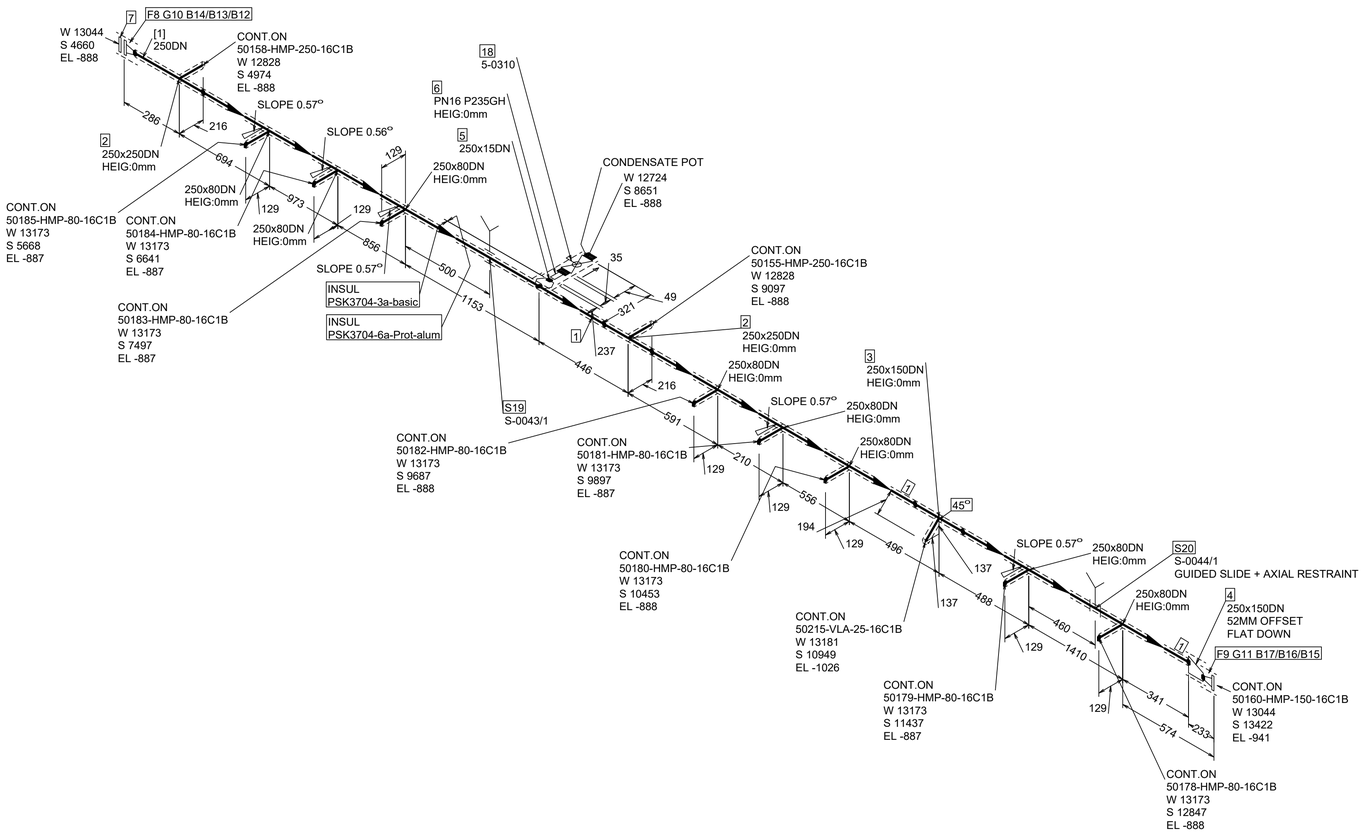

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 273 x 6.30 - EN 10216-2 - P235GH-TC1	250	119440-VE16C1C-R00	7134MM
2	Equal tee - EN 10253-2 - type A - 273 x 7.10 - P235GH-TC1	250 x 250	119440-VE16C1C-R00	2
3	Reduced tee - EN 10253-2 - type A - 273 x 6.30 / 168.3 x 5.60 - P235GH-TC1	250 x 150	119440-VE16C1C-R00	1
4	Eccentric reducer - EN 10253-2 - type A - 273 x 6.30 / 168.3 x 4.50 - P235GH-TC1	250 x 150	119440-VE16C1C-R00	1
5	Set on Tee with Bran made of EN 10216-2 TUBE 21.3 x 5.00 H=100 - P235GH-TC1	250 x 15	119440-VE16C1C-R00	1
6	STRAIGHT NIPPLE OTOE/PLAIN OTHER END NPT THRD. R-208 SHORT 316 PN16 P235GH	15	KBE/BBB001	1
7	Blind flange - EN 1092-1 - type 05 - B1 - 273/DN250 - PN16 P265GH	250	119440-VE16C1C-R00	1
8	Weld-neck flange - EN 1092-1 - type 11 - B1 - 273/DN250 - PN16 - P250GH	250	119440-VE16C1C-R00	1
9	Weld-neck flange - EN 1092-1 - type 11 - B1 - 168.3/DN150 - PN16 - P250GH	150	119440-VE16C1C-R00	1

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
10	Gasket - EN 1514-1 - type IBC - OD273/DN250 - 1.5mm Thk - PN16 Fiber	250	119440-VE16C1C-R00	1
11	Gasket - EN 1514-1 - type IBC - OD168.3/DN150 - 1.5mm Thk - PN16 Fiber	150	119440-VE16C1C-R00	1
12	100 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		12
13	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	24		12
14	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	24		24
15	238 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
16	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	20		8
17	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	20		16
18	KPK BASIC BALL VALVE TF/TF WI HAND LEVER 5-0310	15	KBE/VALV01	1
	SUPPORTS			
19	GUIDED SLIDE PSK 7303 TYPE 2, LOW See supportlist	250	VOFSUPP-PRIM-PSK-ATTA	1
20	1-SIDED AXIAL RESTRAINT PSK 7303 TYPE 7, LOW See supportlist GUIDED SLIDE + AXIAL RESTRAINT	250	VOFSUPP-PRIM-PSK-ATTA	1

PIPE SPOOLS

[1]

ORIGO & MARKINGS

E 18465 North East N 39915

23 U +-119 G

[1] DENOTES PARTS LIST
(1) DENOTES WELD NO.
1 DENOTES REVISION
INSULATION
INSUL. + TRACE
BRANCH START POINT

Insulation table (lengths according SSG 7645 Alt2)

Bore	Thickness	Length	Insulation spec name
250	100mm	8713mm	/PSK3704-3a-basic
150	100mm	57mm	/PSK3704-3a-basic
15	30mm	321mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class	Directive	2014/68/EU	Hazardous CLP content	
Effiency of long. weld	Acc. to pipe class	Design press. (min)	-1bar	Pipe Class	/119440-VE16C1C-R00
NDT circ. weld %	-	Design temp. (min)	-	PED Category	I
NDT long. weld %	-	Max. allow. press. (PS)	-	Media	
Welding list see doc.	-	Operating press.	5.9bar	Standard	
		Operating temp.	181degC	P&ID	RAU8F00303
		PED Module	-	Design press.	6bar
		PED Group	-	Design temp.	220degC
		Wind loads	-	Test press.	-
		External loads	-	Pipe list doc. ID	RAUAF04300
				Valve list doc. ID	RAUAF04301

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50159-HMP-250-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1/ 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/A/DESI/PIPE/HMP MDB: /119440.005 DB: PREPAA/PREPAASession: 4397 18/05/2026