


| NO | PART DESCRIPTION | DN (MM) | PIPE SPEC | QUANTITY |
|---|---|---|---|---|
| 1 | Tube - 273 x 6.30 - EN 10216-2 - P235GH-TC1 | 250 | 119440-VE16C1C-R00 | 8302MM |
| 2 | Tube - 114.3 x 6.30 - EN 10216-2 - P235GH-TC1 | 100 | 119440-E63C1B-R00 | 200MM |
| 3 | Tube - 21.3 x 2.00 - EN 10216-2 - P235GH-TC1 | 15 | 119440-VE16C1C-R00 | 900MM |
| 4 | Eccentric reducer - EN 10253-2 - type A - 273 x 6.30 / 168.3 x 4.50 - P235GH-TC1 | 250 x 150 | 119440-VE16C1C-R00 | 1 |
| 5 | Reduced tee - EN 10253-2 - type A - 273 x 6.30 / 168.3 x 5.60 - P235GH-TC1 | 250 x 150 | 119440-VE16C1C-R00 | 1 |
| 6 | Set on Tee with Bran made of EN 10216-2 TUBE 21.3 x 5.00 H=100 - P235GH-TC1 | 250 x 15 | 119440-VE16C1C-R00 | 1 |
| 7 | Elbow - EN 10253-2 - type A - model 3D - 90deg - 273 x 6.30 - P235GH-TC1 | 250 | 119440-VE16C1C-R00 | 6 |
| 8 | Elbow - EN 10253-2 - type A - model 3D - 90deg - 21.3 x 2.00 - P235GH-TC1 | 15 | 119440-VE16C1C-R00 | 6 |
| 9 | Weld-neck flange - EN 1092-1 - type 11 - B1 - 168.3/DN150 - PN16 - P250GH | 150 | 119440-VE16C1C-R00 | 1 |
| 10 | Weld-neck flange - EN 1092-1 - type 11 - B1 - 114.3/DN100 - PN16 - P250GH | 100 | 119440-VE16C1C-R00 | 1 |

| NO | PART DESCRIPTION | DN (MM) | PIPE SPEC | QUANTITY |
|---|---|---|---|---|
| 11 | Gasket - EN 1514-1 - type IBC - OD168.3/DN150 - 1.5mm Thk - PN16 Fiber | 150 | 119440-VE16C1C-R00 | 1 |
| 12 | Gasket - EN 1514-1 - type IBC - OD114.3/DN100 - 1.5mm Thk - PN16 Fiber | 100 | 119440-VE16C1C-R00 | 1 |
| 13 | 80 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG | 20 | | 8 |
| 14 | Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG | 20 | | 8 |
| 15 | Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG | 20 | | 16 |
| 16 | 70 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG | 16 | | 8 |
| 17 | Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG | 16 | | 8 |
| 18 | Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG | 16 | | 16 |
| 19 | KPK BASIC SAFETY VALVE FLANGED PN 16/16 5-0311 | 150 x 100 | KBE/VALV01 | 1 |
| | SUPPORTS | | | |
| 20 | 1-SIDED AXIAL RESTRAINT PSK 7303 TYPE 7, LOW See supportlist Special axial restraint, connected to main | 250 | VOFSUPP-PRIM-PSK-ATTA | 1 |
| 21 | SLIDE SUPPORT PSK 7303 TYPE 1, HIGH See supportlist | 250 | VOFSUPP-PRIM-PSK-ATTA | 1 |
| 22 | 1-SIDED ANCHOR PSK 7303 TYPE 9, LOW See supportlist | 250 | VOFSUPP-PRIM-PSK-ATTA | 1 |
| 23 | SPECIAL SUPPORT See supportlist CLAMP | 15 | VOFSUPP-PRIM-PSK-ATTA | 1 |

PIPE SPOOLS

[1] [2]

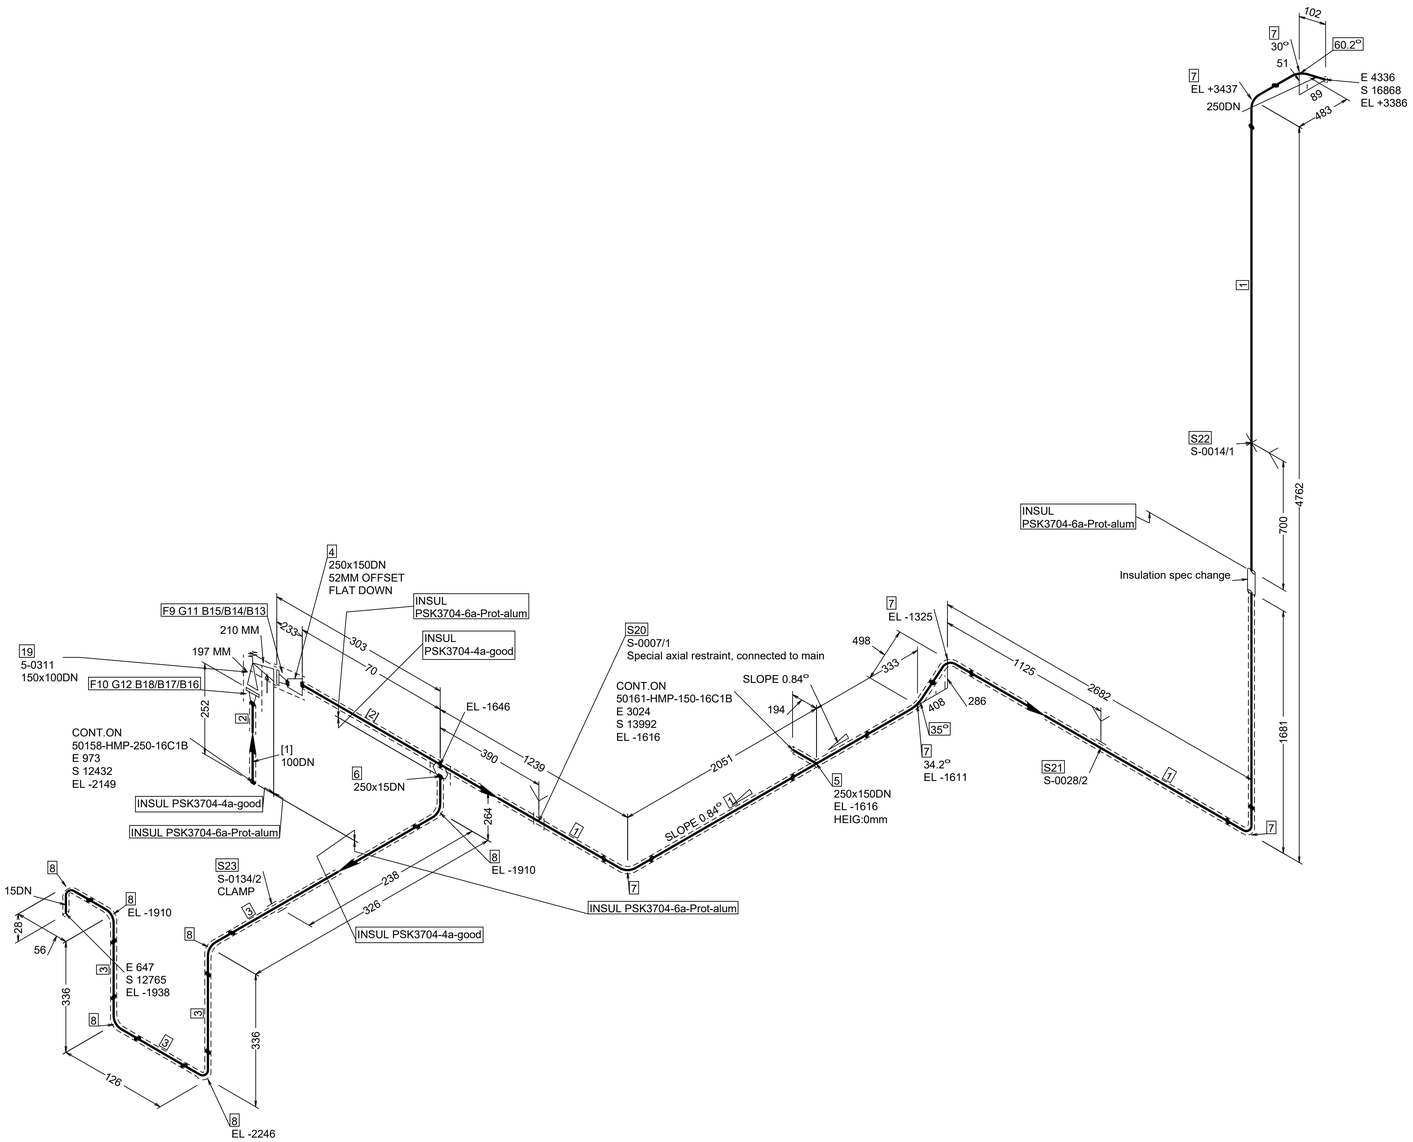


| Insulation table (lengths according SSG 7645 Alt2) | | | |
|---|---|---|---|
| Bore | Thickness | Length | Insulation spec name |
| 15 | 50mm | 1473mm | /PSK3704-4a-good |
| 200 | 100mm | 124mm | /PSK3704-4a-good |
| 100 | 100mm | 254mm | /PSK3704-4a-good |
| 150 | 100mm | 288mm | /PSK3704-4a-good |
| 150 | 60mm | 57mm | /PSK3704-6a-Prot-alum |
| 250 | 60mm | 8740mm | /PSK3704-6a-Prot-alum |

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

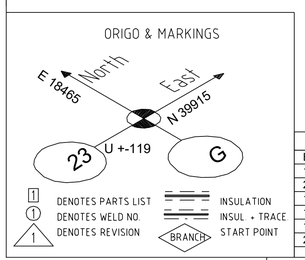Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

| | | | | | |
|---|---|---|---|---|---|
| | | | Hazardous CLP content | | |
| Directive | 2014/68/EU | Pipe Class | /119440-VE16C1C-R00 | | |
| Design press. (min) | -1bar | PED Category | I | | |
| Design temp. (min) | - | Media | | | |
| Max. allow. press. (PS) | - | Standard | | | |
| Operating press. | 6bar | P&ID | RAU8F00303 | | |
| Welding factor | Acc. to pipe class | Operating temp. | 181degC | Design press. | 6bar |
| Effiency of long. weld | Acc. to pipe class | PED Module | - | Design temp. | 220degC |
| NDT circ. weld % | - | PED Group | - | Test press. | - |
| NDT long. weld % | - | Wind loads | - | Pipe list doc. ID | RAUAF04300 |
| Welding list see doc. | - | External loads | - | Valve list doc. ID | RAUAF04301 |

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

| Rev | Revision Note | Created by | Checked by | Approved by | Date |
|---|---|---|---|---|---|
| 0 | | J. Lakka | T. Saarinen | M. Kankkunen | 5/5/2026 |

Site: Tervasaari, Valkeakoski
Equipment Type: HOyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 2768-mK-E ISO 2768-mK-E / ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50163-HMP-250-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1 / 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/ADESI/PIPE/HMP MDB: /119440.005 Session: 4405 18/05/2026 DB: PREPAA/PREPAA