



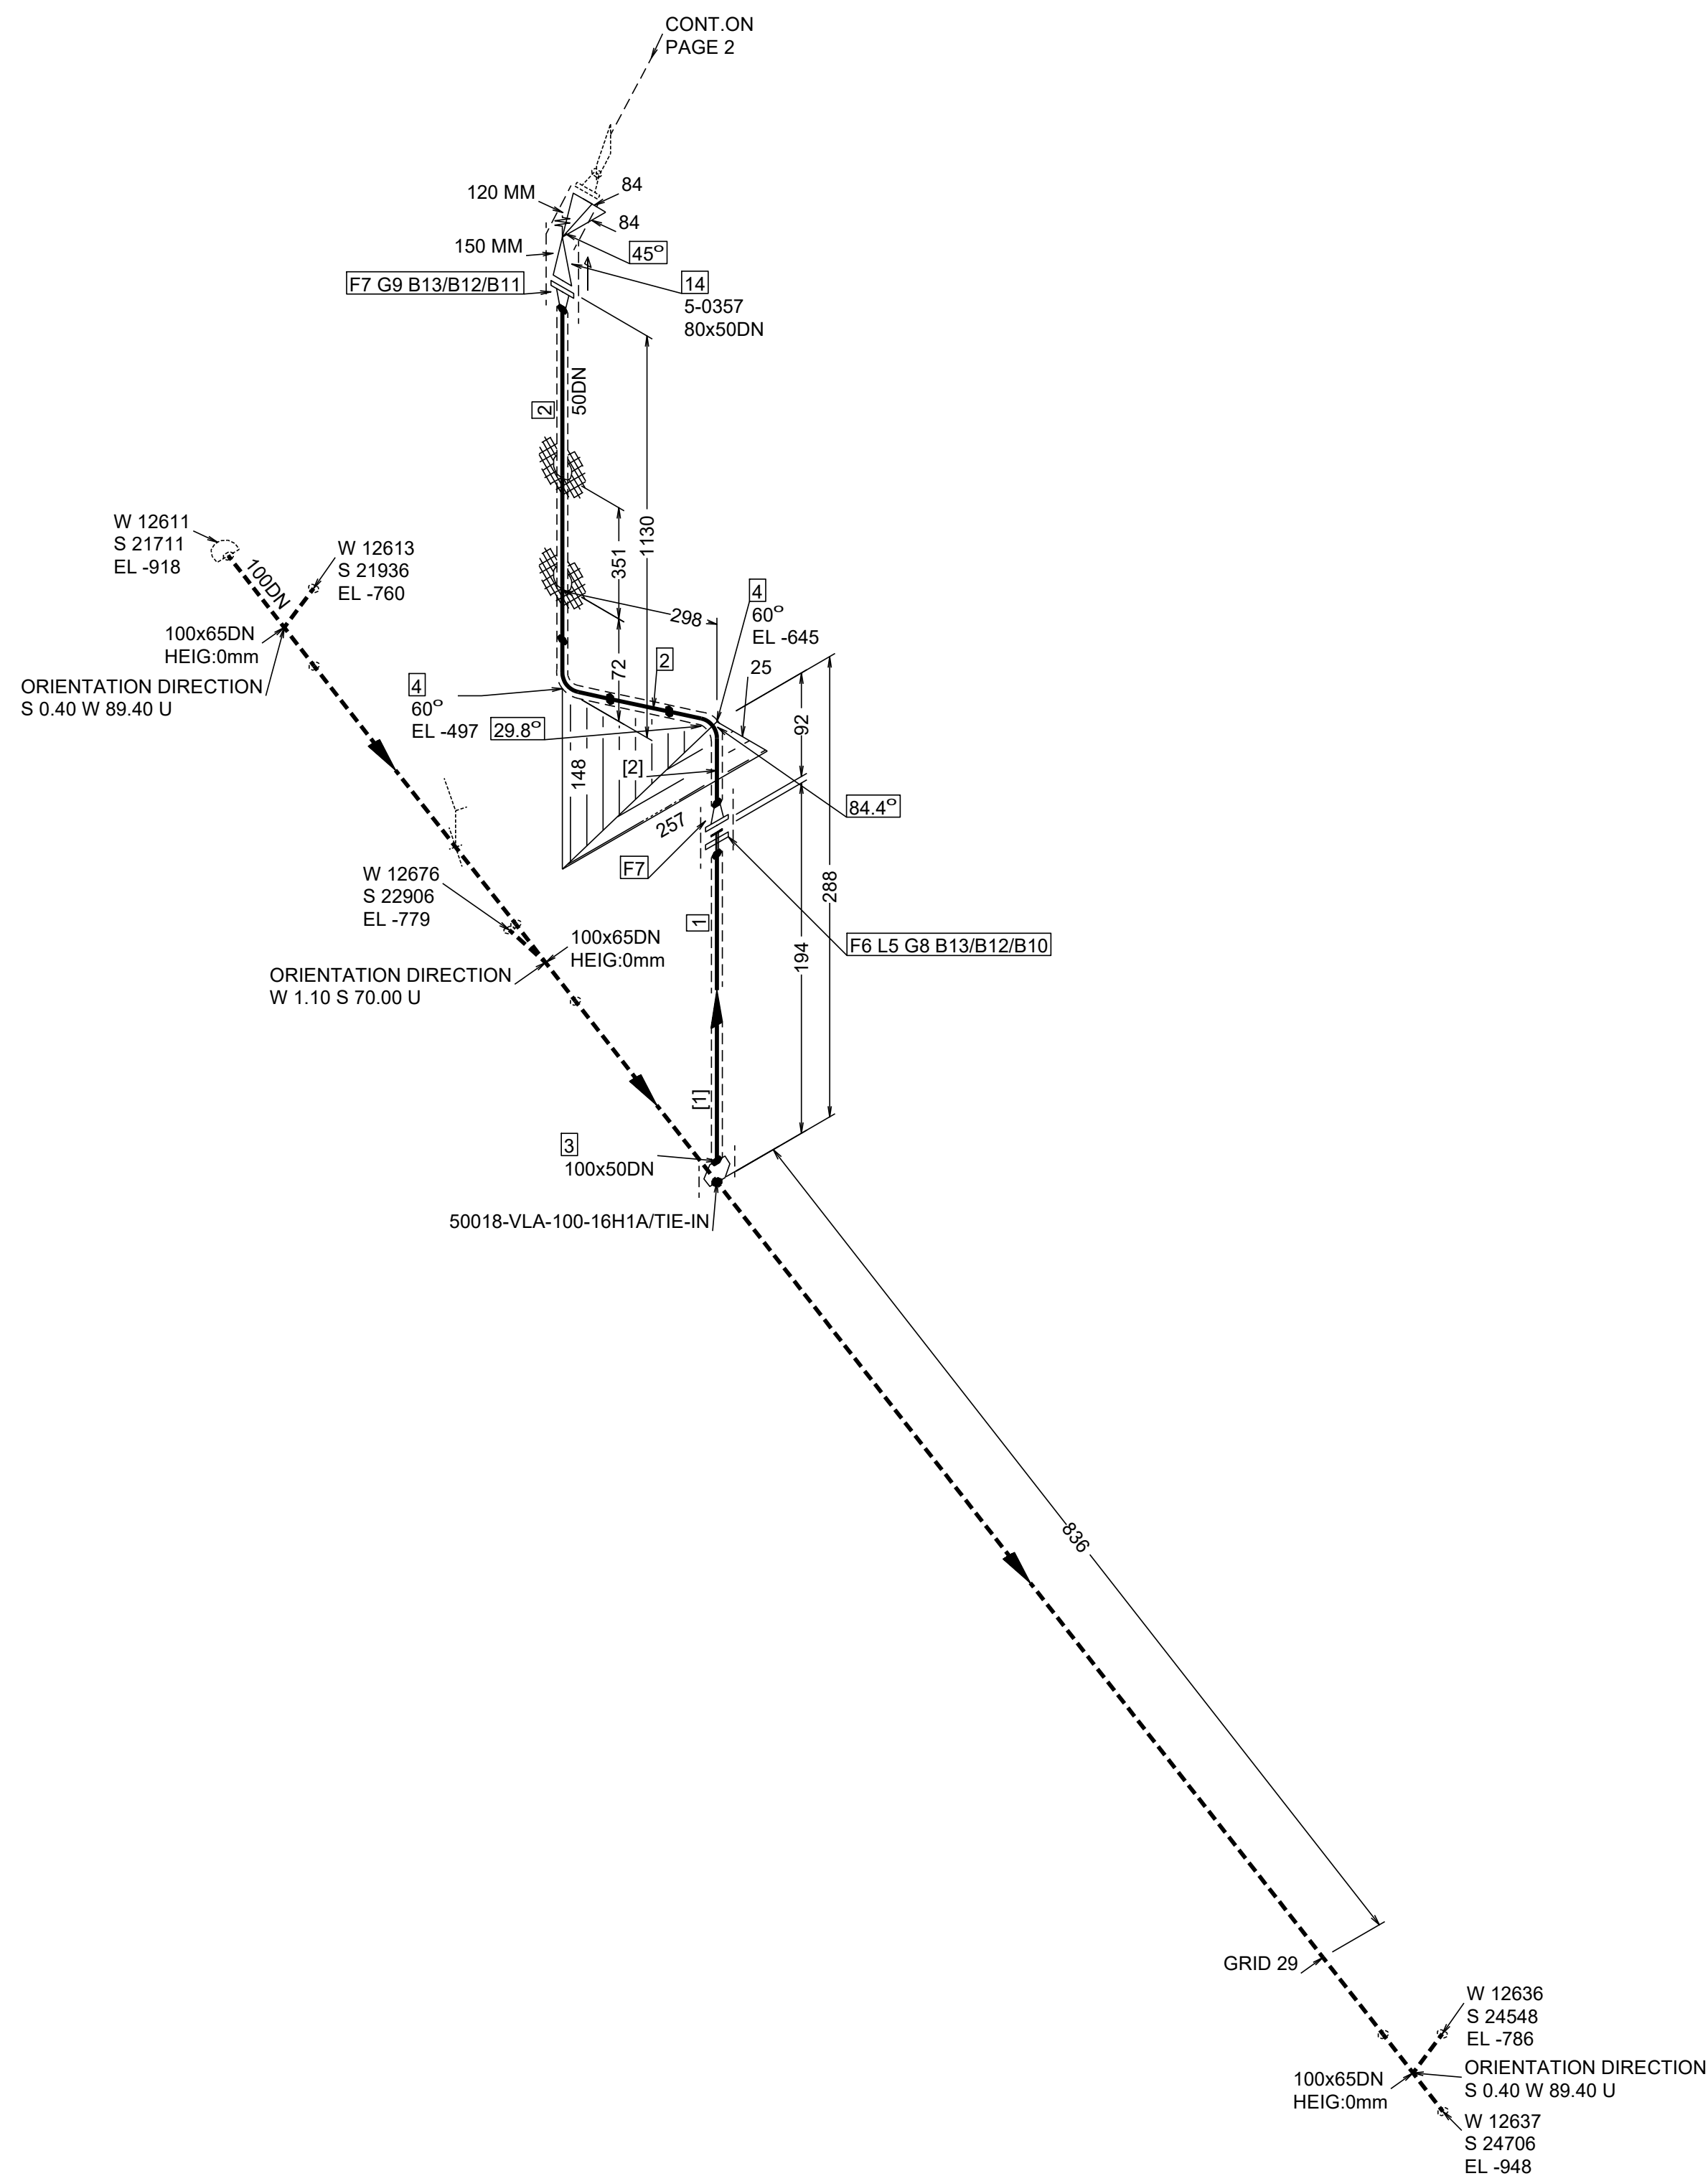

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 60.3 x 2.00 - EN 10217-7 - 1.4307-TC1	50	119440-VE16H1A-R00	100MM
2	Tube - 60.3 x 2.90 - EN 10216-2 - P235GH-TC1	50	119440-VE16C1C-R00	1248MM
3	Set on Tee with Plate made of run pipe - 114.3 x 2.00 D1 = 60.3 W=40 - 1.4307-TC1 50018-VLA-100-16H1A/TIE-IN	100 x 50	119440-VE16H1A-R00	
4	Elbow - EN 10253-2 - type A - model 3D - 90deg - 60.3 x 2.90 - P235GH-TC1	50	119440-VE16C1C-R00	2
5	Weldring neck - EN 1092-1 - type 35 - 60.3/DN50 - PN16 - 1.4307	50	119440-VE16H1A-R00	1
6	Loose flange - EN 1092-1 - type 02 - - 60.3/DN50 - PN40 - P265GH HDG	50	119440-VE16H1A-R00	1
7	Weld-neck flange - EN 1092-1 - type 11 - B1 - 60.3/DN50 - PN40 - P250GH	50	119440-VE16C1C-R00	2
NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
8	Gasket - EN 1514-1 - type IBC - OD60.3/DN50 - 1.5mm Thk - PN40 Fiber	50	119440-VE16H1A-R00	1
9	Gasket - EN 1514-1 - type IBC - OD60.3/DN50 - 1.5mm Thk - PN40 Fiber	50	119440-VE16C1C-R00	1
10	80 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		4
11	70 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		4
12	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		8
13	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	16		16
14	KPK BASIC SAFETY VALVE FLANGED PN 16/16 5-0357	80 x 50	KBE/VALV01	1

PIPE SPOOLS

[1] [2]

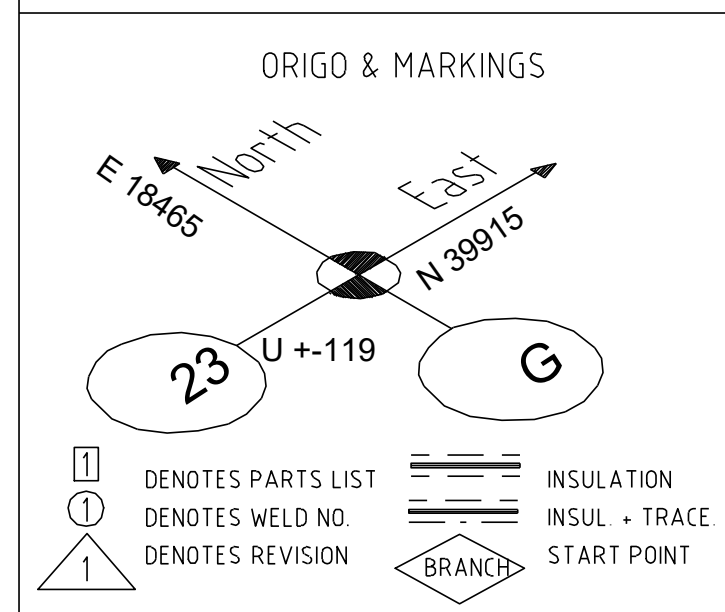

Bore	Thickness	Length	Insulation spec name
100	40mm	151mm	/PSK3704-6a-Prot-alum
50	40mm	1667mm	/PSK3704-6a-Prot-alum
80	40mm	244mm	/PSK3704-6a-Prot-alum
100	50mm	2575mm	/PSK3704-6a-Prot-alum
15	30mm	1100mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Efficiency of long weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content		Degree of prefabrication to be decided by contractor.									
				Rev/ Revision Note		Created by		Checked by		Approved by		Date	
Directive	2014/68/EU	Pipe Class	/19440-VE16C1C-R00	0		J. Lakka		T. Saarinen		M. Kankkunen		5/5/2026	
Design press. (min)	-1bar	PED Category	I	Site Tervasaari, Valkeakoski		Equipment Type Höyry- ja lauhdejärjestelmä						Equipment ID	
Design temp. (min)	-	Media		Project Key TERPMS_NS265A		Project Name Ter PM 5 Safe Future				Project Number NS265A		Work	
Max. allow. press. (PS)	-	Standard		Projection Method		Welding Symbols ISO 5553		General Tolerances ISO 13 920-BF		ISO 2768 -mK-E ISO 2768 -mK-E		ISO 2768 -mK-E	
Operating press.	5bar	P&ID	RAU8F00303			This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.							
Operating temp.	159degC	Design press	6bar										
PED Module	-	Design temp.	220degC	Title		50164-HMP-100-16C1B							
PED Group	-	Test press.	-										
Wind loads	-	Pipe list doc. ID	RAUAF04300	Status CERTIFIED		Document ID							
External loads	-	Valve list doc. ID	RAUAF04301	Security Classification Internal		Revision 0							



Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026
Site	Equipment Type				Equipment ID
Tervasaari, Valkeakoski		Hyöry- ja lauhdejärjestelmä			
Project Key	Project Name	Project Number			Work
TERPMS_N265A	Ter PM 5 Safe Future	N5265A			
Projection Method	Welding Symbols	General Tolerances	ISO 2768 -mK-E	ISO 2768 -mK-E	Scale
	ISO 2553	ISO 13 920 -BF	ISO 2768 -mK-E	ISO 2768 -mK-E	Size A1
This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use. 					
Title 50164-HMP-100-16C1B					
Status	Document ID			Sheet	
CERTIFIED				21 / 2	
Security Classification Internal				Revision 0	