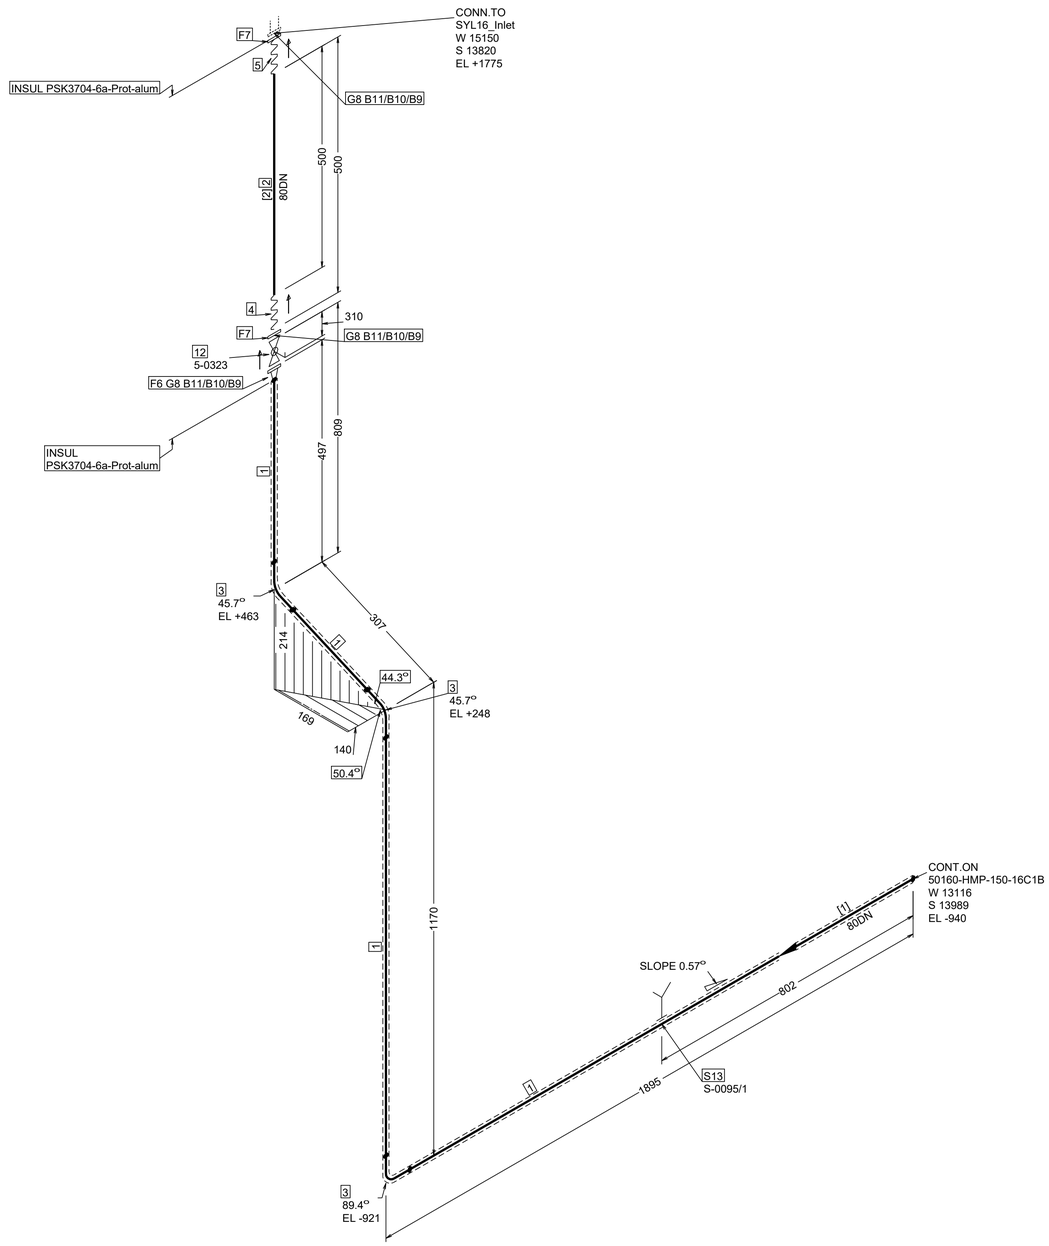


NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 88.9 x 3.20 - EN 10216-2 - P235GH-TC1	80	119440-VE16C1C-R00	3401MM
2	HOSE	80	HOSES	500MM
3	Elbow - EN 10253-2 - type A - model 3D - 90deg - 88.9 x 3.20 - P235GH-TC1	80	119440-VE16C1C-R00	3
4	HOSE PROVIDED BY KADANT	80	HOSES	1
5	HOSE	80	HOSES	1
6	Weld-neck flange - EN 1092-1 - type 11 - B1 - 88.9/DN80 - PN16 - P250GH	80	119440-VE16C1C-R00	1
7	Dummy wn flange - DIN 2633 80x88.9 PN16 Delivered with component	80	DUMMY-FLANGES	2

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
8	Gasket - EN 1514-1 - type IBC - OD88.9/DN80 - 1.5mm Thk - PN40 Fiber	80	119440-VE16C1C-R00	3
9	70 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		24
10	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		24
11	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	16		48
12	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0323	80	KBE/VALV01	1
	SUPPORTS			
13	SLIDE SUPPORT PSK 7303 TYPE 1, LOW See supportlist	80	VOFSUPP-PRIM-PSK-ATTA	1

PIPE SPOOLS

[1] [2]

ORIGO & MARKINGS

E 18465 North East N 39915

23 U +-119 G

[1] DENOTES PARTS LIST
(1) DENOTES WELD NO.
1 DENOTES REVISION
INSULATION
INSUL. + TRACE
BRANCH START POINT

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
80	40mm	3892mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class	Operating temp.	181degC	Design press.	6bar
Effiency of long. weld	Acc. to pipe class	PED Module	-	Design temp.	220degC
NDT circ. weld %	-	PED Group	-	Test press.	-
NDT long. weld %	-	Wind loads	-	Pipe list doc. ID	RAUAF04300
Welding list see doc.	-	External loads	-	Valve list doc. ID	RAUAF04301

			Hazardous CLP content		
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00		
Design press. (min)	-1bar	PED Category	SEP		
Design temp. (min)	-	Media			
Max. allow. press. (PS)	-	Standard			
Operating press.	5.9bar	P&ID	RAU8F00303		

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 2768-mK-E ISO 2768-mK-E / ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or it's subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50177-HMP-80-16C1B

Status: CERTIFIED
Document ID:
Sheet: 1 / 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/A/DESI/PIPE/HMP MDB: /119440.005 DB: PREPAA/PREPAASession: 4397 18/05/2026