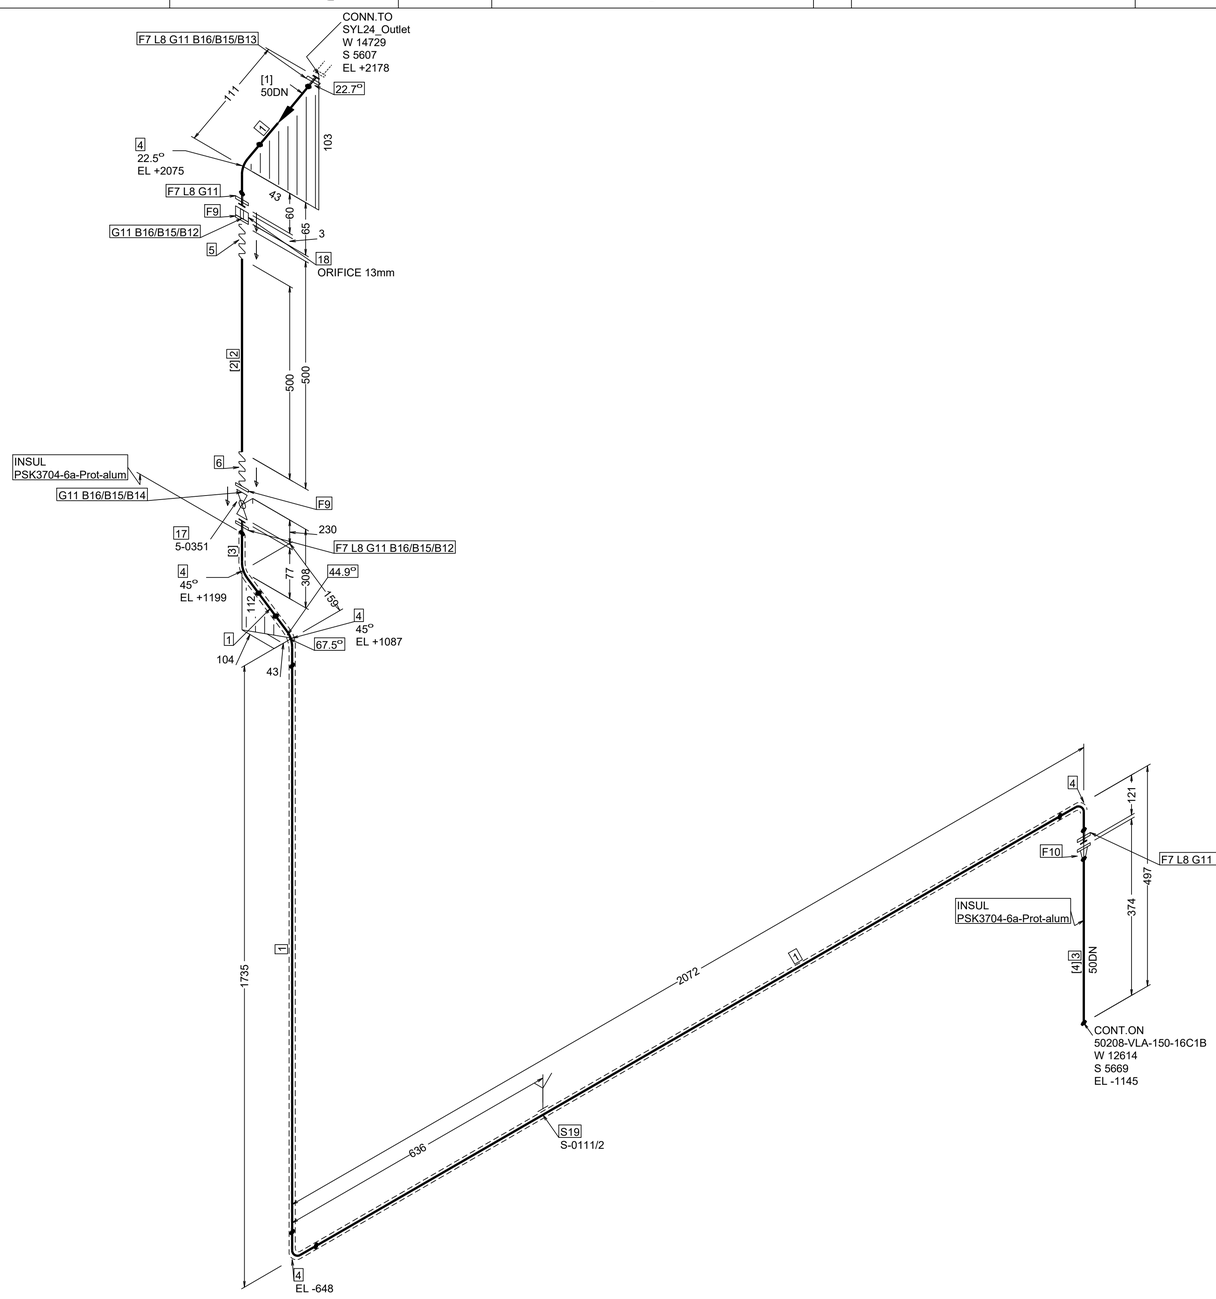

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 60.3 x 2.00 - EN 10217-7 - 1.4307-TC1	50	119440-VE16H1A-R00	3694MM
2	HOSE	50	HOSES	500MM
3	Tube - 60.3 x 2.90 - EN 10216-2 - P235GH-TC1	50	119440-VE16C1C-R00	326MM
4	Elbow - w - EN 10253-4 - type A - Table A.1 - model 3D - 90deg - 60.3 x 2.00 - 1.4307	50	119440-VE16H1A-R00	5
5	HOSE PROVIDED BY KADANT	50	HOSES	1
6	HOSE	50	HOSES	1
7	Loose flange - EN 1092-1 - type 02 - - 60.3/DN50 - PN40 - P265GH HDG	50	119440-VE16H1A-R00	4
8	Weldring neck - EN 1092-1 - type 35 - 60.3/DN50 - PN16 - 1.4307	50	119440-VE16H1A-R00	4
9	Dummy wn flange - DIN 2633 50x60.3 PN16 Delivered with component	50	DUMMY-FLANGES	2
10	Weld-neck flange - EN 1092-1 - type 11 - B1 - 60.3/DN50 - PN40 - P250GH	50	119440-VE16C1C-R00	1

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
11	Gasket - EN 1514-1 - type IBC - OD60.3/DN50 - 1.5mm Thk - PN40 Fiber	50	119440-VE16H1A-R00	6
12	80 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		12
13	75 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		4
14	65 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		4
15	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		20
16	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	16		40
17	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0351	50	KBE/VALV01	1
18	Orifice plate, bf ORIFICE 13mm PROVIDED BY KADANT	50	DATACOMP-TEST	1
	SUPPORTS			
19	SLIDE SUPPORT PSK 7303 TYPE 1, LOW See supportlist	50	VOFSUPP-PRIM-PSK-ATTA	1

PIPE SPOOLS

[1] [2] [3] [4]

ORIGO & MARKINGS

E 18465 North East N 39915

23 U +-119 G

[1] DENOTES PARTS LIST
(1) DENOTES WELD NO.
1 DENOTES REVISION
BRANCH
INSULATION
INSUL. + TRACE
START POINT

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
50	40mm	4119mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line.

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class	Operating temp.	164degC	Design press.	6bar
Effiency of long. weld	Acc. to pipe class	PED Module	-	Design temp.	220degC
NDT circ. weld %	-	PED Group	-	Test press.	-
NDT long. weld %	-	Wind loads	-	Pipe list doc. ID	RAUAF04300
Welding list see doc.	-	External loads	-	Valve list doc. ID	RAUAF04301

Directive	2014/68/EU	Hazardous CLP content			
Design press. (min)	-1bar	Pipe Class	/119440-VE16H1A-R00		
Design temp. (min)	-	PED Category	I		
Max. allow. press. (PS)	-	Media			
Operating press.	5.7bar	Standard			
		P&ID	RAU8F00303		

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

Rev	Revision Note	Created by	Checked by	Approved by	Date
0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026

Site: Tervasaari, Valkeakoski
Equipment Type: Höyry- ja lauhdejärjestelmä
Equipment ID:
Project Key: TERPM5_N5265A
Project Name: Ter PM 5 Safe Future
Project Number: N5265A
Work:
Projection Method:
Welding Symbols: ISO 2553
General Tolerances: ISO 2768-mK-E ISO 2768-mK-E / ISO 13 920-BF ISO 2768-mK-E ISO 2768-mK-E
Scale: -
Size: A1
Weight: -

This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.

Title: 50205-VLA-50-16H1A

Status: CERTIFIED
Document ID:
Sheet: 1 / 1
Security Classification: Internal
Revision: 0

Project: VKB Zone: PD1-BM/A/DESI/PIPE/VLA MDB: /119440.005
DB: PREPAA/PREPAA Session: 4397
18/05/2026