

A

B

C

D


E

F

NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
1	Tube - 76.1 x 2.90 - EN 10216-2 - P235GH-TC1	65	119440-VE16C1C-R00	170MM
2	Tube - 33.7 x 2.60 - EN 10216-2 - P235GH-TC1	25	119440-VE16C1C-R00	3399MM
3	Tube - 33.7 x 2.00 - EN 10217-7 - 1.4307-TC1	25	119440-VE16H1A-R00	70MM
4	Equal tee - EN 10253-2 - type A - 33.7 x 2.60 - P235GH-TC1	25 x 25	119440-VE16C1C-R00	2
5	Elbow - EN 10253-2 - type A - model 3D - 90deg - 33.7 x 2.60 - P235GH-TC1	25	119440-VE16C1C-R00	5
6	Weld-neck flange - EN 1092-1 - type 11 - B1 - 76.1/DN65 - PN16 - P250GH	65	119440-VE16C1C-R00	1
7	Blind flange - EN 1092-1 - type 05 - B1 - 76.1/DN65 - PN16 P265GH	65	119440-VE16C1C-R00	1
8	Weld-neck flange - EN 1092-1 - type 11 - B1 - 33.7/DN25 - PN40 - P250GH	25	119440-VE16C1C-R00	5
9	Weld-neck flange - EN 1092-1 - type 11 - B1 - 33.7/DN25 - PN40 - 1.4307	25	119440-VE16H1A-R00	1
NO	PART DESCRIPTION	DN (MM)	PIPE SPEC	QUANTITY
10	Gasket - EN 1514-1 - type IBC - OD76.1/DN65 - 1.5mm Thk - PN40 Fiber	65	119440-VE16C1C-R00	1
11	Gasket - EN 1514-1 - type IBC - OD33.7/DN25 - 1.5mm Thk - PN40 Fiber	25	119440-VE16C1C-R00	7
12	65 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		8
13	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	16		8
14	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	16		16
15	60 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		4
16	55 mm Bolt EN ISO 4014 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		24
17	Hexagon nut EN ISO 4032 25CrMo4, EN 10269, mat cert. 3.1, HDG	12		28
18	Washer EN ISO 7089 Grade A - S235JR EN10025-2 - HDG	12		56
19	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0382	25	KBE/VALV01	1
20	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0379	25	KBE/VALV01	1
21	KPK BASIC STEAM TRAP FLANGED PN40 5-0380	25	KBE/VALV01	1
22	KPK BASIC BALL VALVE FLANGED PN16 RF WI HAND LEVER 5-0381	25	KBE/VALV01	1
<u>SUPPORTS</u>				
23	SLIDE SUPPORT PSK 7303 TYPE 1, LOW See supportlist	25	VOFSUPP-PRIM-PSK-AT TA	2

PIPE SPOOLS

[1] [2] [3]

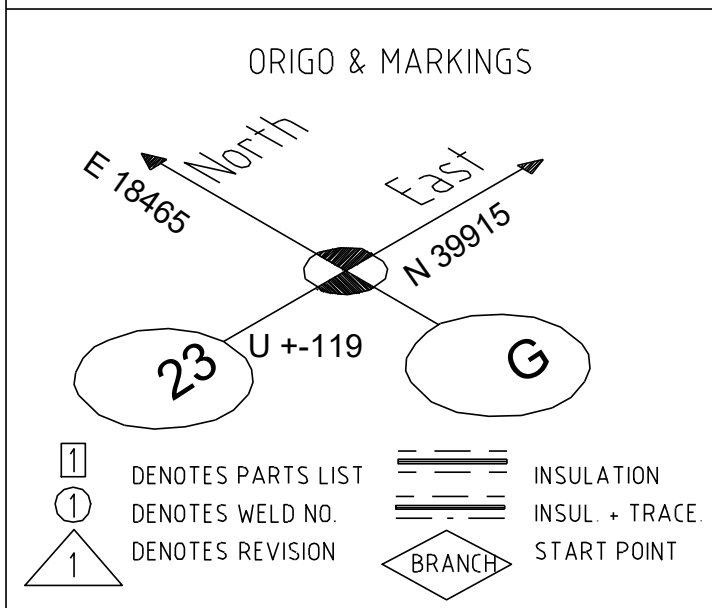

Insulation table (lengths according SSG 7645 Al/t2)			
Bore	Thickness	Length	Insulation spec name
25	30mm	4997mm	/PSK3704-6a-Prot-alum
65	40mm	311mm	/PSK3704-6a-Prot-alum

NOTE:

Site weldings to be added by contractor.

Buildings construction and equipment erection tolerances to be checked by contractor.

Pipe levels and dimensions are according to pipe center line

Isometric drawings for sizes DN 15-25 are approximate.
Piping contractor is responsible for final routing and supporting.

Welding factor	Acc. to pipe class
Efficiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

For installation tolerances dimensions to be checked by pipe contractor at site.
Degree of prefabrication to be decided by contractor.

		Hazardous CLP content		Legal representation to be decided by contractor					
Directive	2014/68/EU	Pipe Class	/I19440-VE16C1C-R00	Rev/ Revision Note		Created by	Checked by	Approved by	Date
Design press. (min)	-1bar	PED Category	SEP	0		J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026
Design temp. (min)	-	Media		Site Tervasaari, Valkeasoski		Equipment Type Höyry- ja lauhdejärjestelmä			Equipment ID
Max. allow. press. (PS)	-	Standard		Project Key TERFMS_NS265A		Project Number NS265A			Work
Operating press.	3.5bar	P&ID	RAUF00303	Projection Method ISO 5253		General Tolerances ISO 13 920-BF			Scale A1
Operating temp.	156degC	Design press	6bar	Welding Symbols ISO 5253		ISO 2768-mK-E ISO 2768-mK-E ISO 2768-mK-E			Weight -
PED Module	-	Design temp.	220degC	 This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries (collectively and individually "Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The document or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.					
PED Group	-	Test press.	-	Title 50235-VLA-25-16C1B					
Wind loads	-	Pipe list doc. ID	RAUAF04300	Status CERTIFIED		Document ID			Sheet 1 / 1
External loads	-	Valve list doc. ID	RAUAF04301	Security Classification Internal					Revision 0