


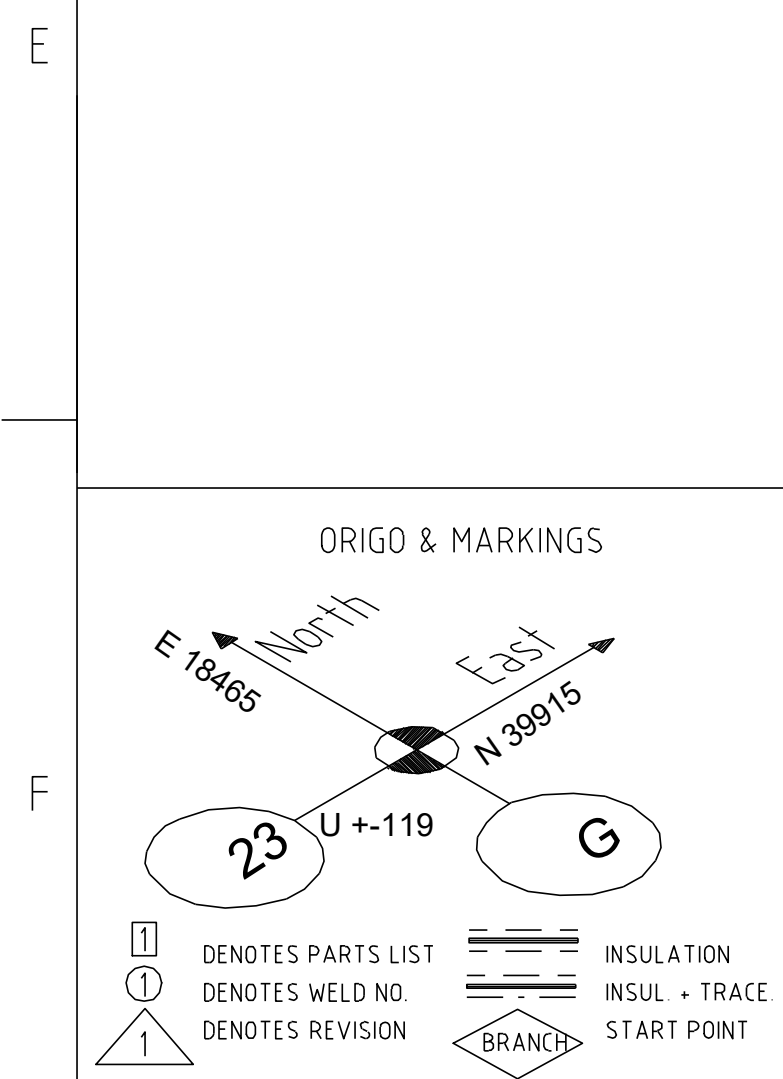

Insulation table (lengths according SSG 7645 Alt2)			
Bore	Thickness	Length	Insulation spec name
25	80mm	3145mm	/PSK3704-4a-good
150	120mm	466mm	/PSK3704-4a-good

Welding factor	Acc. to pipe class
Efficiency of long. weld	Acc. to pipe class
NDT circ. weld %	-
NDT long. weld %	-
Welding list see doc.	-

		Hazardous CLP content	
Directive	2014/68/EU	Pipe Class	/119440-VE16C1C-R00
Design press. (min)	-1bar	PED Category	1/ SEP
Design temp. (min)	-	Media	
Max. allow. press. (PS)	-	Standard	
Operating press.	8.5bar	P&ID	RAU8F00303
Operating temp.	198degC	Design press.	10.7bar
PED Module	-	Design temp.	250degC
PED Group	-	Test press.	-
Wind loads	-	Pipe list doc. ID	RAUAF04300
External loads	-	Valve list doc. ID	RAUAF04301

For installation tolerances dimensions to be checked by pipe contractor at site.							
Degree of prefabrication to be decided by contractor.							
Rev	Revision Note		Created by	Checked by	Approved by	Date	
0			J. Lakka	T. Saarinen	M. Kankkunen	5/5/2026	
	site		Equipment Type				Equipment ID
	Tervasaari, Valkeakoski		Höyry-, ja lauhdejärjestelmä				
	Project Key N5265A	Project Name TerPM S Safe Future		Project Number N5265A		Work	
Projection Method	Welding Symbols ISO 2553	General Tolerances ISO 13 920-BF	ISO 2768 -mK-E	ISO 2768 -mK-E	Scale -	Site A	Weight -
This document is the exclusive intellectual property of Valmet Corporation and/or its subsidiaries collectively and individually ("Valmet") and is furnished solely for executing and maintaining the specific project. Re-use of the document for any other project or purpose is prohibited. The copyright or the information shall not be reproduced, copied or disclosed to any third party without the prior written consent of Valmet. By accessing this document, you accept these terms of use.							
File N50236-VLA-25-16C1B							
Status CERTIFIED	Document ID					Sheet 1 / 1	
Security Classification Internal						Revision 0	