

TYPICAL LIGHTING HOMERUN
SECTION DETAILS



3 - DIRECT-WALL / CEILING MOUNTING
N T S

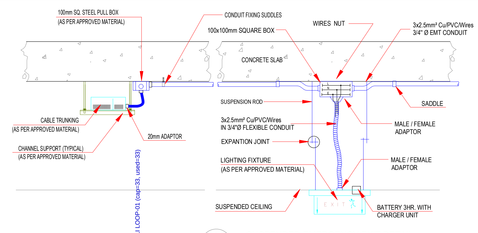

4 - SUSPENDED EMERGENCY EXIT DETAIL
N T S

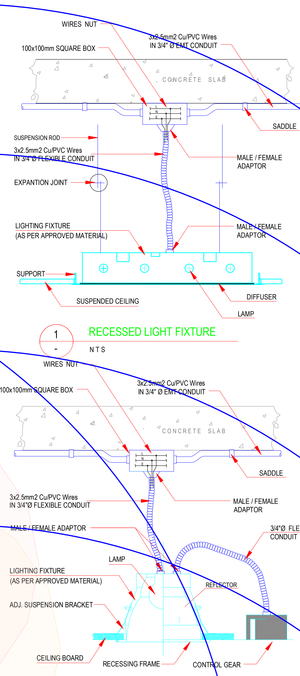

1 - RECESSED LIGHT FIXTURE
N T S

2 - CEILING MOUNTED DOWNLIGHT
N T S

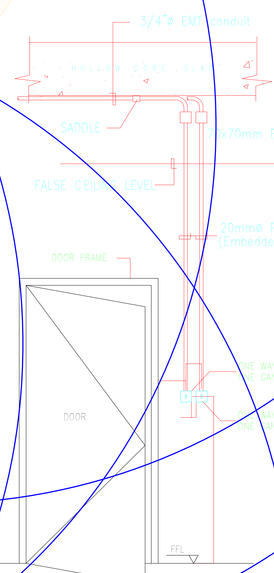

LIGHT SWITCH MOUNTIN
TYPICAL DETAIL

E - SCALE N.T.S

LOOP: DALI LOOP-12 (cap=26, used=26)
LOOP: DALI LOOP-13 (cap=37 , used=37)
LOOP: DALI LOOP-9 (cap=33, used=33)
LOOP: DALI LOOP-4 (cap=37, used=37)
LOOP: DALI LOOP-15 (cap=18, used=18)
LOOP: DALI LOOP-14 (cap=16, used=16)
LOOP: DALI LOOP-03 (cap=36, used=36)
LOOP: DALI LOOP-02 (cap=36, used=36)
LOOP: DALI LOOP-01 (cap=33, used=33)
LOOP: DALI LOOP-05 (cap=14, used=14)
LOOP: DALI LOOP-06 (cap=40, used=40)

DALI LOOP-4
LCP-L2 /01, PART-1 (37Nos.)
DALI LOOP-15
LCP-L2 /01, PART-1 (18Nos.)
DALI LOOP-13
LCP-L2 /01, PART-1 (37Nos.)
DALI LOOP-03
LCP-L2 /01, PART-1 (36Nos.)
DALI LOOP-14
LCP-L2 /01, PART-1 (16Nos.)
DALI LOOP-12
LCP-L2 /01, PART-1 (26Nos.)
DALI LOOP-3
LCP-L2 /01, PART-1 (33Nos.)
DALI LOOP-12
LCP-L2 /01, PART-1 (28Nos.)
DALI LOOP-11
LCP-L2 /01, PART-1 (28Nos.)
DALI LOOP-10
LCP-L2 /01, PART-1 (28Nos.)
DALI LOOP-08
LCP-L2 /01, PART-1 (34Nos.)

300 x 100mm Compartment
Cable Trunking for Lighting,
Power & Equipment Power
Refer to Equipment Power Dwg.
for Final Cable Tray Layout

LIGHTING TAKEOFF REVIEW
ASSIGNED FIXTURES (283)
CB
EM
EMEM
DISCARDED NOISE (380):
Gray X @ 50%

SUMMARY:
Fixtures: 673
Assigned: 442
Discarded: 231
Room: 15
Room: 181
Space: 33
Unassigned (<0.75): 442
IP: wallsonly: 0

BY SPEC CODE:
S1: 347
S2: 71
S2: 20
CS: 4

BY ROOM TYPE:
(no name): 112
Air: 30
Lift: 22
Lift: 22
Stair: 16
Toilet: 34
Toilet: 10
Toilet: 10
Toilet: 4
Toilet: 4
Toilet: 2
Toilet: 2
Void: 1