


Phase β (2.6kV): NO_2^- clamp removes oscillation?

(a) Bulk-only $[\text{O}_3]$ — NO_2^- as dynamical variable test



(b) Bulk-only $[\text{NO}_2^-]$ — verification of clamp

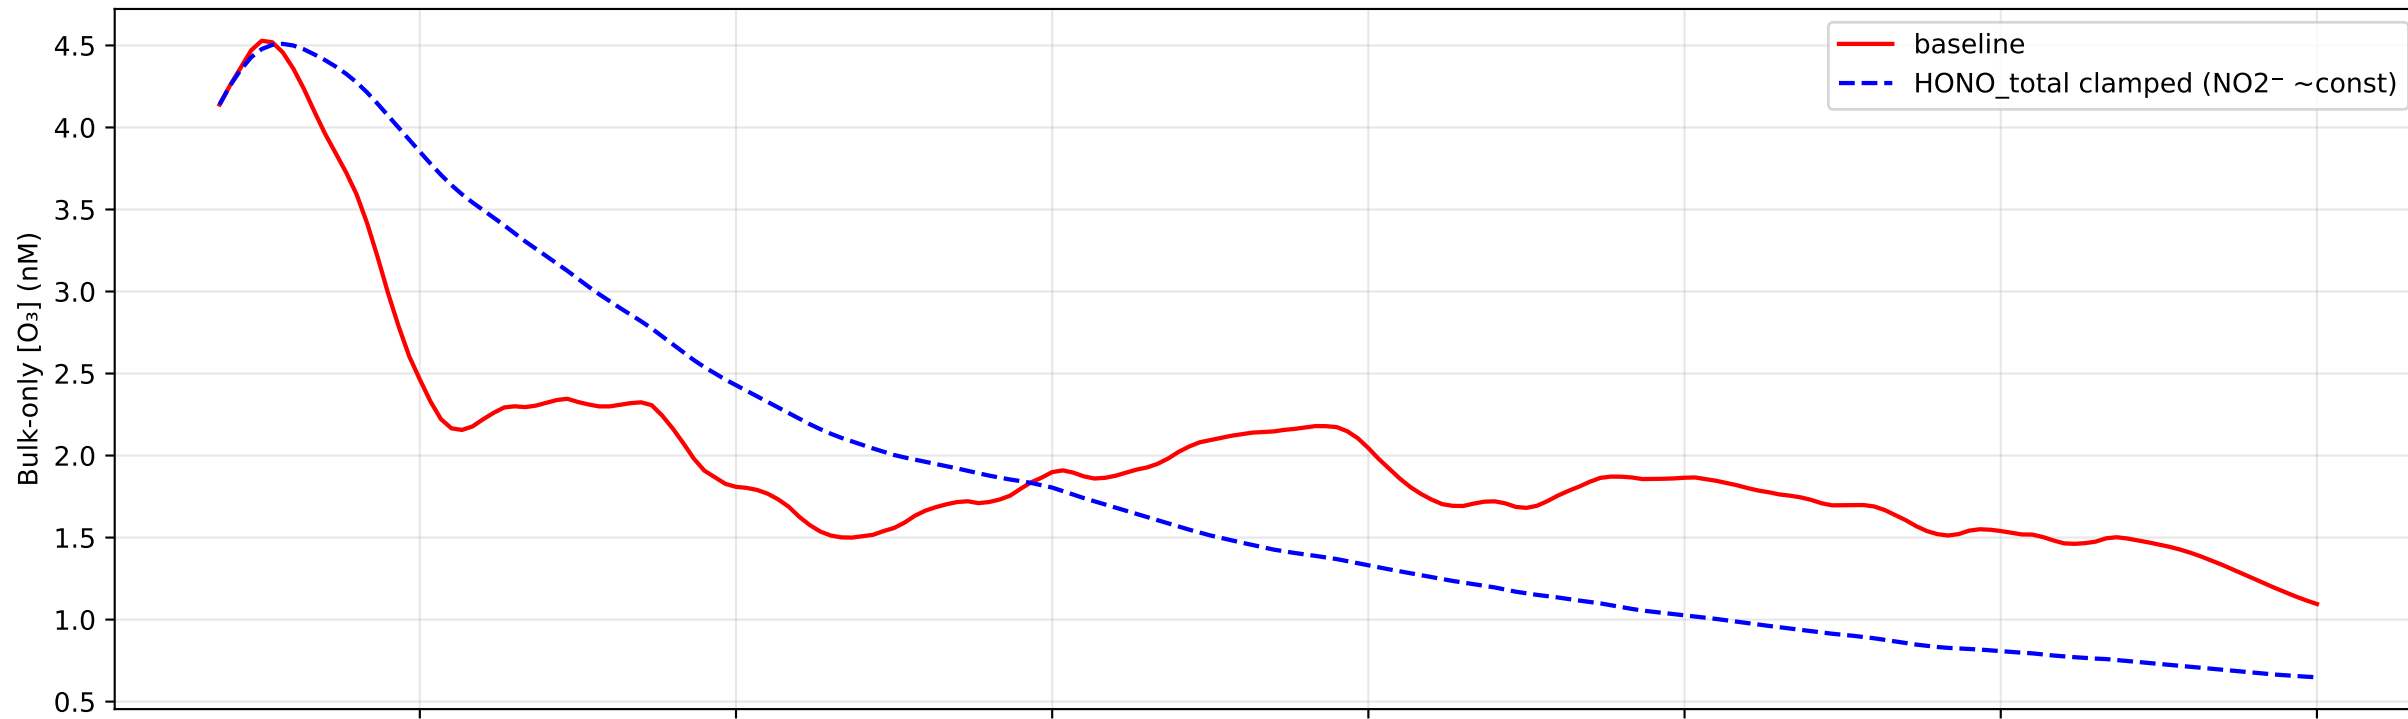