


Phase G (3.6kV): dz_min grid sweep — verify numerical leak hypothesis

(a) O₃ spatial @ t=480s — dz_min sweep



(b) O₃ at z≈4mm vs time

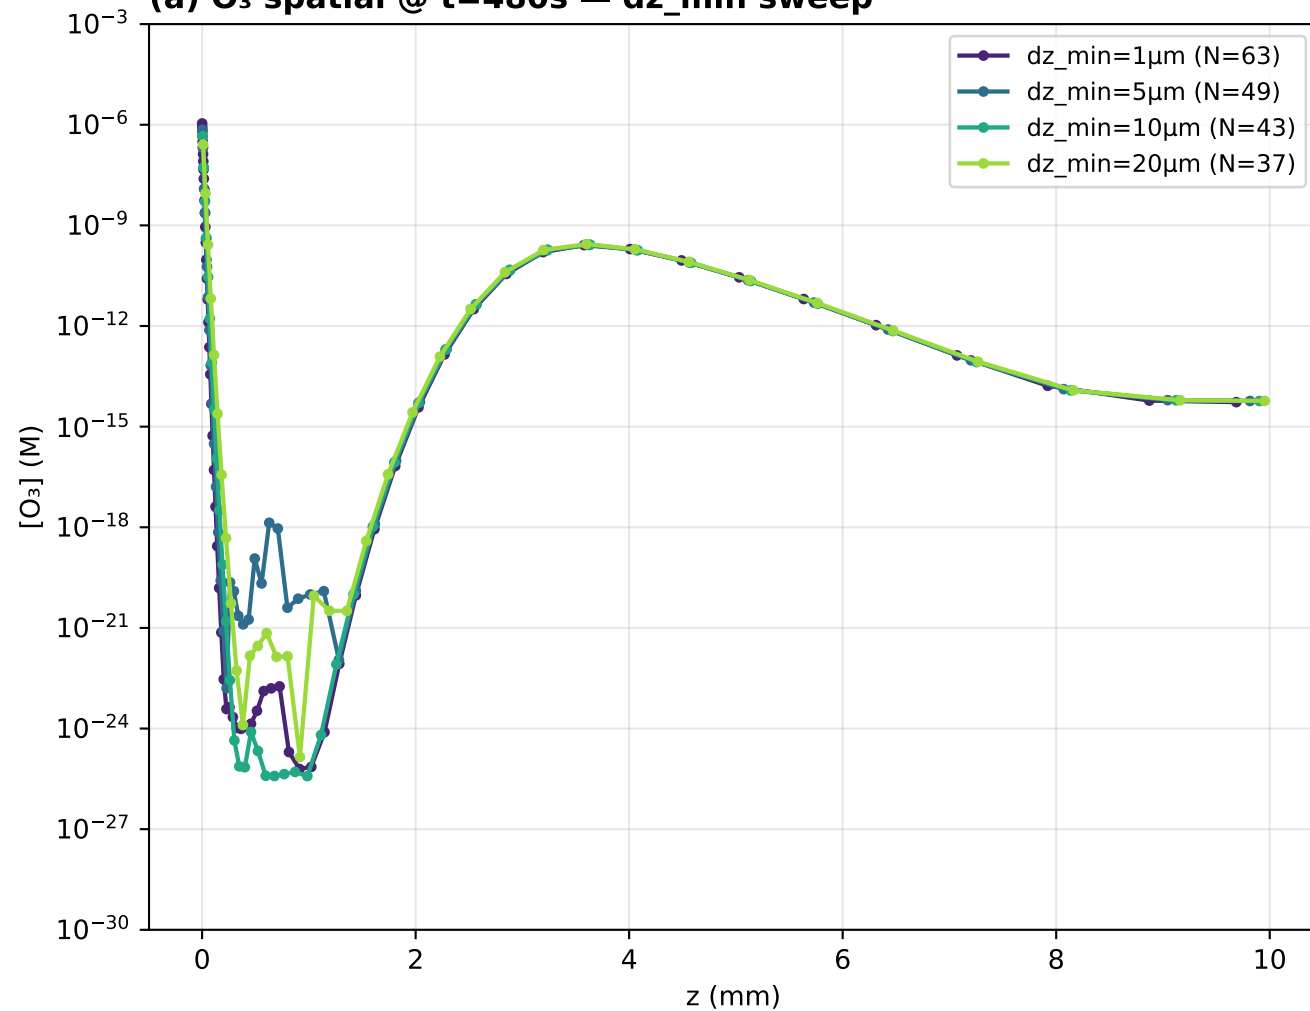