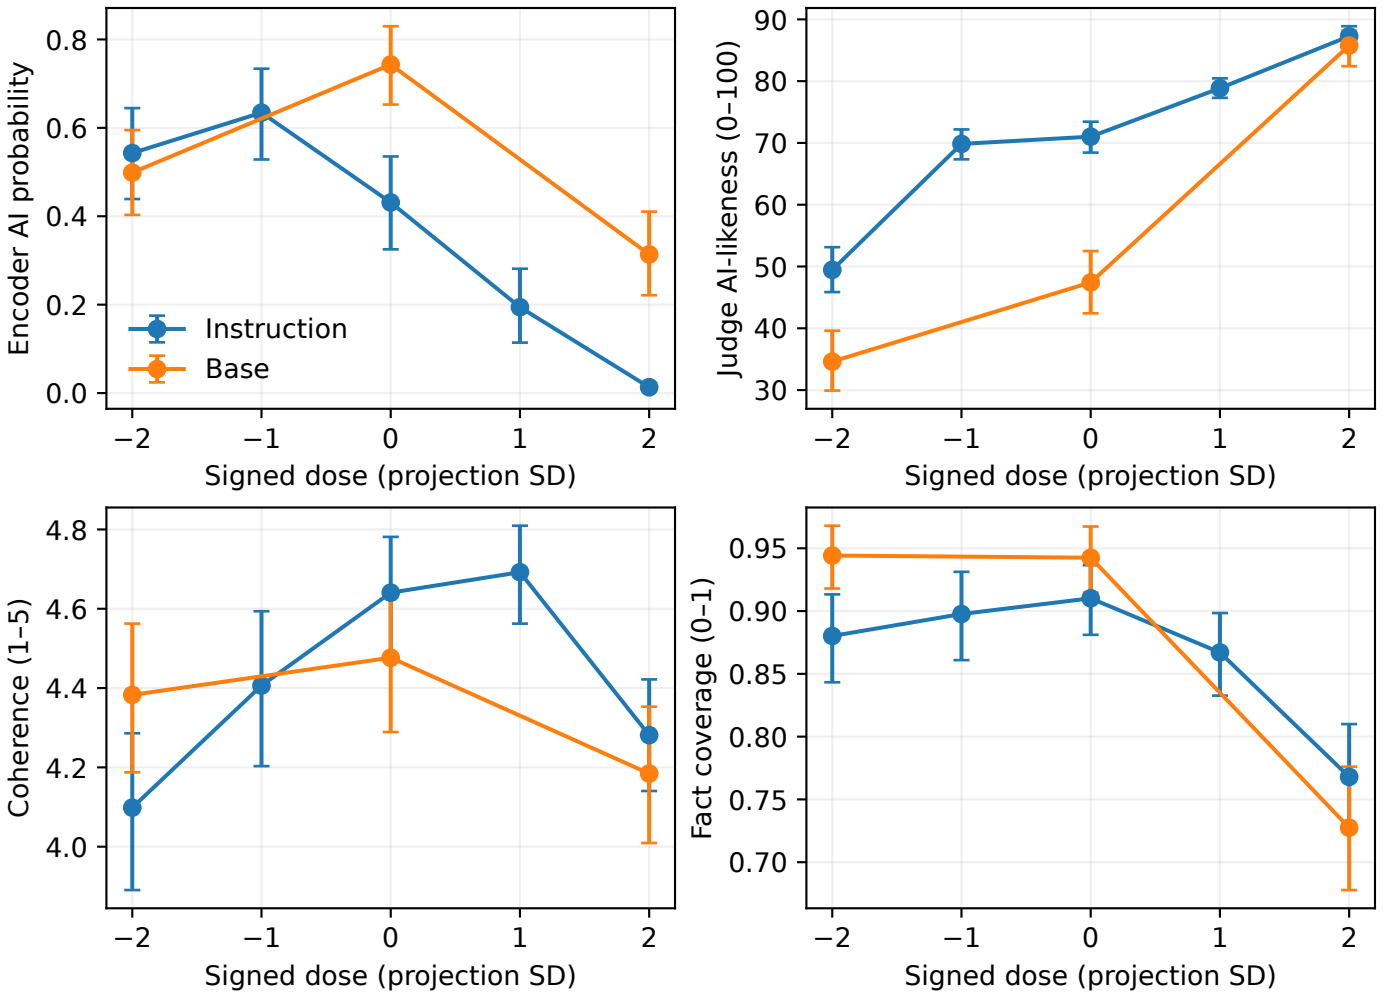
Encoder AI probability
0.0
0.2
0.4
0.6
0.8
Instruction
Base
−2
−1
0
1
2
Signed dose (projection SD)
Judge AI-likeness (0–100)
30
40
50
60
70
80
90
Signed dose (projection SD)
Coherence (1–5)
4.0
4.2
4.4
4.6
4.8
Signed dose (projection SD)
Fact coverage (0–1)
0.70
0.75
0.80
0.85
0.90
0.95
Signed dose (projection SD)