


## Sprint-4

Date	20 November 2022
Team ID	PNT2022TMID39403
Project Name	Signs with Smart Connectivity for Better Road Safety

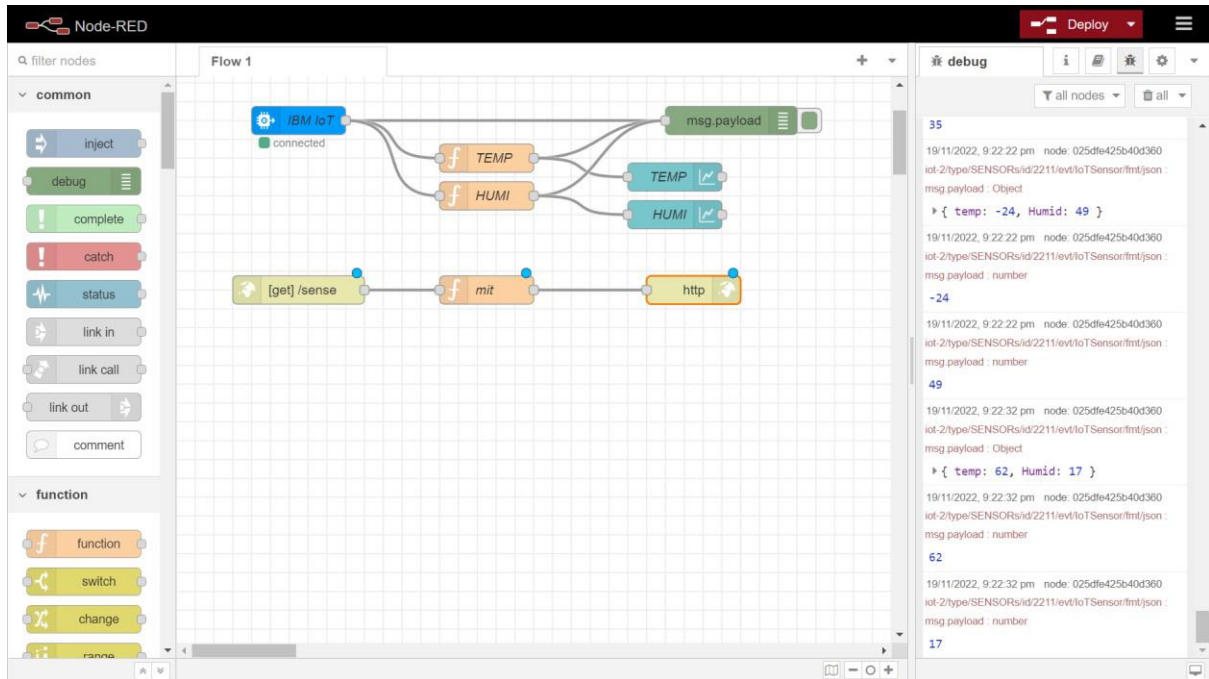

**Device Details**

Browse Action Device Types Interfaces Add Device

---

Identity Device Information **Recent Events** State Logs

The recent events listed show the live stream of data that is coming and going from this device.

Event	Value	Format	Last Received
IoT Sensor	{"temp": -7, "humid": 51}	json	a few seconds ago
IoT Sensor	{"temp": 82, "humid": 42}	json	a minute ago
IoT Sensor	{"temp": 40, "humid": 47}	json	a minute ago
IoT Sensor	{"temp": 3, "humid": 47}	json	a minute ago
IoT Sensor	{"temp": 71, "humid": 43}	json	a minute ago

\*Python 3.7.0 Shell\*

```
File Edit Shell Debug Options Window Help
Temperature = 6 C Humidity = 44 % to IBM Watson
Temperature = 18 C Humidity = 23 % to IBM Watson
Temperature = 82 C Humidity = 26 % to IBM Watson
Temperature = 67 C Humidity = 69 % to IBM Watson
Temperature = 58 C Humidity = 33 % to IBM Watson
Temperature = 61 C Humidity = 43 % to IBM Watson
Temperature = 20 C Humidity = 79 % to IBM Watson
Temperature = 20 C Humidity = 38 % to IBM Watson
Temperature = 64 C Humidity = 36 % to IBM Watson
Temperature = 56 C Humidity = 57 % to IBM Watson
Temperature = -5 C Humidity = 31 % to IBM Watson
Temperature = 22 C Humidity = 49 % to IBM Watson
Temperature = 15 C Humidity = 83 % to IBM Watson
Temperature = 34 C Humidity = 80 % to IBM Watson
Temperature = 72 C Humidity = 87 % to IBM Watson
Temperature = -1 C Humidity = 20 % to IBM Watson
Temperature = 38 C Humidity = 71 % to IBM Watson
Temperature = 51 C Humidity = 37 % to IBM Watson
Temperature = 89 C Humidity = 13 % to IBM Watson
Temperature = -24 C Humidity = 27 % to IBM Watson
Temperature = 56 C Humidity = 41 % to IBM Watson
Temperature = 79 C Humidity = 27 % to IBM Watson
Temperature = 87 C Humidity = 60 % to IBM Watson
Temperature = -24 C Humidity = 12 % to IBM Watson
Temperature = -16 C Humidity = 59 % to IBM Watson
Temperature = 8 C Humidity = 39 % to IBM Watson
Temperature = -17 C Humidity = 61 % to IBM Watson
Temperature = 7 C Humidity = 54 % to IBM Watson
Temperature = 45 C Humidity = 28 % to IBM Watson
Temperature = 1 C Humidity = 71 % to IBM Watson
Temperature = 70 C Humidity = 70 % to IBM Watson
Temperature = 59 C Humidity = 30 % to IBM Watson
Temperature = 93 C Humidity = 83 % to IBM Watson
Temperature = 78 C Humidity = 35 % to IBM Watson
Temperature = -24 C Humidity = 49 % to IBM Watson
Temperature = 62 C Humidity = 17 % to IBM Watson
Temperature = 66 C Humidity = 14 % to IBM Watson
Temperature = -3 C Humidity = 58 % to IBM Watson
Temperature = 11 C Humidity = 77 % to IBM Watson
Temperature = -20 C Humidity = 45 % to IBM Watson
Temperature = 88 C Humidity = 89 % to IBM Watson
Temperature = 44 C Humidity = 63 % to IBM Watson
Temperature = 58 C Humidity = 33 % to IBM Watson
Temperature = 94 C Humidity = 10 % to IBM Watson
```

