

# Project Development Phase

## Sprint 4


Date	13 November 2022
Team ID	PNT2022TMID35665
Project Name	Industry-Specific Intelligent Fire Management System

LINK: <https://wokwi.com/projects/347212137885598290>


LINK: <https://wokwi.com/projects/322410731508073042>

### IMAGES OF MIT-APP INVERTER:


#### SCREEN 1:

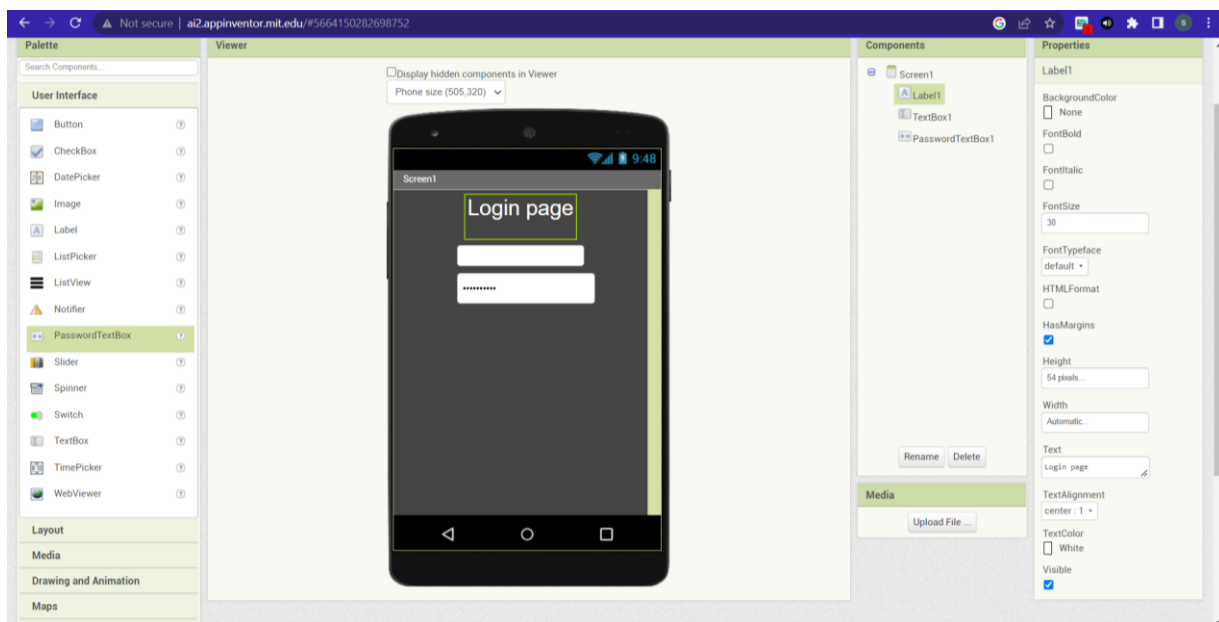


SCREEN 1 Block Codes:

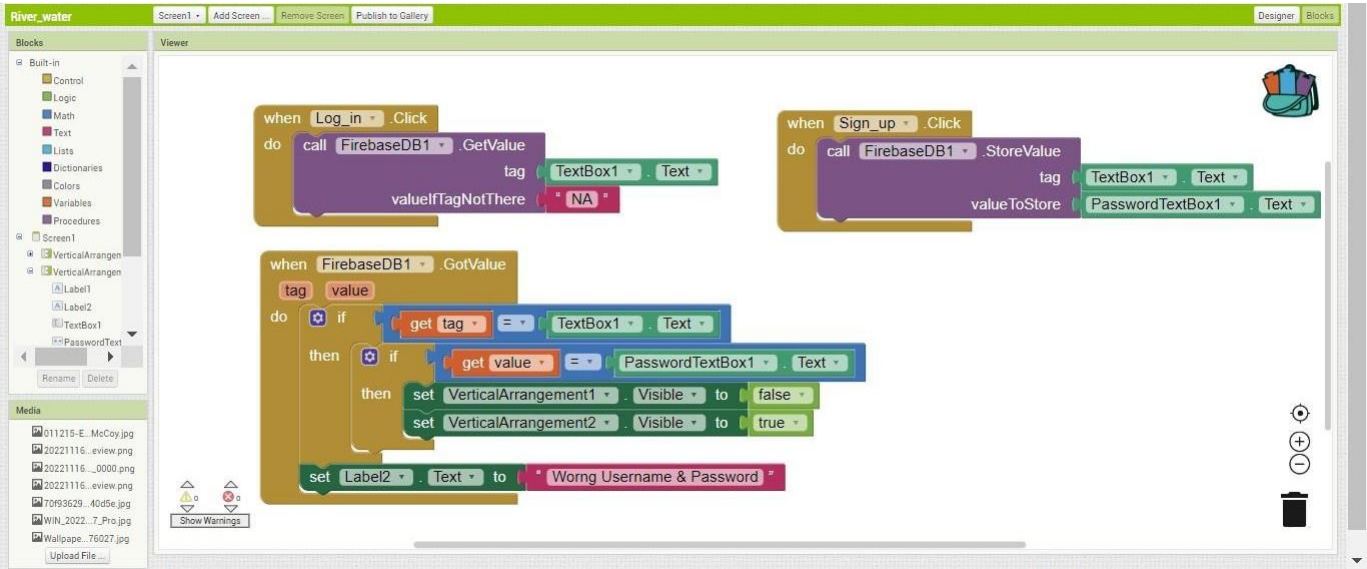


SCREEN 2:

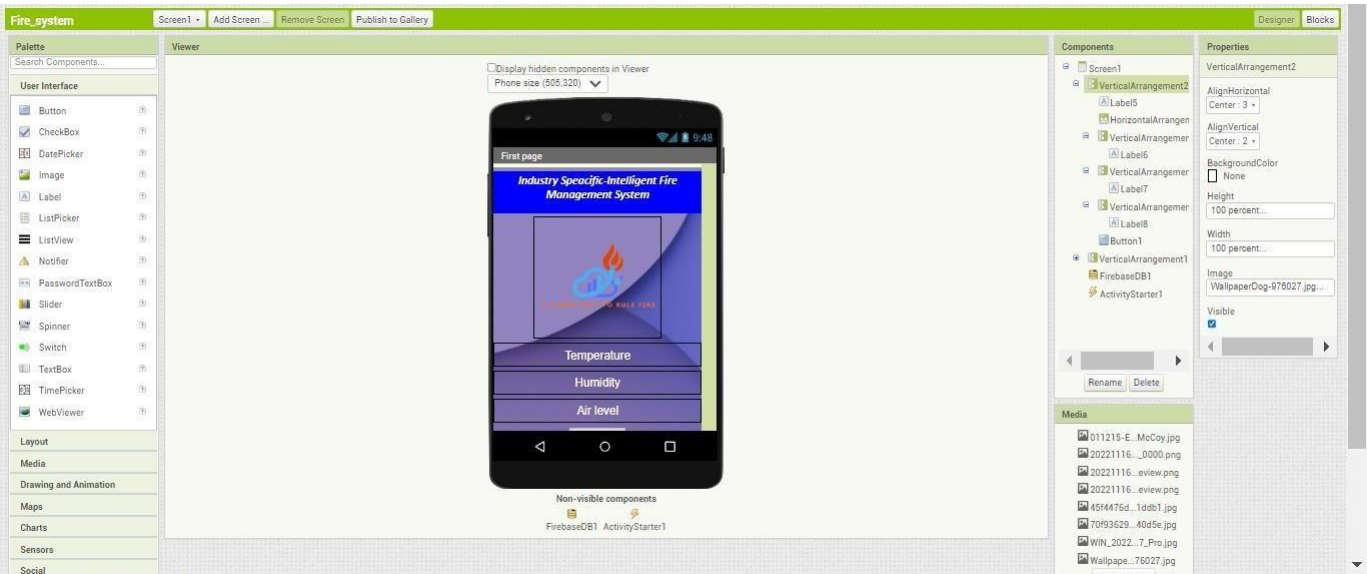

SCREEN 2 Outputs:

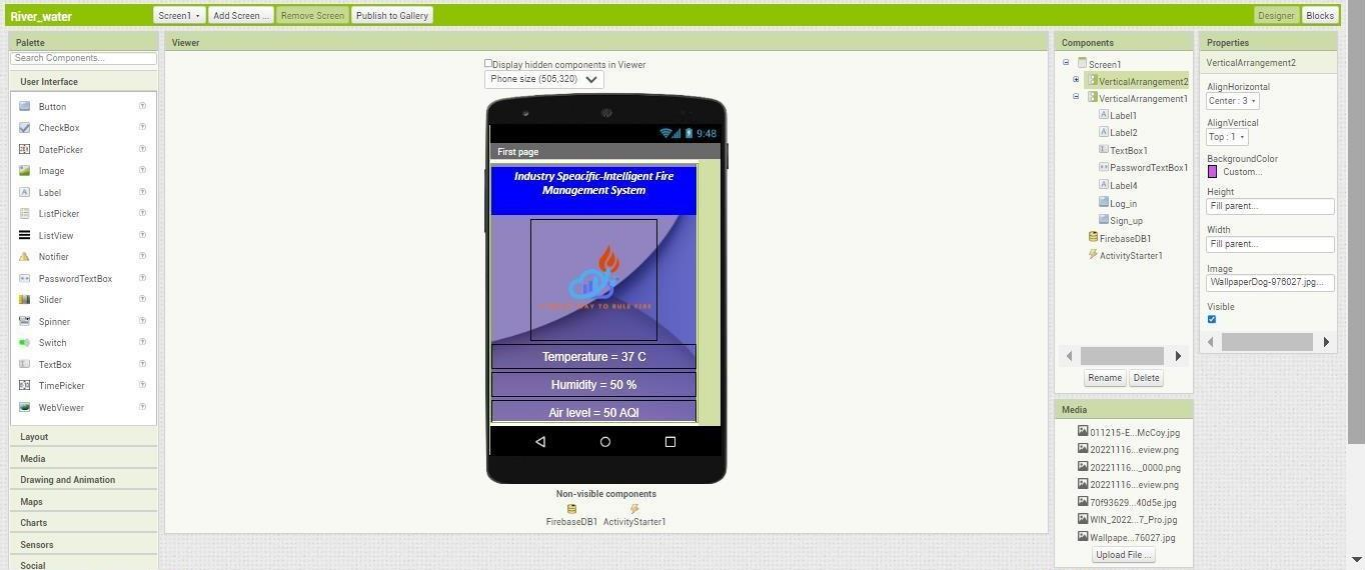

SCREEN 2 Block Codes:

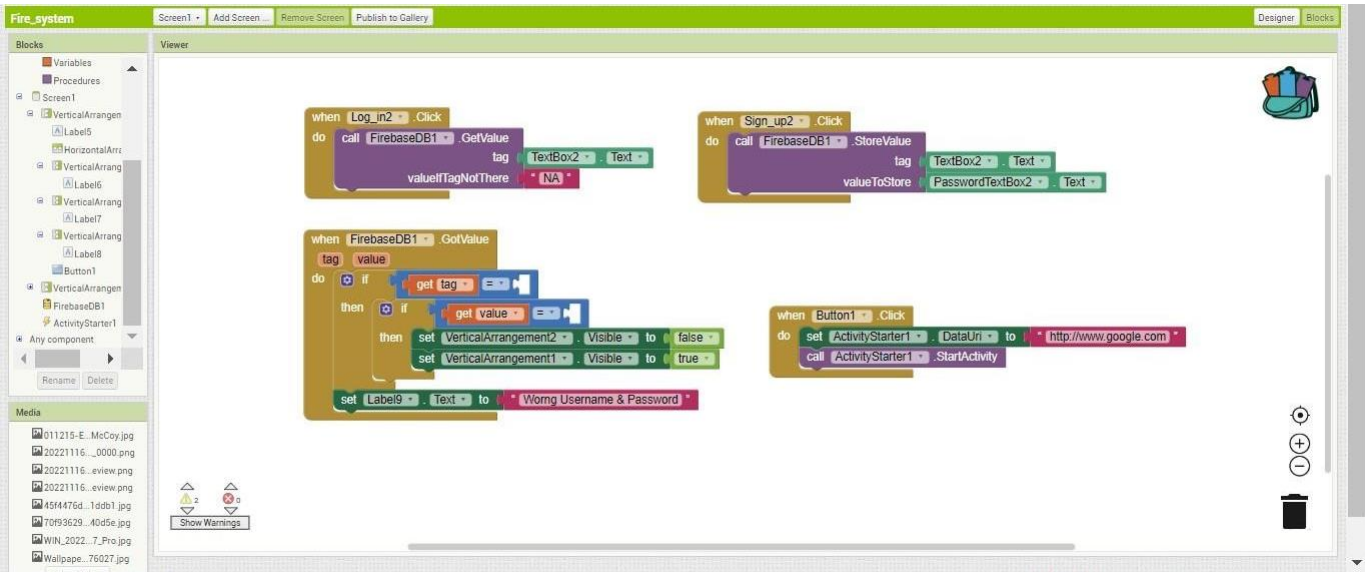

## FIRE MANAGEMENT SYSTEM



TEMPERATURE : 121



GAS : 3



FLAME : 650



FIRE STATUS : Fire is Detected  
SPRINKLER STATUS: Working  
GAS STATUS : No Gas Leakage is Detected  
EXHAUST FAN STATUS : Not Working