


## Sprint-4

Date	20 November 2022
Team ID	PNT2022TMID39433
Project Name	Signs with Smart Connectivity for Better Road Safety

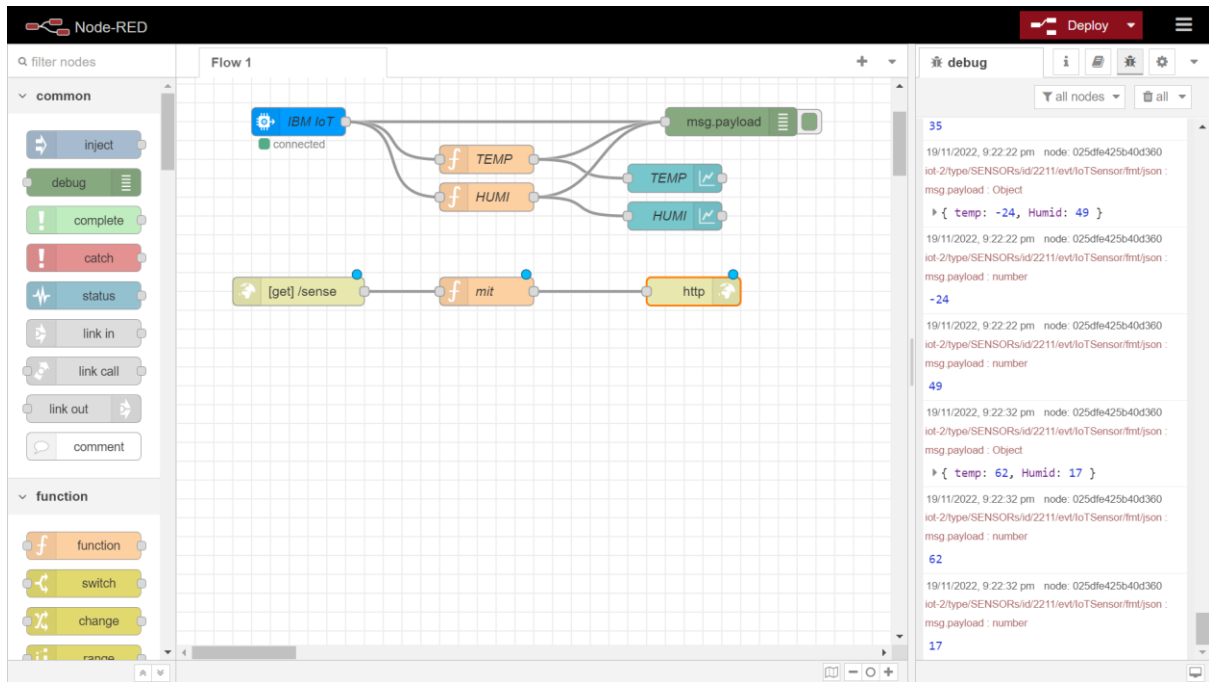

IBM Watson IoT Platform

Recent Events

The recent events listed show the live stream of data that is coming and going from this device.

Event	Value	Format	Last Received
IoT Sensor	{"temp": -7, "Humid": 51}	json	a few seconds ago
IoT Sensor	{"temp": 82, "Humid": 42}	json	a minute ago
IoT Sensor	{"temp": 40, "Humid": 47}	json	a minute ago
IoT Sensor	{"temp": 3, "Humid": 47}	json	a minute ago
IoT Sensor	{"temp": 71, "Humid": 43}	json	a minute ago

0 Simulations running

\*Python 3.7.0 Shell\*

```
File Edit Shell Debug Options Window Help
Temperature = 6 C Humidity = 44 % to IBM Watson
Temperature = 18 C Humidity = 23 % to IBM Watson
Temperature = 82 C Humidity = 26 % to IBM Watson
Temperature = 67 C Humidity = 69 % to IBM Watson
Temperature = 58 C Humidity = 33 % to IBM Watson
Temperature = 61 C Humidity = 43 % to IBM Watson
Temperature = 20 C Humidity = 79 % to IBM Watson
Temperature = 20 C Humidity = 38 % to IBM Watson
Temperature = 64 C Humidity = 36 % to IBM Watson
Temperature = 56 C Humidity = 57 % to IBM Watson
Temperature = -5 C Humidity = 31 % to IBM Watson
Temperature = 22 C Humidity = 49 % to IBM Watson
Temperature = 15 C Humidity = 83 % to IBM Watson
Temperature = 34 C Humidity = 80 % to IBM Watson
Temperature = 72 C Humidity = 87 % to IBM Watson
Temperature = -1 C Humidity = 20 % to IBM Watson
Temperature = 38 C Humidity = 71 % to IBM Watson
Temperature = 51 C Humidity = 37 % to IBM Watson
Temperature = 89 C Humidity = 13 % to IBM Watson
Temperature = -24 C Humidity = 27 % to IBM Watson
Temperature = 56 C Humidity = 41 % to IBM Watson
Temperature = 79 C Humidity = 27 % to IBM Watson
Temperature = 87 C Humidity = 60 % to IBM Watson
Temperature = -24 C Humidity = 12 % to IBM Watson
Temperature = -16 C Humidity = 59 % to IBM Watson
Temperature = 8 C Humidity = 39 % to IBM Watson
Temperature = -17 C Humidity = 61 % to IBM Watson
Temperature = 7 C Humidity = 54 % to IBM Watson
Temperature = 45 C Humidity = 28 % to IBM Watson
Temperature = 1 C Humidity = 71 % to IBM Watson
Temperature = 70 C Humidity = 70 % to IBM Watson
Temperature = 59 C Humidity = 30 % to IBM Watson
Temperature = 93 C Humidity = 83 % to IBM Watson
Temperature = 78 C Humidity = 35 % to IBM Watson
Temperature = -24 C Humidity = 49 % to IBM Watson
Temperature = 62 C Humidity = 17 % to IBM Watson
Temperature = 66 C Humidity = 14 % to IBM Watson
Temperature = -3 C Humidity = 58 % to IBM Watson
Temperature = 11 C Humidity = 77 % to IBM Watson
Temperature = -20 C Humidity = 45 % to IBM Watson
Temperature = 88 C Humidity = 89 % to IBM Watson
Temperature = 44 C Humidity = 63 % to IBM Watson
Temperature = 58 C Humidity = 33 % to IBM Watson
Temperature = 94 C Humidity = 10 % to IBM Watson
```

← ↻ <https://node-red-tbdal-2022-11-10.eu-gb.mybluemix.net/sense>

```
{\"Temperature\":99,\"Humidity\":81}
```