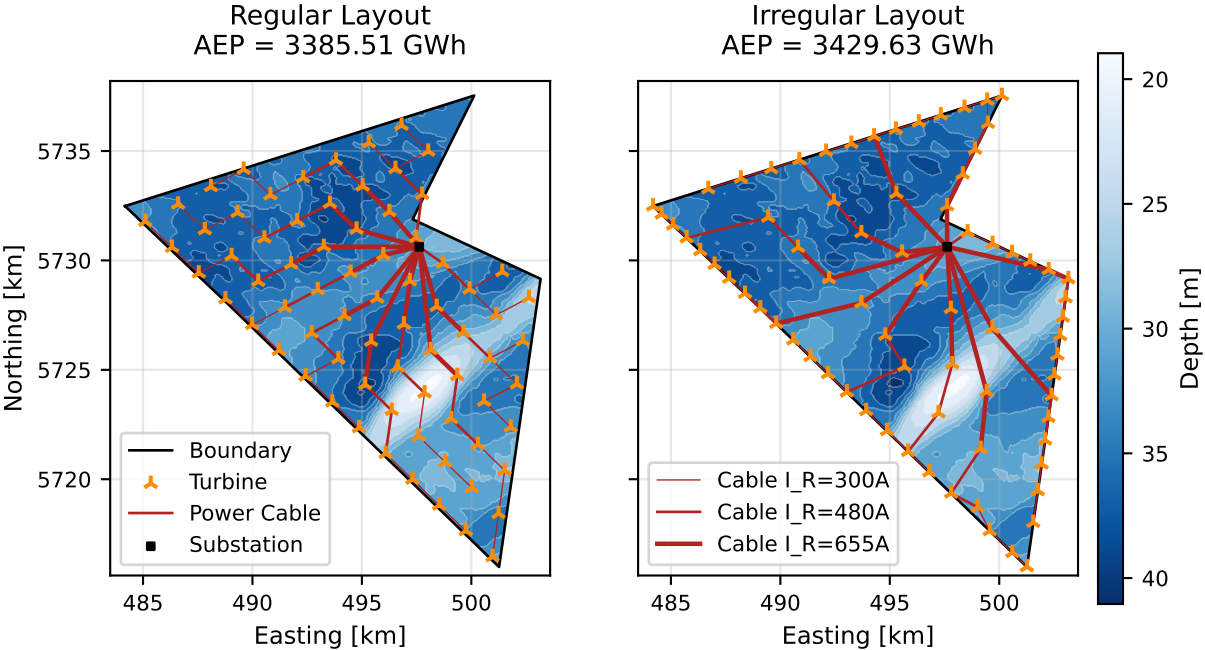
Regular Layout
AEP = 3385.51 GWh
Irregular Layout
AEP = 3429.63 GWh
Northing [km]
5735
5730
5725
5720
485
490
495
500
Easting [km]
Boundary
Turbine
Power Cable
Substation
Cable I_R=300A
Cable I_R=480A
Cable I_R=655A
Depth [m]
20
25
30
35
40