




(1) Supervisor's triggered clock

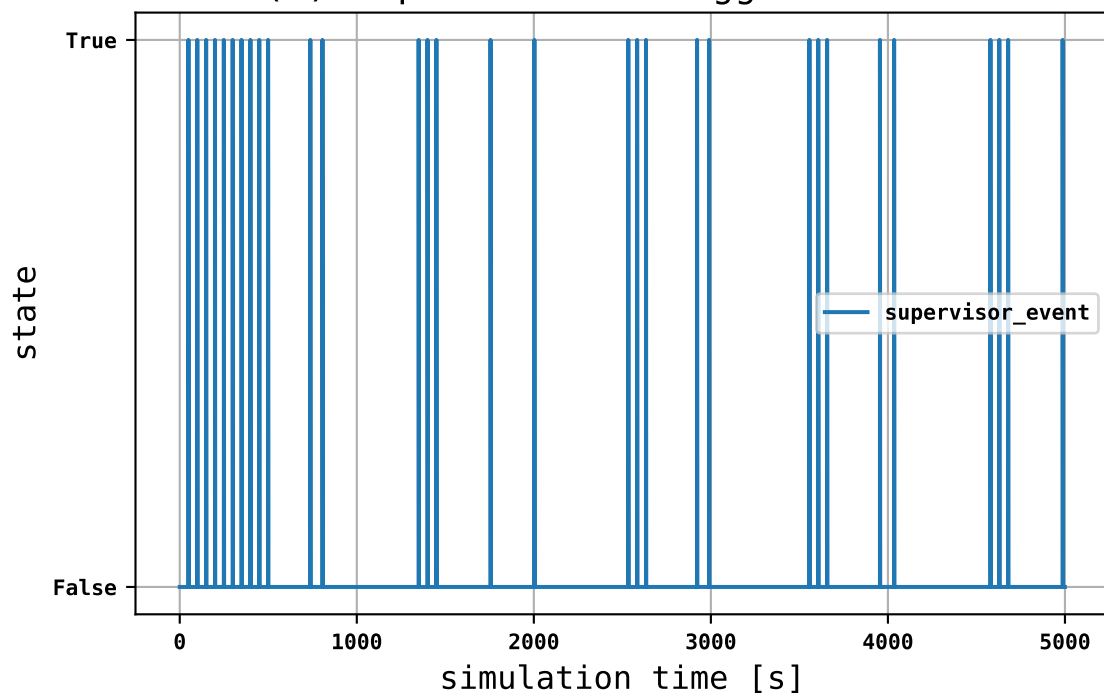


(2) Controller's periodic clock

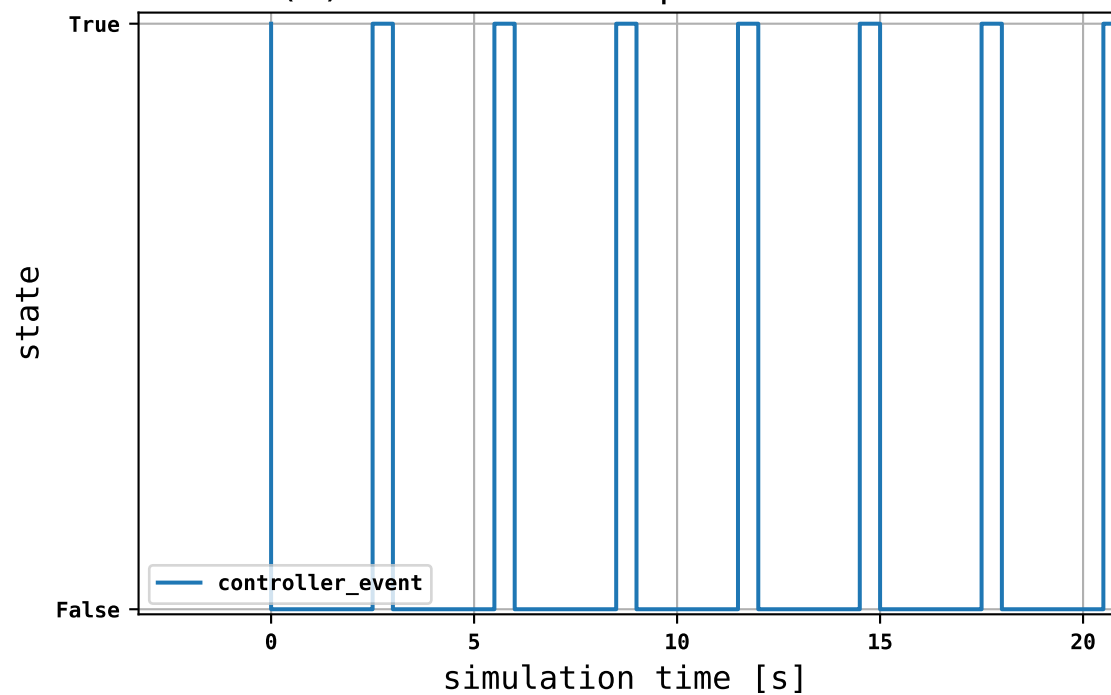


(3) Plant temperatures

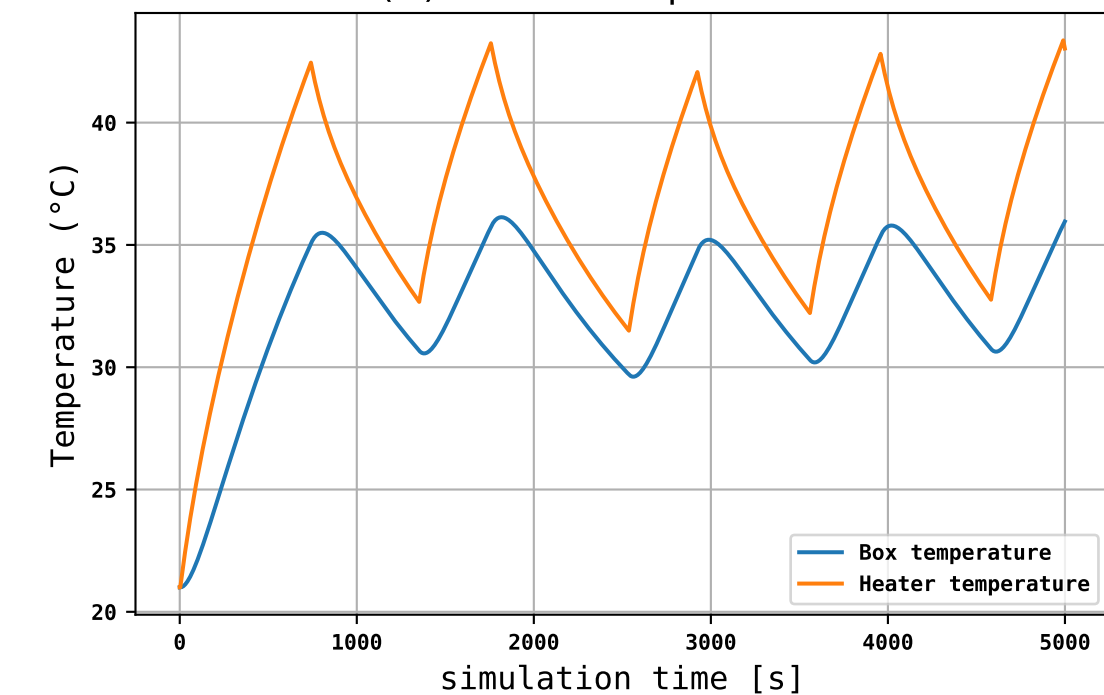

(4) Heater control

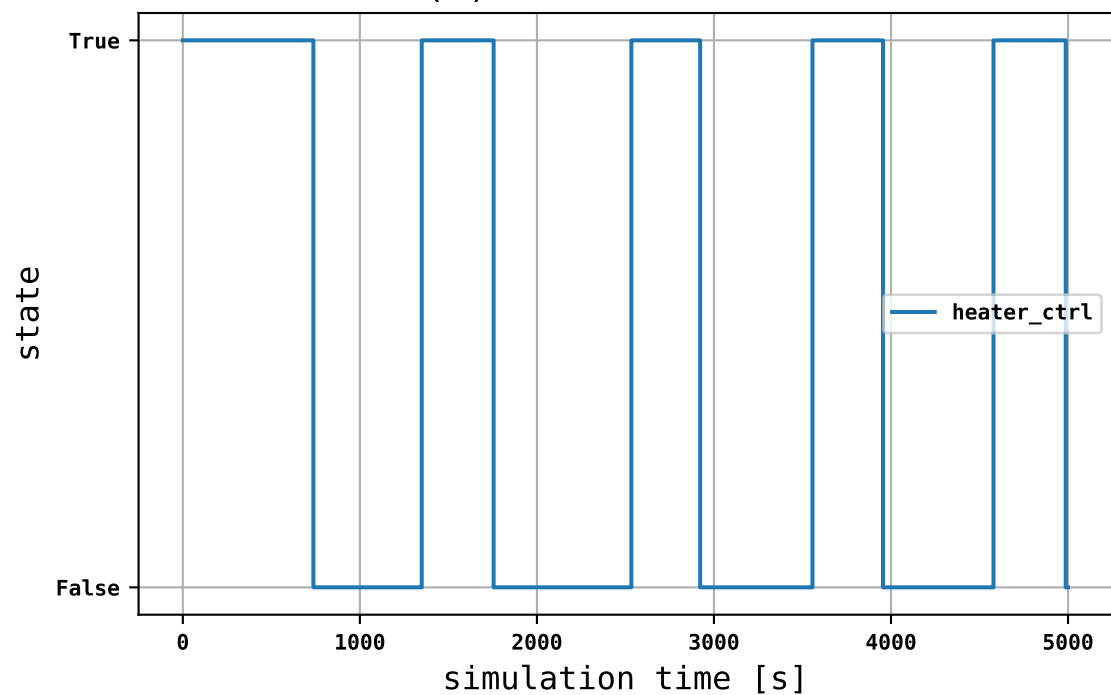

(5) Supervisor's desired temperature

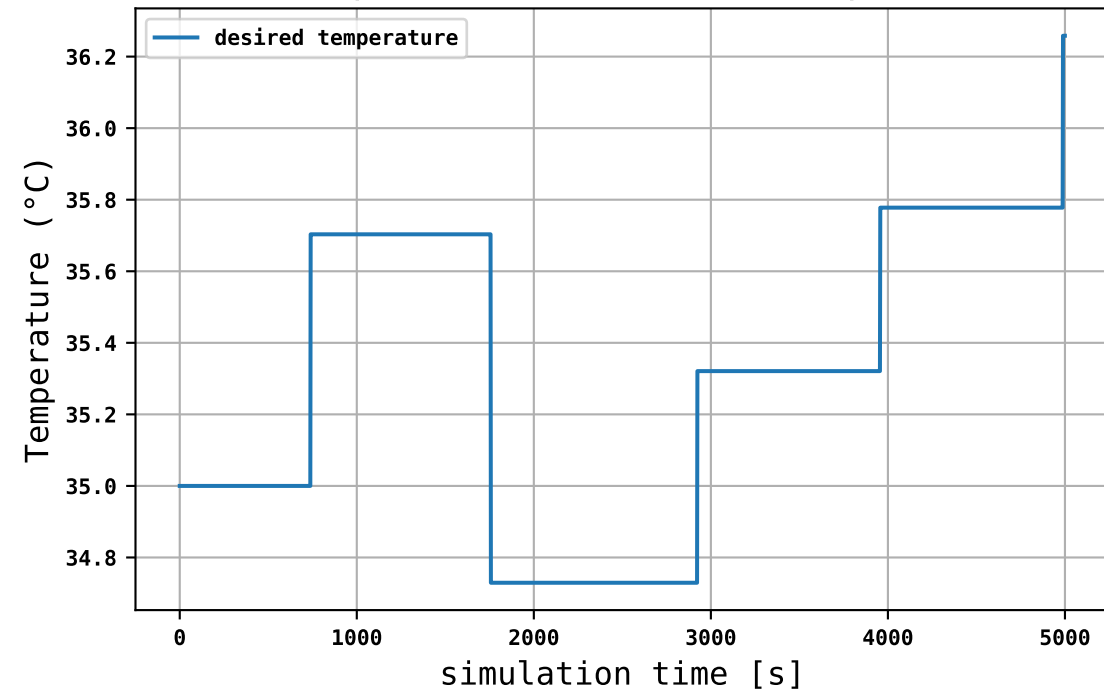

(6) Supervisor's heating time

