




(1) Supervisor's triggered clock

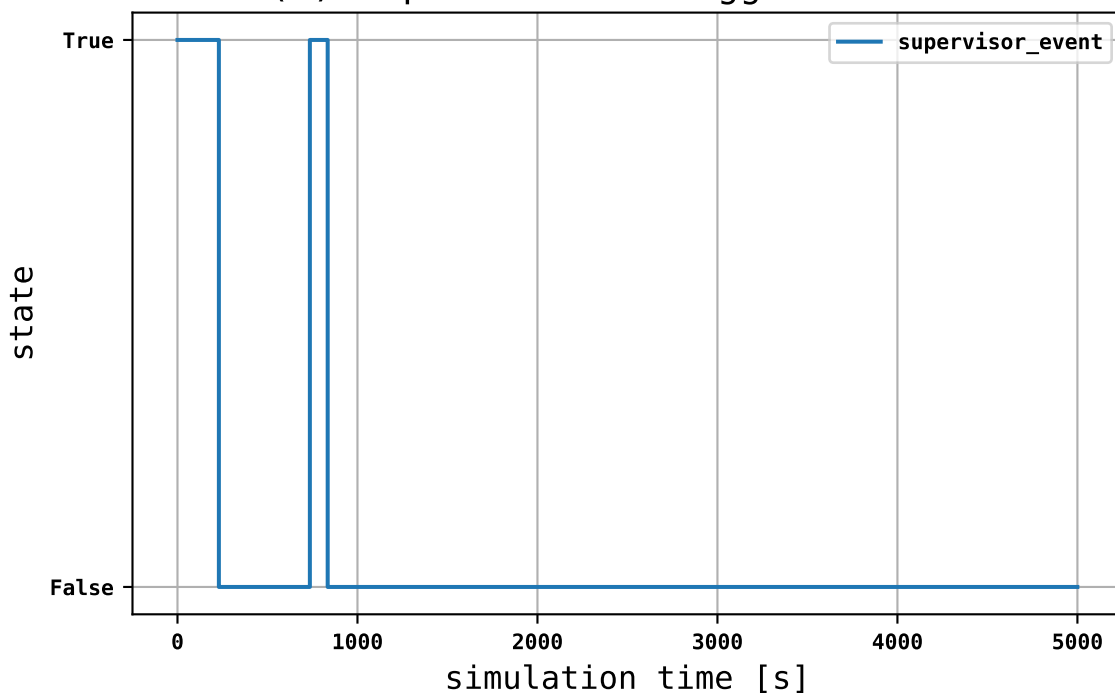


(2) Plant temperatures

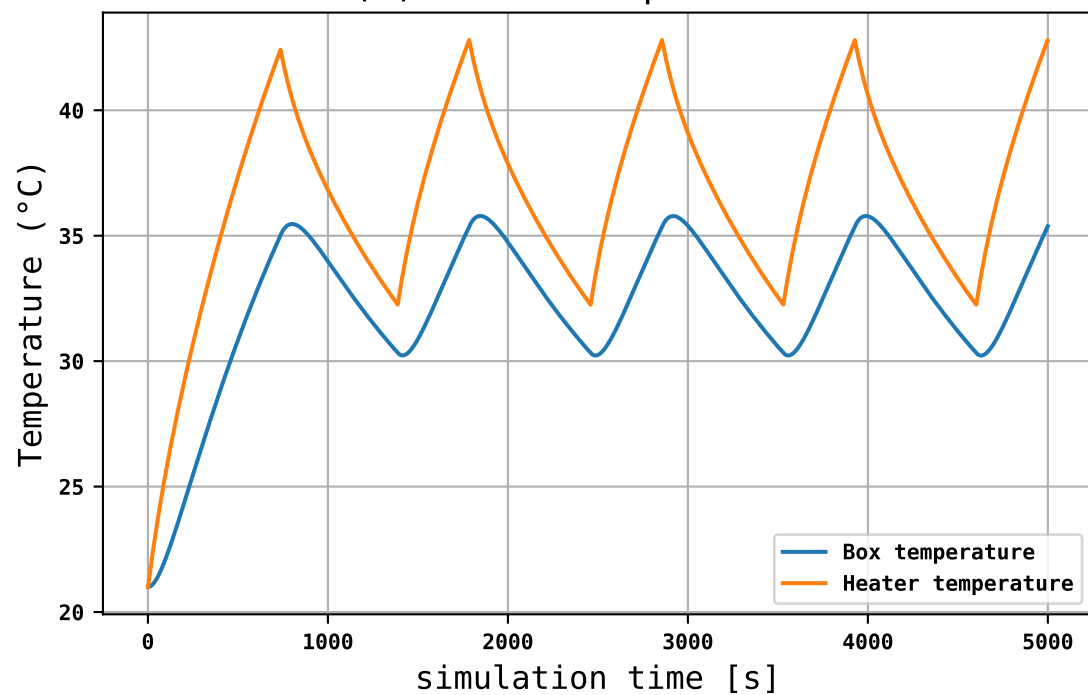

(3) Heater control

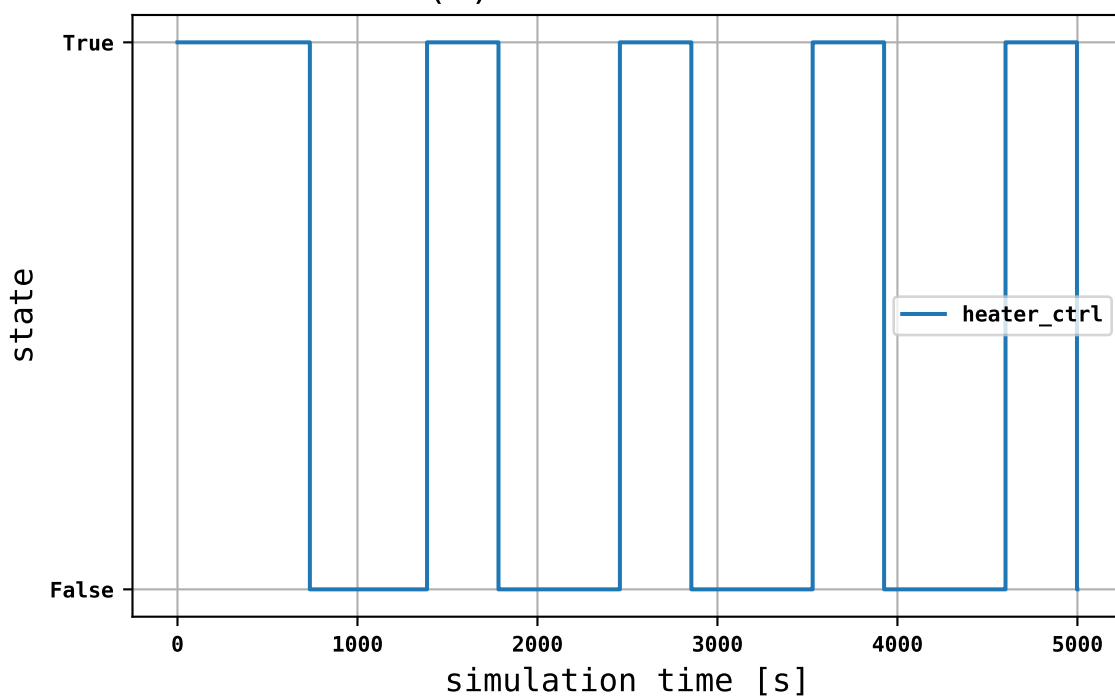

(4) Supervisor's desired temperature

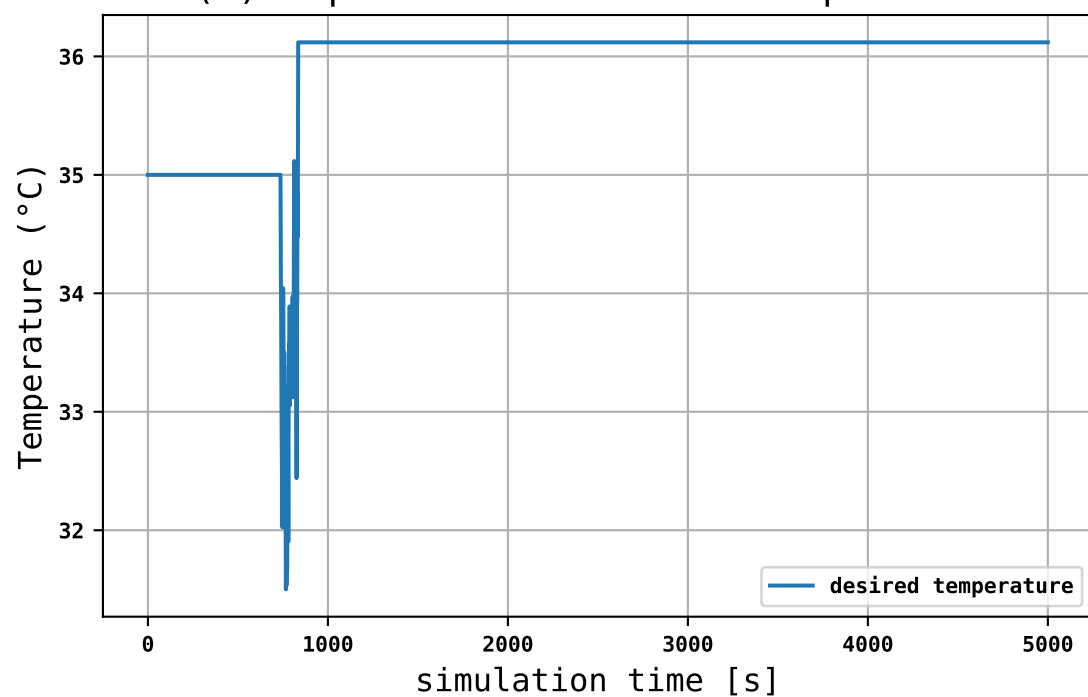

(4) Supervisor's heating time

