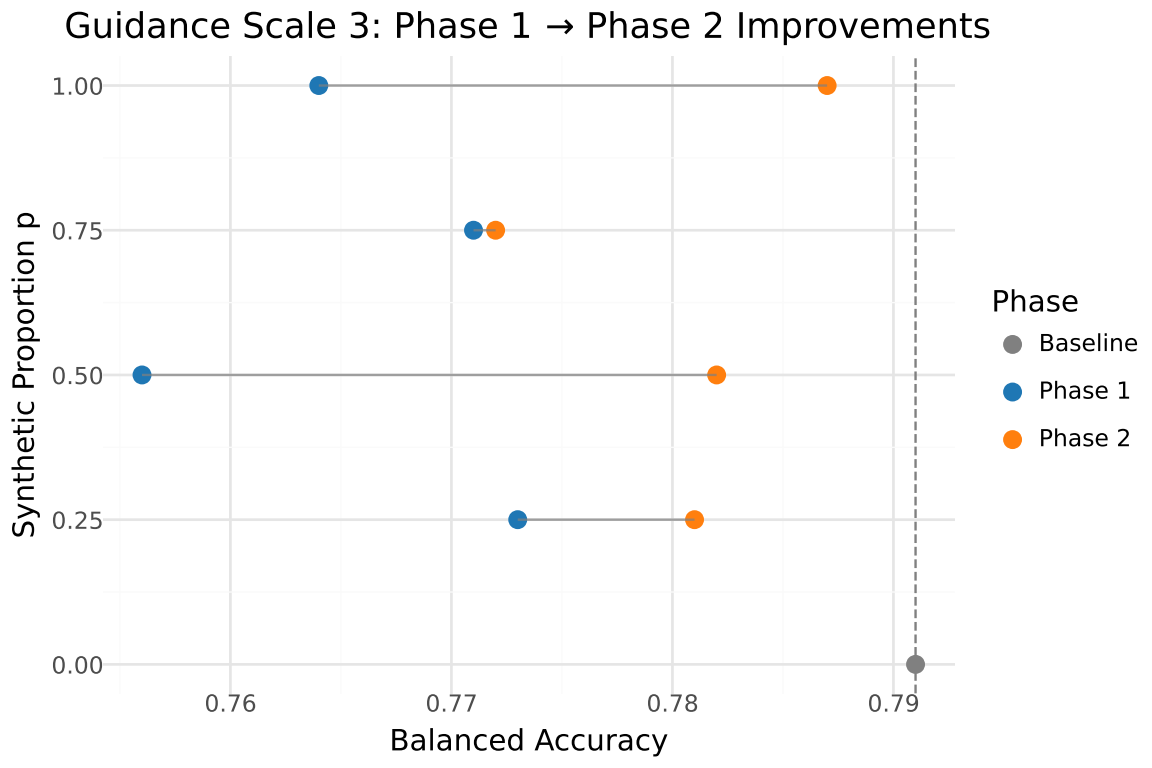
Guidance Scale 3: Phase 1 → Phase 2 Improvements
Synthetic Proportion p
1.00
0.75
0.50
0.25
0.00
0.76
0.77
0.78
0.79
Balanced Accuracy
Phase
Baseline
Phase 1
Phase 2