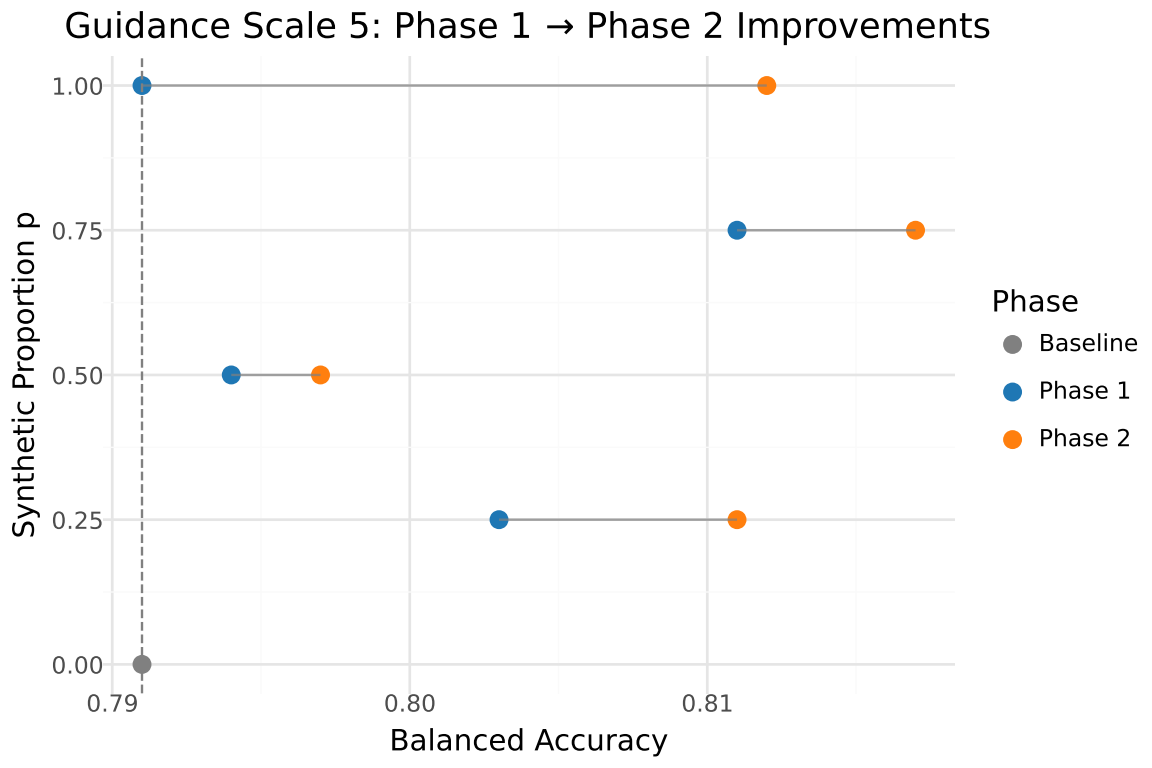
Guidance Scale 5: Phase 1 → Phase 2 Improvements
Synthetic Proportion p
1.00
0.75
0.50
0.25
0.00
0.79
0.80
0.81
Balanced Accuracy
Phase
Baseline
Phase 1
Phase 2