




WALL A  
(SIDE WALL)

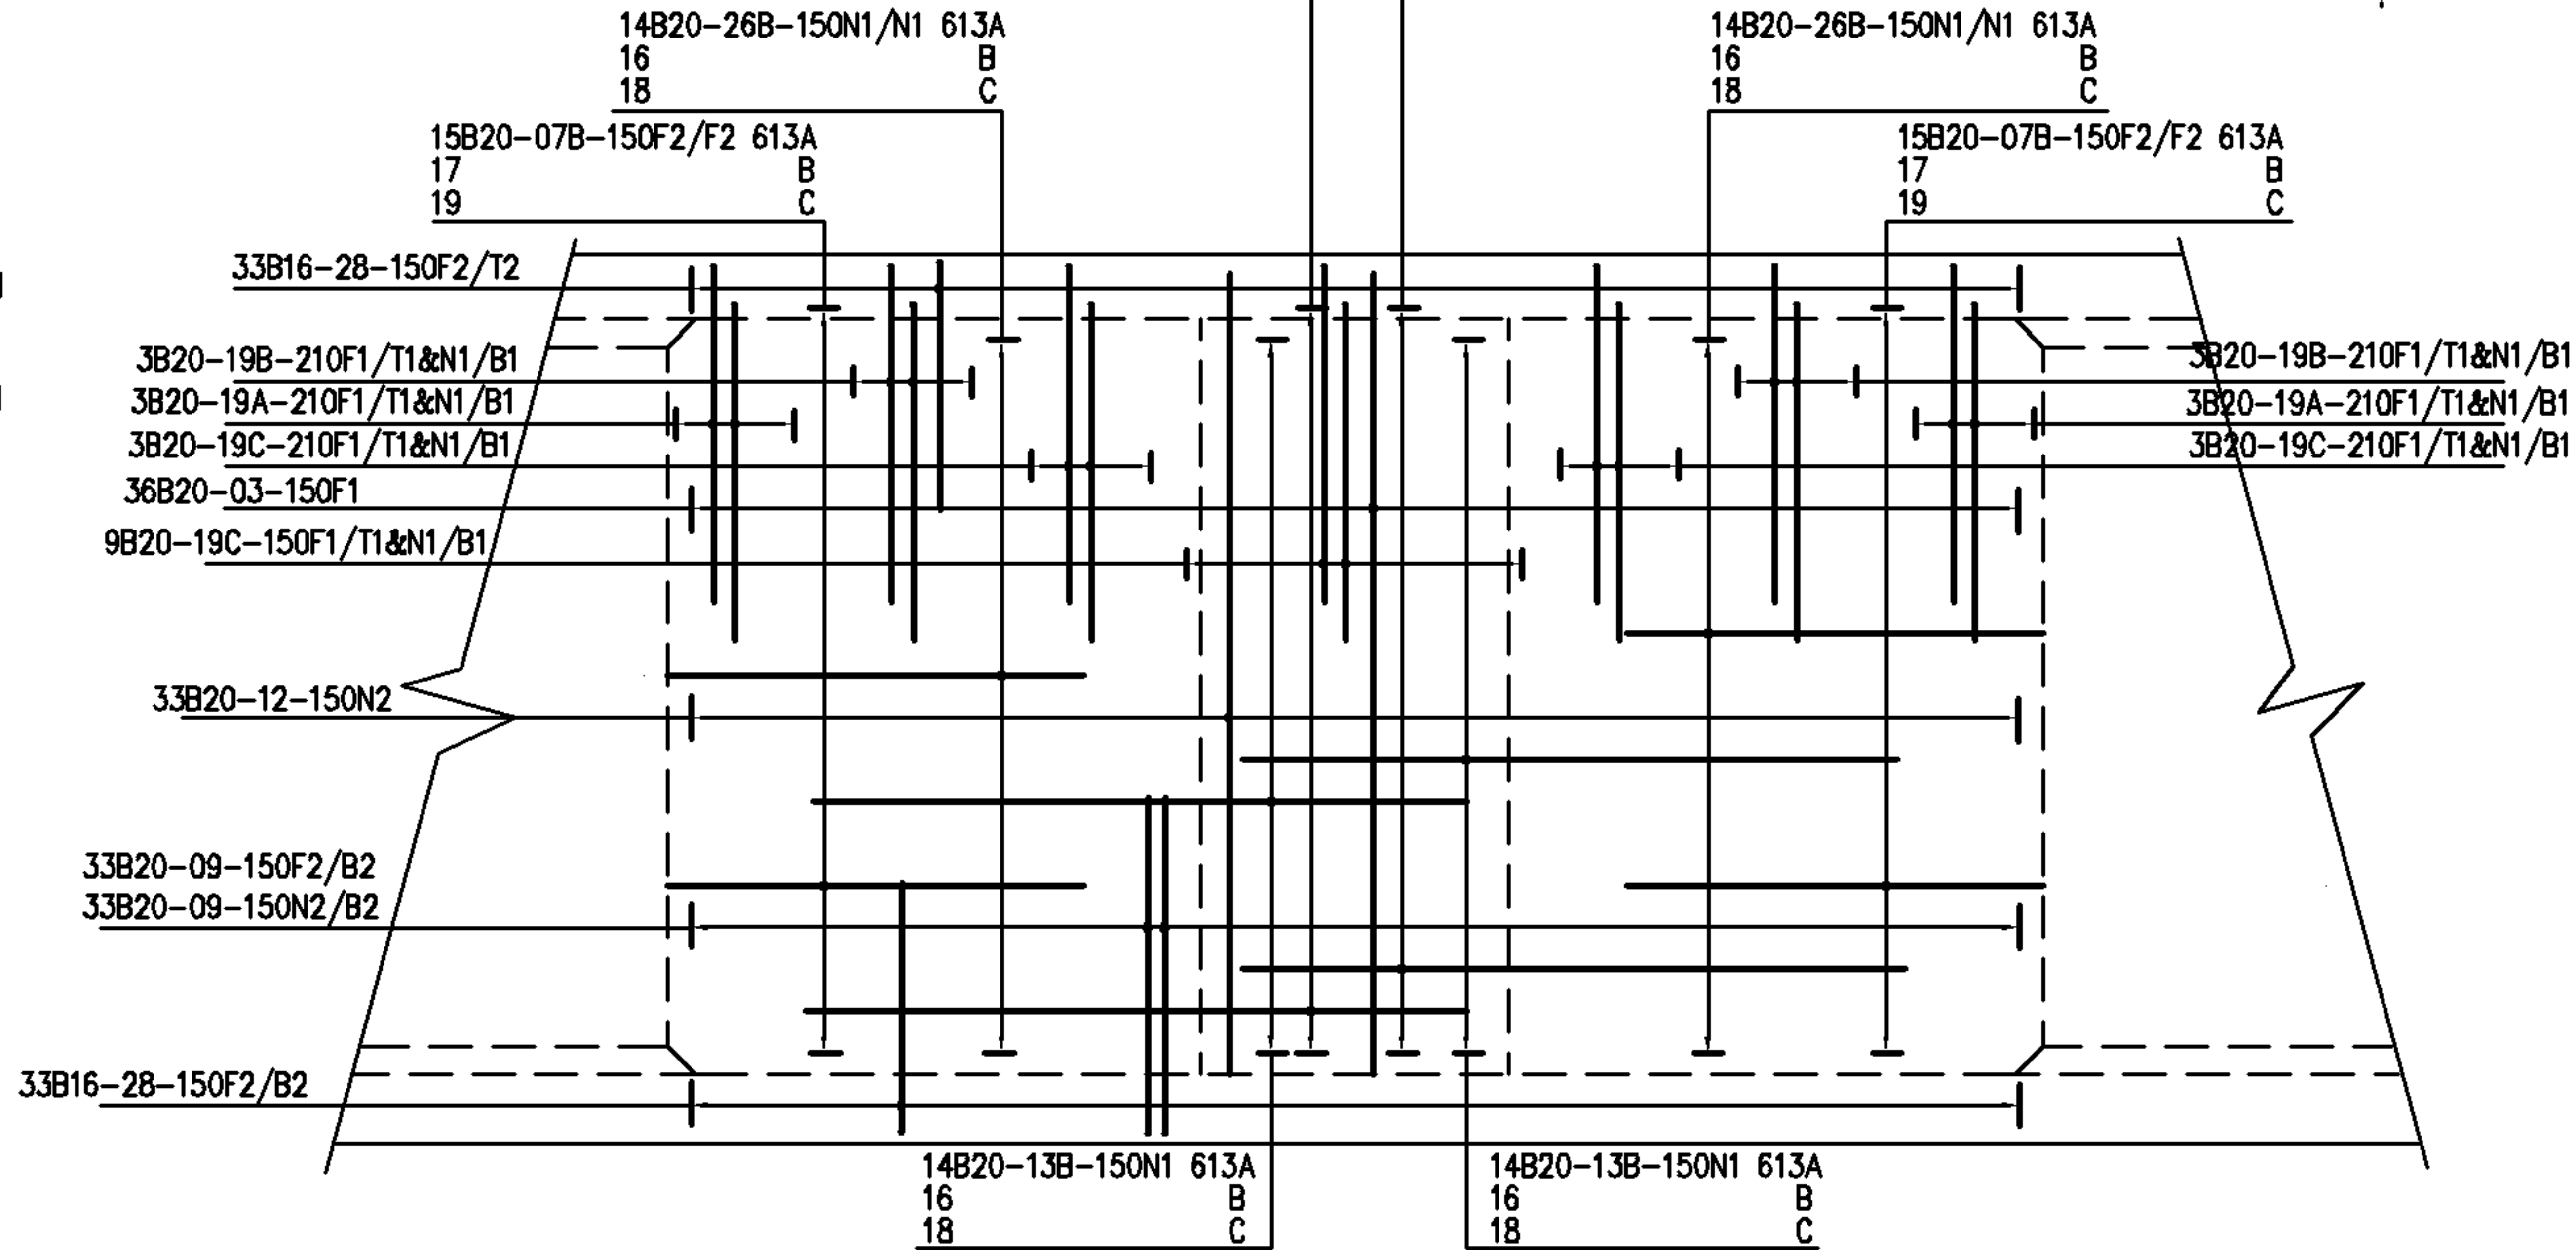

WALL C  
(SIDE WALL)

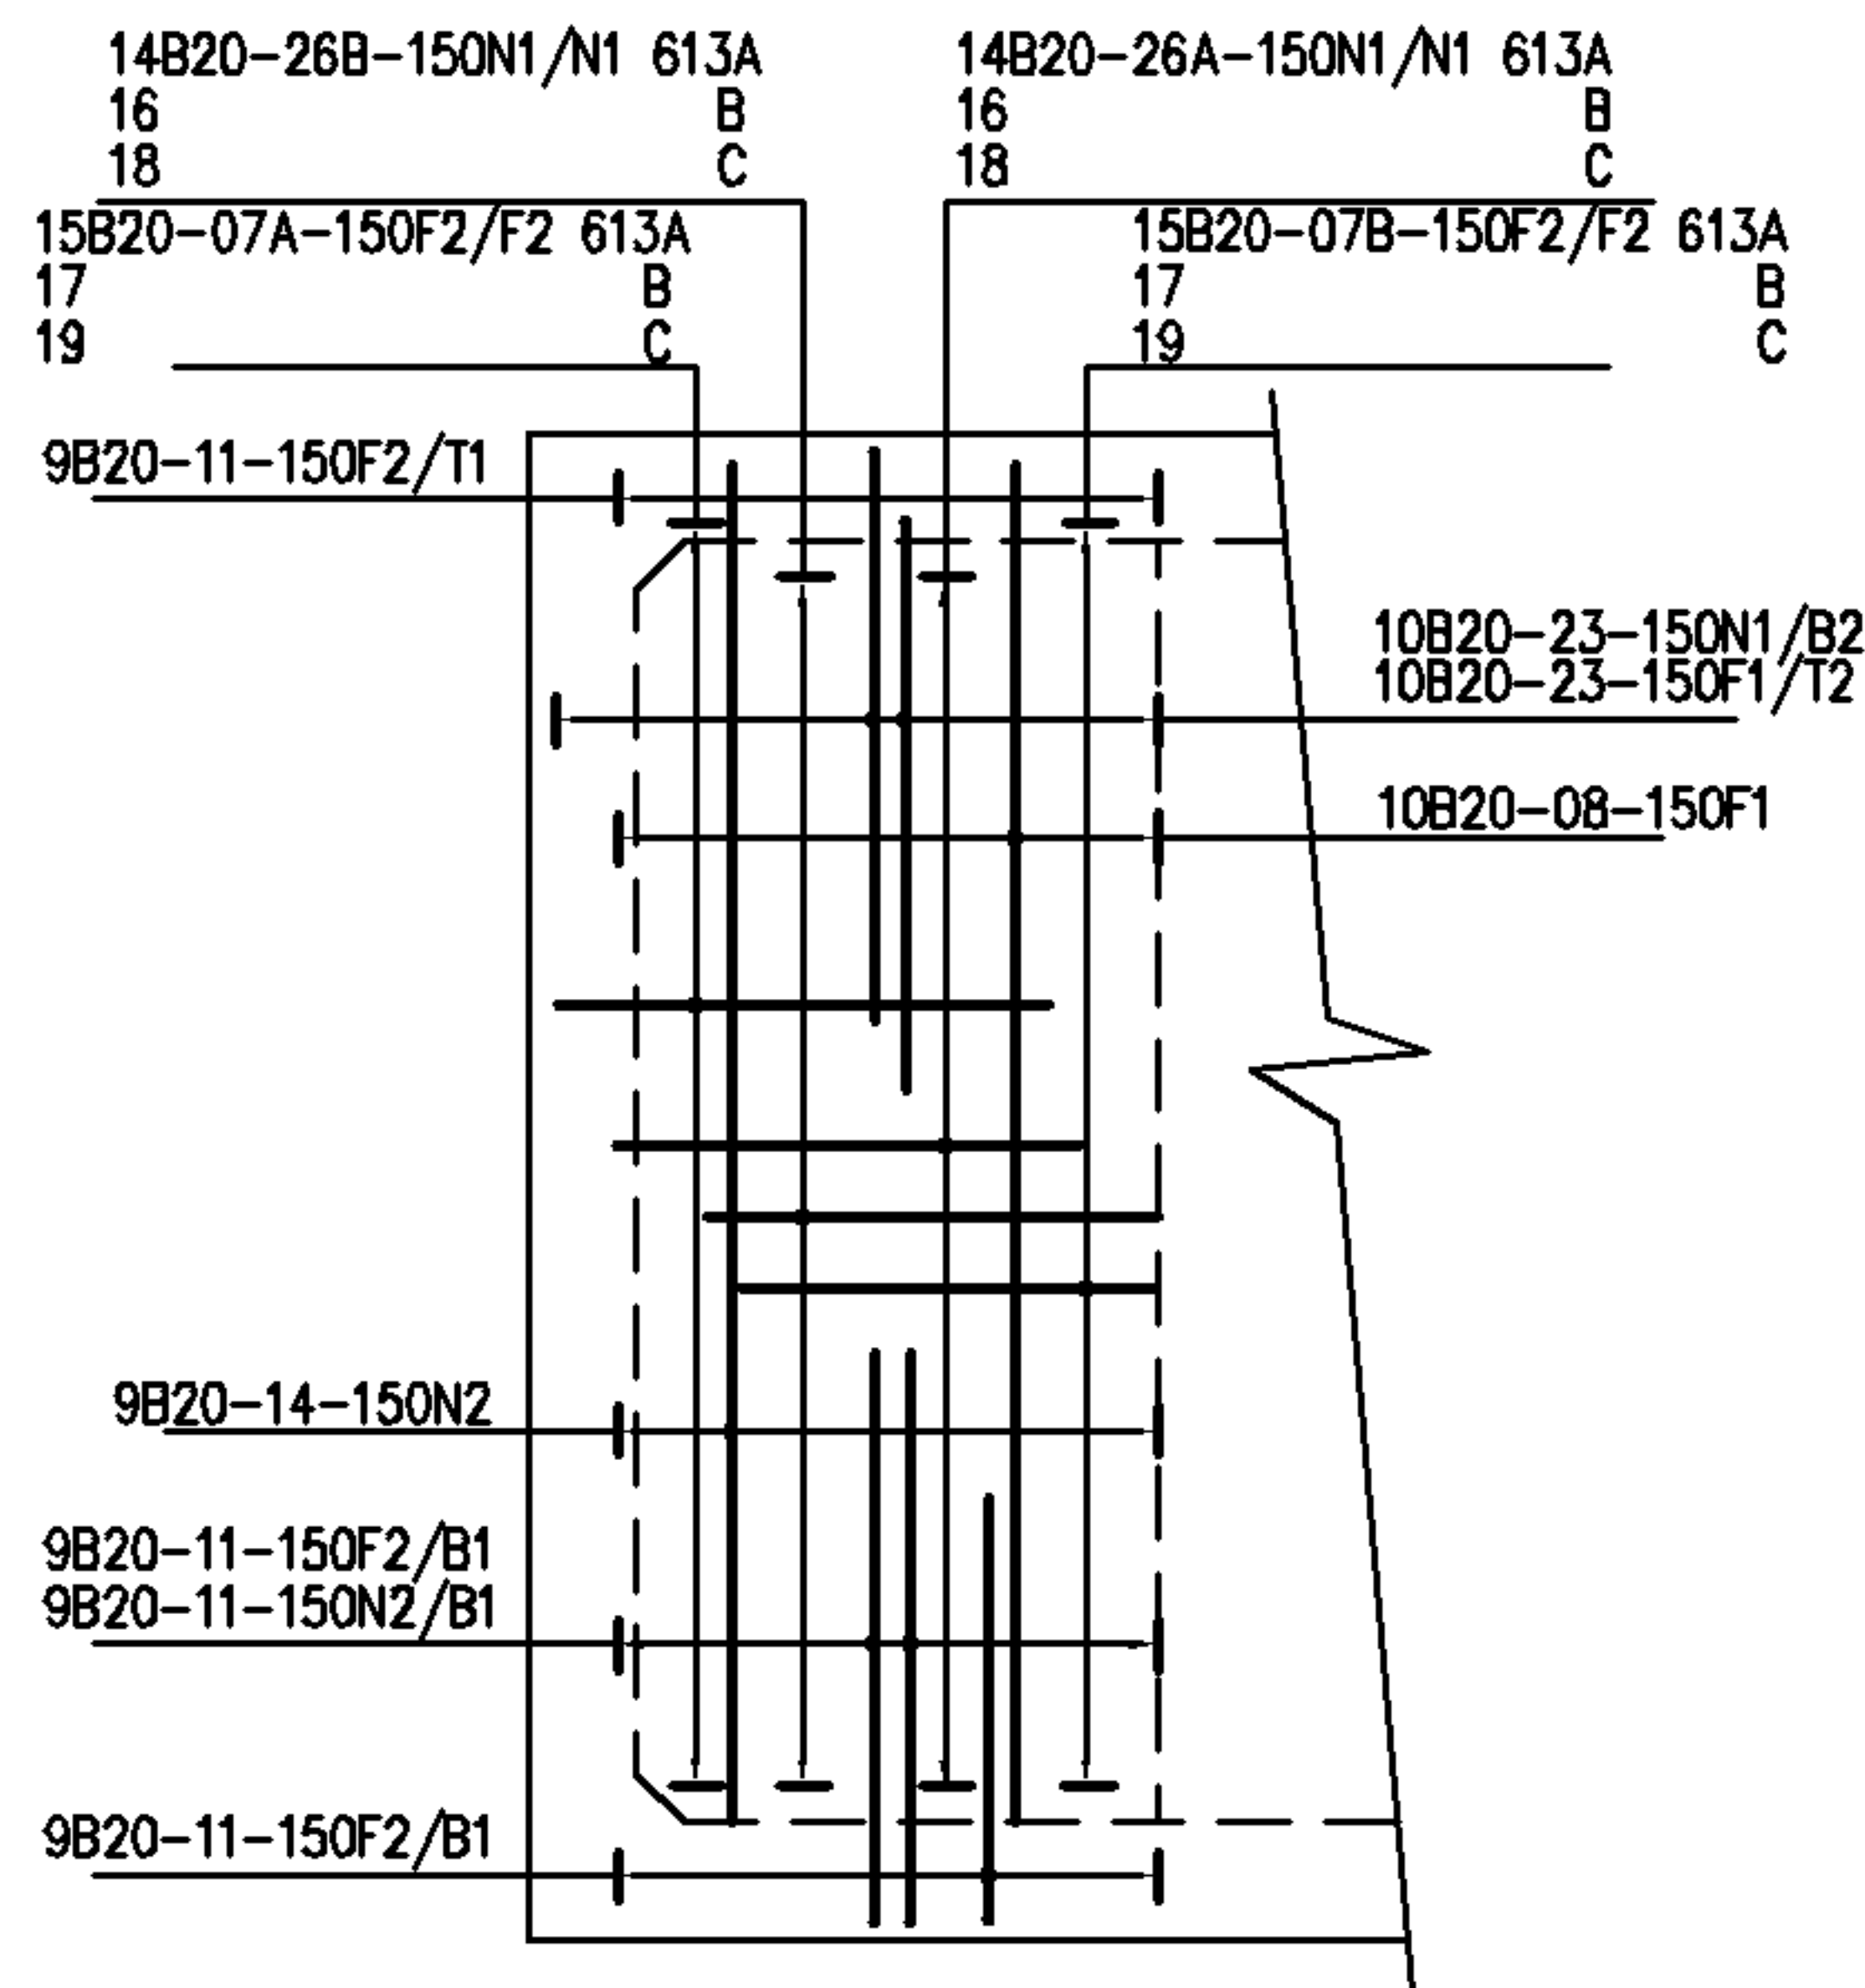

WALLS B & D  
(END WALLS)

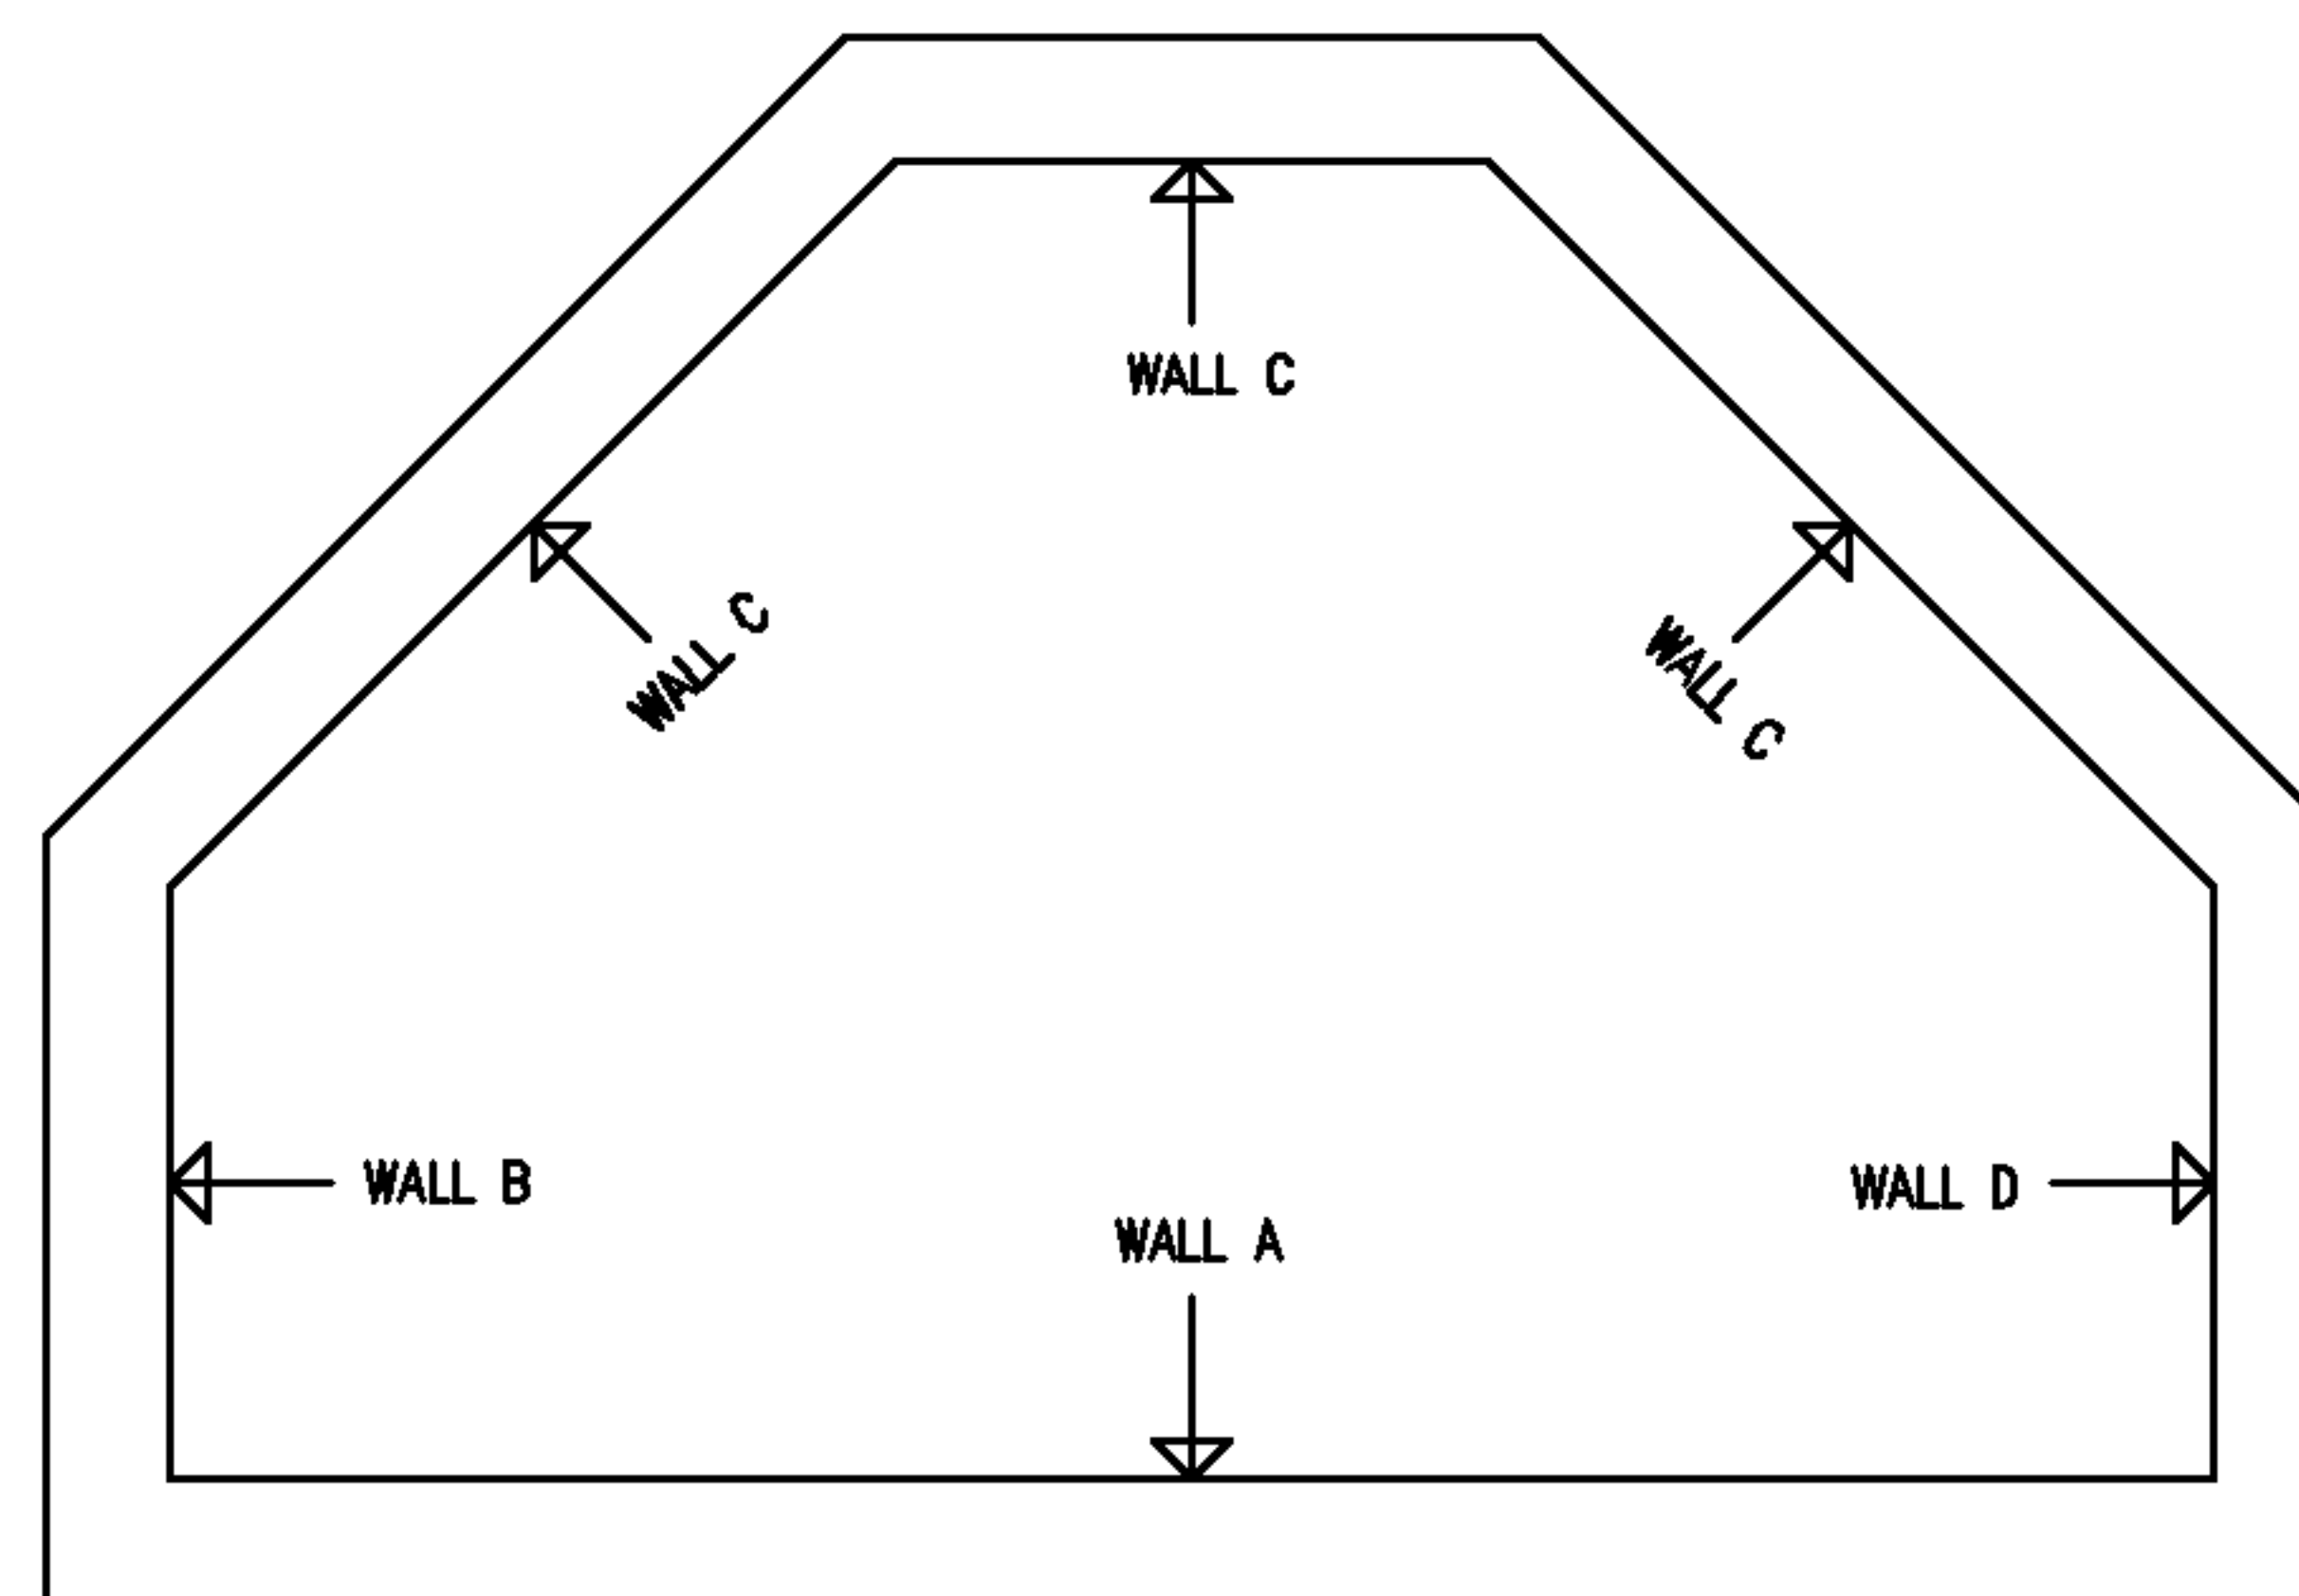

PLAN

NOTES

1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS, DOCUMENTATION AND SPECIFICATIONS RELATING TO THIS MANHOLE STRUCTURE TYPE CONSTRUCTION
2. REINFORCEMENT TO BE GRADE B500B OR B500C CONFORMING TO BS4449: 2005 (REFER CLAUSE 1712 SHW).
3. BAR SCHEDULE AND BENDING TO CONFORM TO BS8666.
4. MINIMUM COVER 55mm TO ANY CONCRETE FACE PROPRIETARY APPROVED SPACERS TO BE UTILISED.
5. BARS INTERSECTING HOLES TO BE CUT ON SITE AND TRIMMED TO CN13916
6. ADDITIONAL BARS MAY BE UTILISED TO TIE / SUPPORT MAIN BARS AS REQUIRED.
7. MAX BAR SPACING TO BE 150mm.

MANHOLE DRAWN TO 'C' SIZE

DIMENSIONS IN mm UNLESS OTHERWISE STATED

© British Telecommunications plc 1994

DO NOT SCALE

ORIGINAL SCALE 1:20

A1 A2	DRN RFG C S CKD M.S.	ANY MODIFICATION TO THE DRAWING OR THE USE OF ALTERNATIVE ITEMS TO THOSE SPECIFIED MUST BE AGREED WITH THE DESIGNER.	MATERIAL -	OMS Drawing Review Drawing number amended to 03 of 08	E	TOLERANCES TO SPECS BS8666, BS5606, BS EN1992 CN15456.	STANDARD MANHOLE MRX613A,613B,613C WALL REINFORCEMENT	REFERENCES SPECS: BS8666, BS EN1992 DRGS: CN15456.
	CERTIFICATION DESIGNER M DA RIOS CLIENT M DA RIOS		FINISH -			VARIOUS LOCATIONS		
	DATE 04/07/94					BT OMS 23.08.15		AMENDMENT