



SECTION A-A

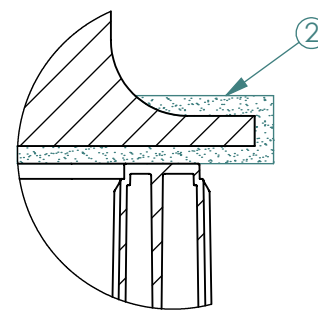

DETAIL C

1. MINIMUM 10MM UNDER FLANGE
2. MINIMUM 10MM OVER FLANGE
3. MINIMUM 50MM WIDER THAN FLANGE

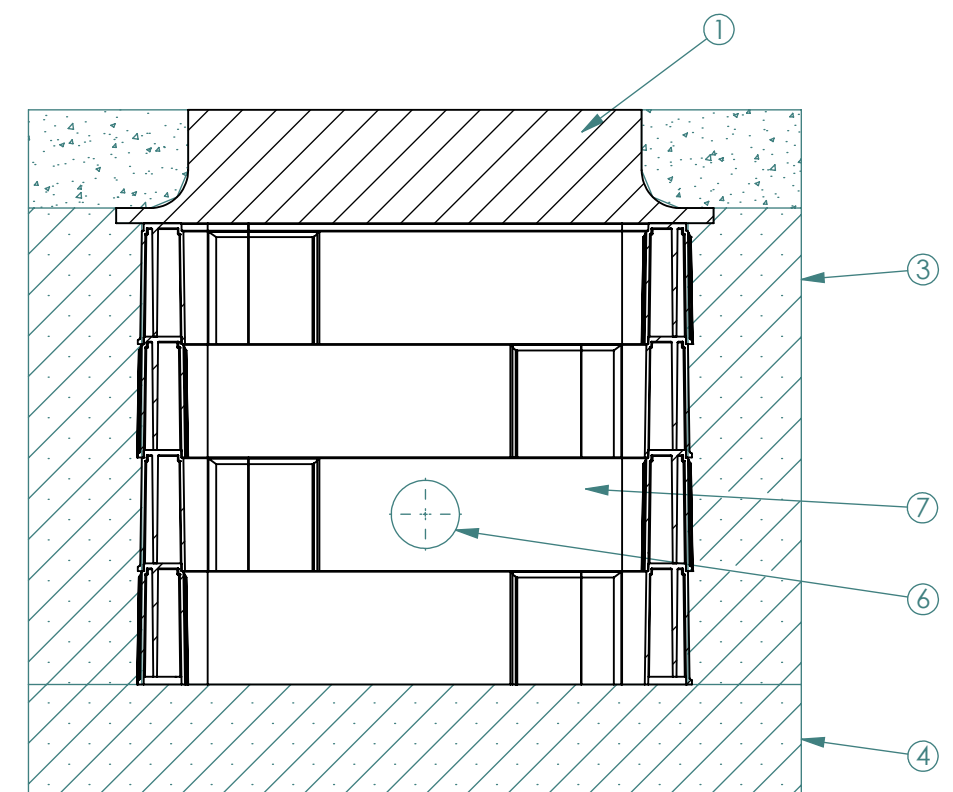

SECTION B-B

Notes.

1. MINIMUM COVER TO CROWN OF DUCTS TO BE 450MM
2. BEDDING MORTAR TO COMPLY WITH HA 104/09
3. BASE TO BE COMPACTED DRY LEAN MIX CONCRETE
4. BOTTOM CHAMBER SECTION TO BE SET 20MM INTO FLOOR