


1. All measurements in millimetres.
2. Reinstatement to comply with the requirements of the NRSWA (subject to category)
3. All duct to be Green and supplied and approved by Virgin Media.
4. Swept Tee's must always be installed on the uppermost duct line closest to the property.
5. A minimum clearance of 25mm must be left between all Duct routes and edge of trench and base of backfill. Any deviation must be approved in advance with the Virgin Media Delivery Engineer.

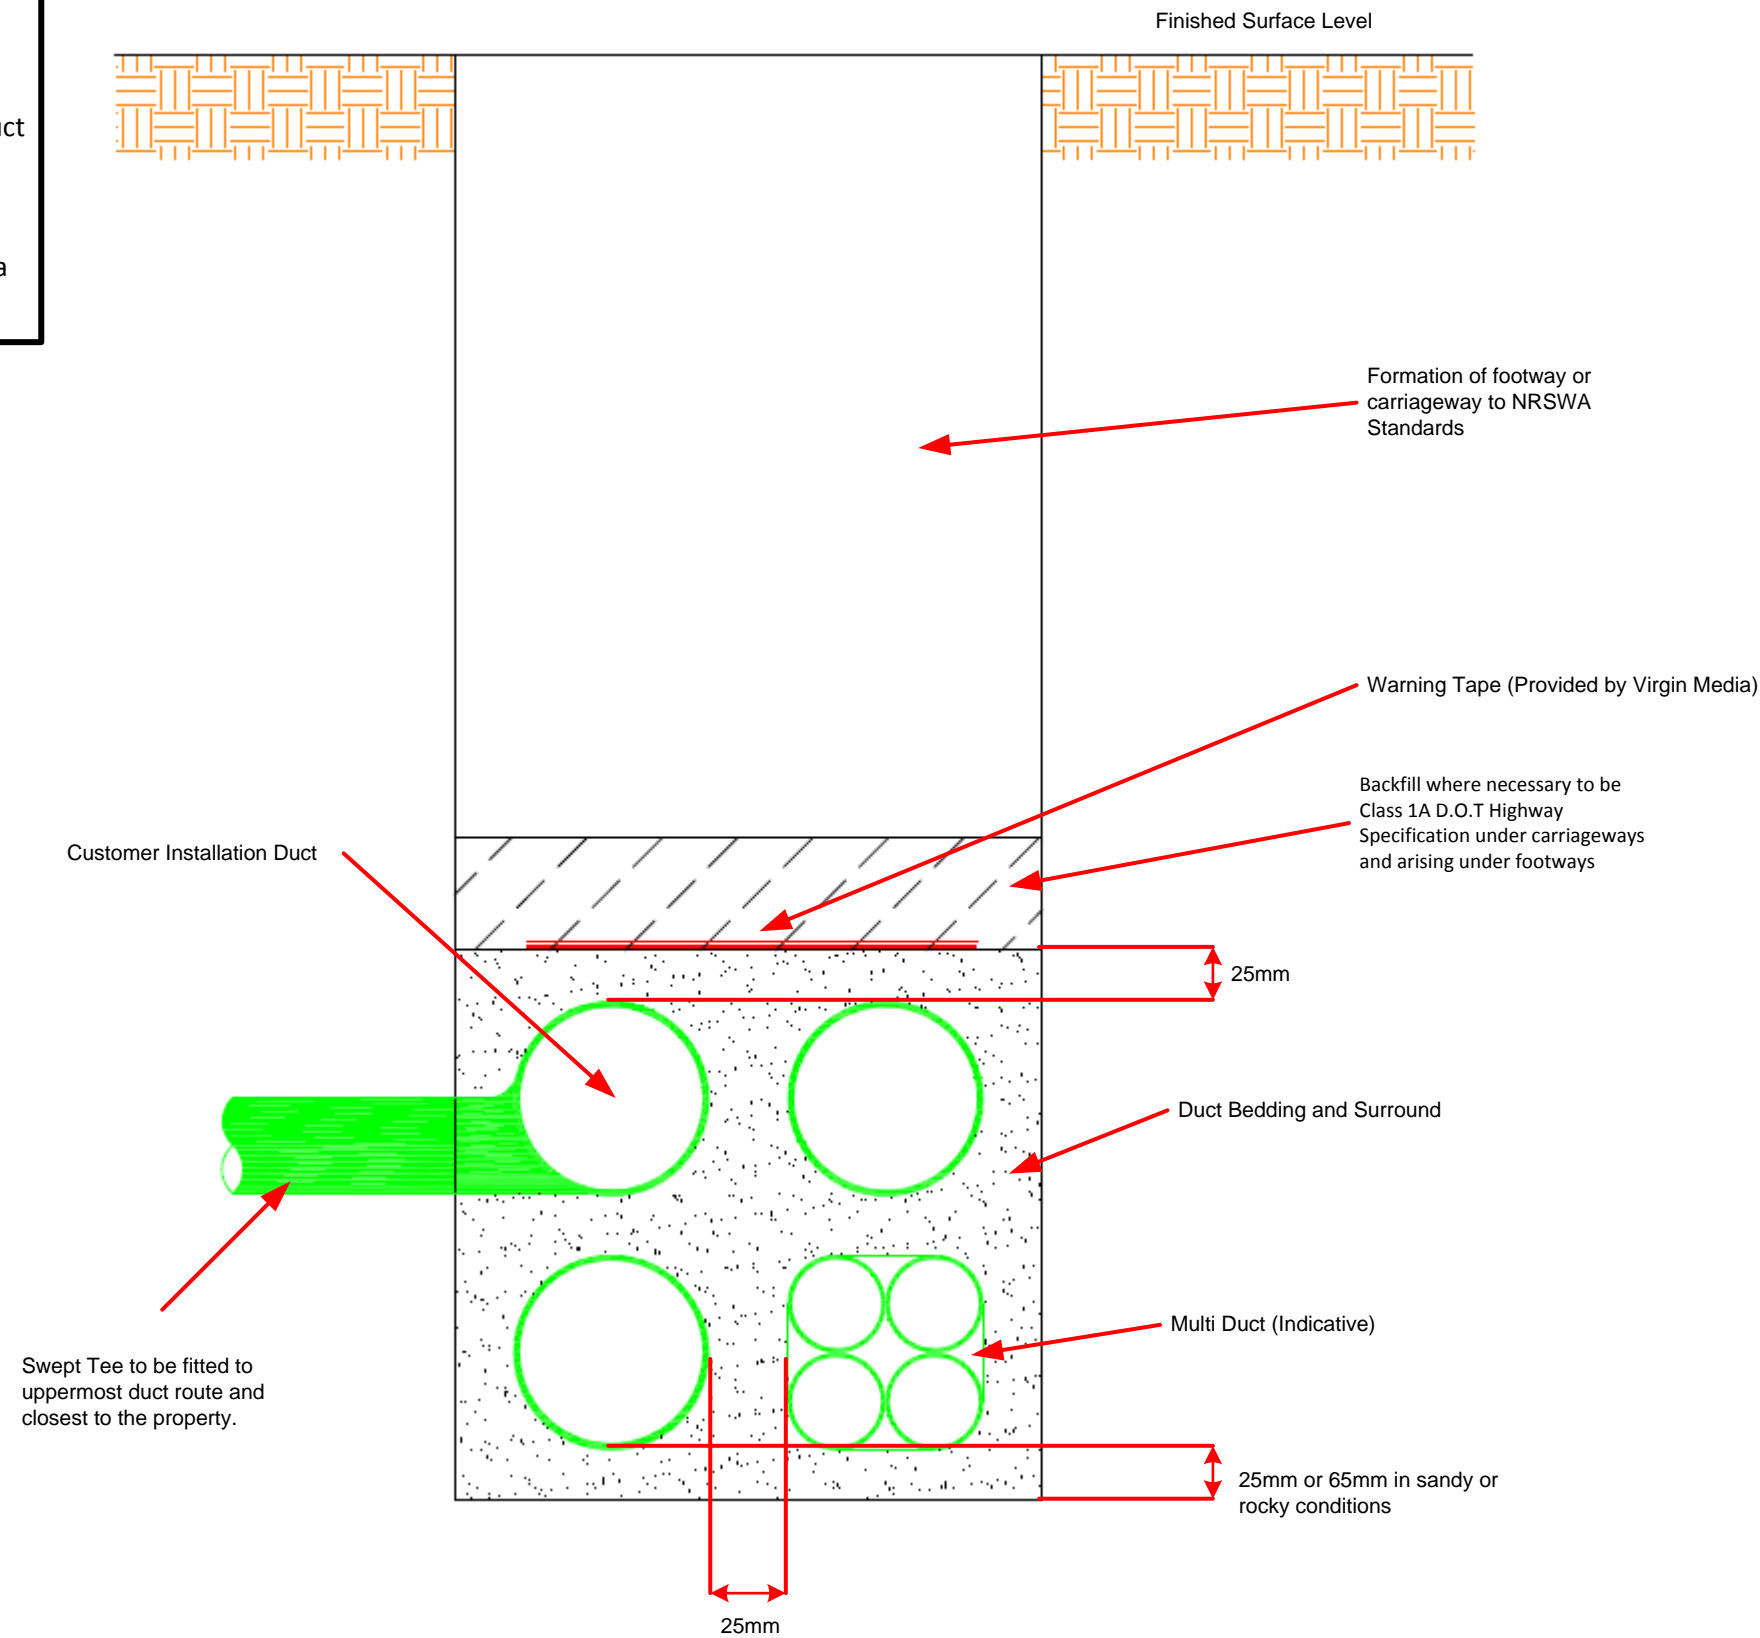

VMTD0017d

Version 1.1 Updated 23/02/14

Created By Stephen Scott

Authorised by Statutory and Standards

Drawing owned and maintained by Virgin Media Technical Drawings. For any queries or feedback please contact...

TechnicalDrawings@virginmedia.co.uk

Typical Layout of Ducts in Trenches

© 2014 Virgin Media Ltd. All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means (Electronic, Mechanical, Photocopying, Recording or otherwise) without the prior written expressed consent of the Company.