


PLAN


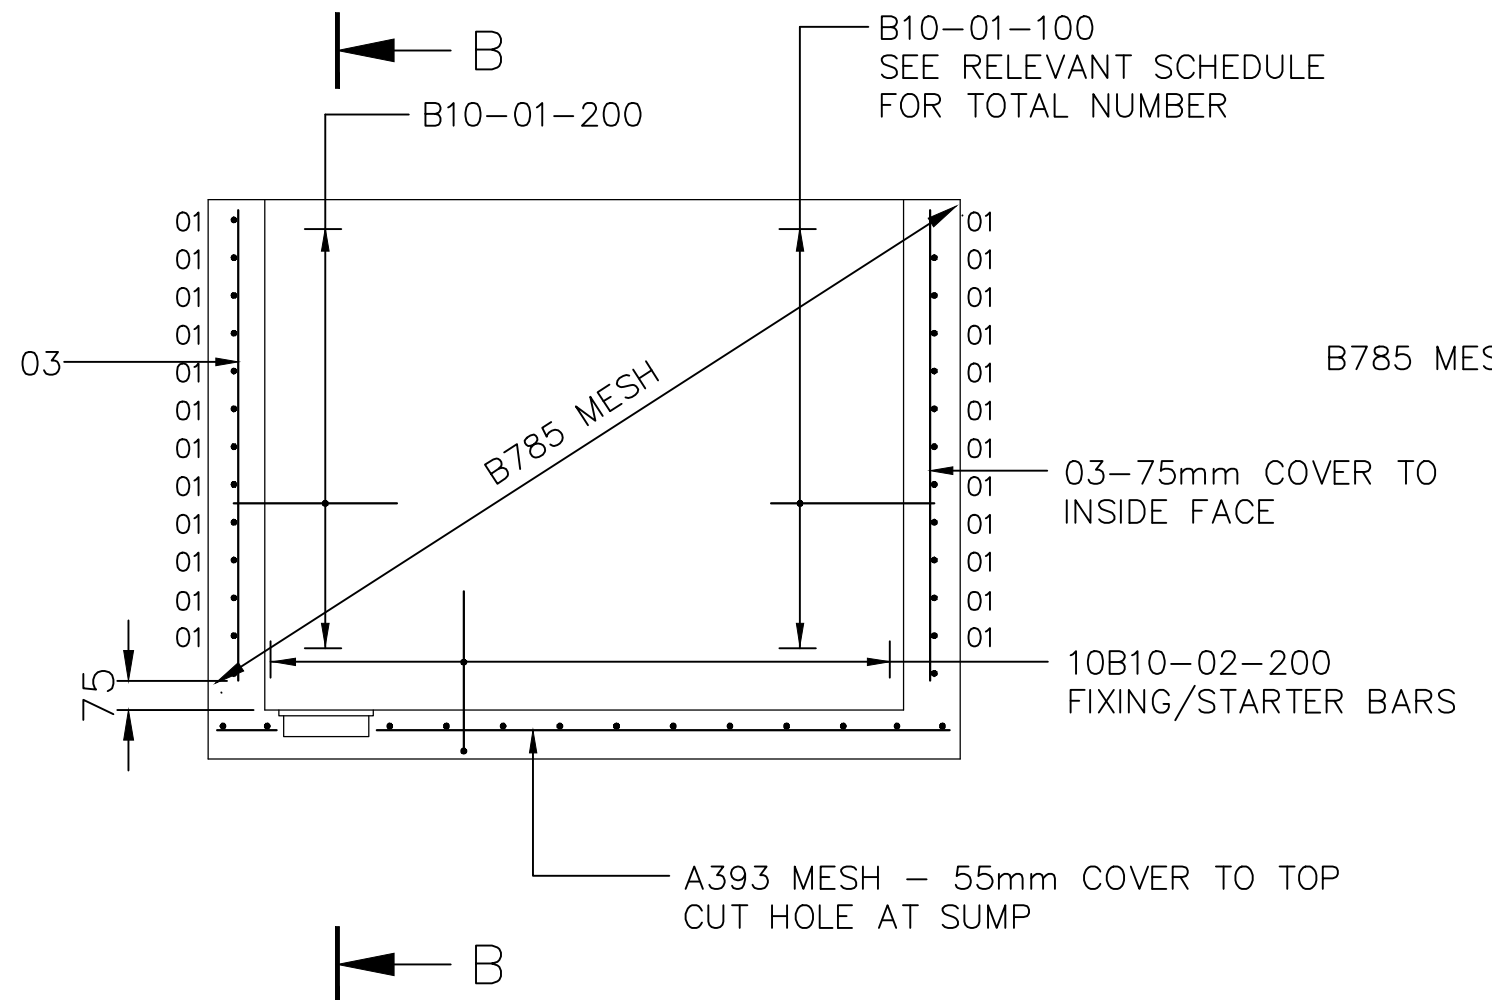


SECTION A-A

NOTES

- CONCRETE TO BE GRADE C35/45 WITH A WATER CEMENT RATIO 0.4. MIN. CEMENT CONTENT 380kg/m³. AGGREGATE MAX. SIZE 20mm. ALL IN ACCORDANCE WITH BS8500 (BS EN206).
- REINFORCEMENT TO BE GRADE B500B OR B500C CONFORMING TO BS4449.
- BAR SCHEDULE AND BENDING TO CONFORM TO BS8666.
- COVER TO BE 55mm MIN. PROPRIETARY SPACERS TO BE UTILISED.
- REINFORCEMENT MAY BE REPOSITIONED SLIGHTLY TO CLEAR DUCTS WHEN NECESSARY.
- BARS INTERSECTING HOLES SHOULD BE CUT ON SITE AND HOLES TRIMMED. SEE CN 13916

BAR NOTATION

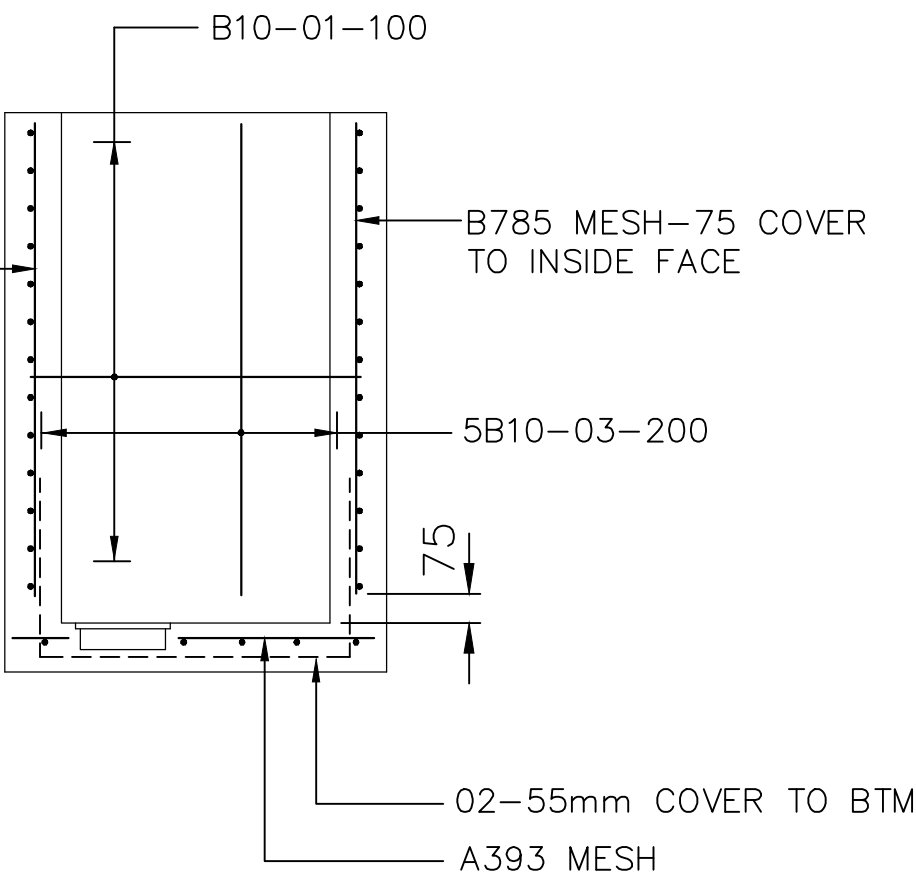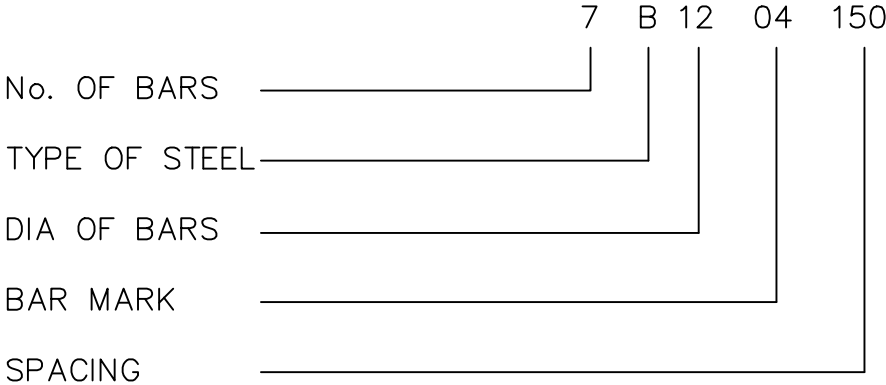

SECTION B-B

BAR SCHEDULE

BAR MARK	TYPE & SIZE	BAR LENGTH	SHAPE CODE	QTY	A	B	C	D
JRF 111 A								
01	B10	1775	21	20	450	900		
02	B10	1825	21	10	485	880		
03	B10	925	00	10	925			
A 393 MESH -1 SHEET - 1925x950								
B 785 MESH -2 SHEETS - 1650x930								
JRF 111 B								
01	B10	1775	21	22	450	900		
02	B10	1825	21	10	485	880		
03	B10	1075	00	10	1075			
A 393 MESH -1 SHEET-1925x950								
B 785 MESH -2 SHEETS-1650x1080								
JRF 111 C								
01	B10	1775	21	26	450	900		
02	B10	1825	21	10	485	880		
03	B10	1225	00	10	1225			
A 393 MESH -1 SHEET-1925x950								
B 785 MESH -2 SHEETS-1650x1230								
JRF 111 D								
01	B10	1775	21	30	450	900		
02	B10	1825	21	10	485	880		
03	B10	1375	00	10	1375			
A 393 MESH -1 SHEET-1925x950								
B 785 MESH -2 SHEETS-1650x1380								

ANY MODIFICATION TO THE DRAWING OR THE USE OF ALTERNATIVE ITEMS TO THOSE SPECIFIED MUST BE AGREED WITH THE DESIGNER.

DIMENSIONS IN mm UNLESS OTHERWISE STATED

© British Telecommunications plc 1994

DO NOT SCALE

ORIGINAL SCALE 1:20

A2 A3	DRN B.A.(PIPCO) CKD M.S.	MATERIAL -	General Drawing Review Minor drafting mods	N		JOINT BOX FOOTWAY JRF 111 A,B,C & D	REFERENCES SPEC LN 550 CN15562
	CERTIFICATION DESIGNER J.VERONA	FINISH -					
	CLIENT MAZZ DARIOS		BT	T&S Design 11.07.19			
DATE 27/07/97			AMENDMENT		ISSUE	Openreach	ALA944
						CN 14983	SHT 02 OF 03

CN14983S02