

THIRD ANGLE PROJECTION

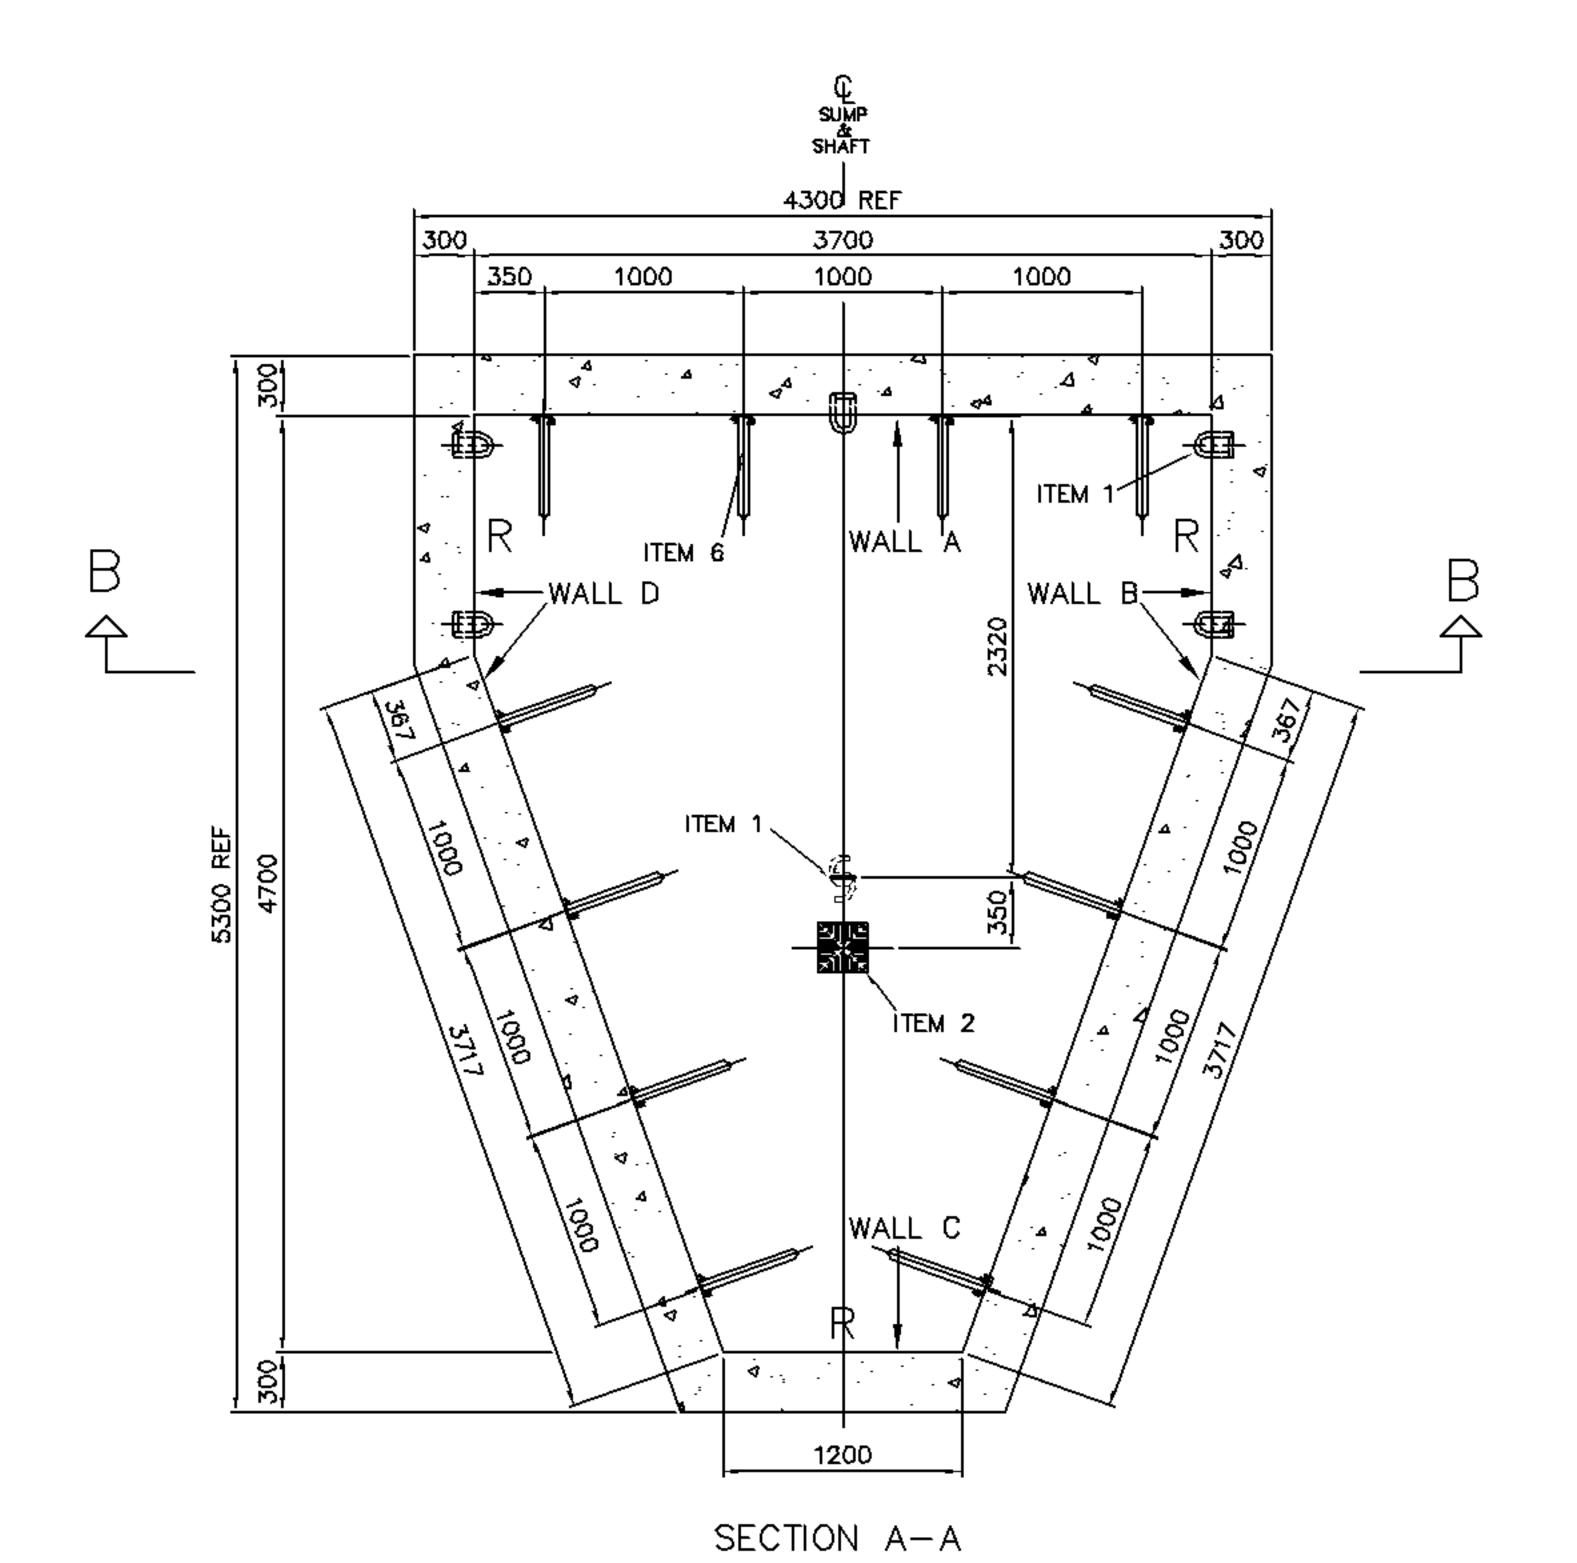


TOLERANCES: - CN15456
ANCHOR IRON POSITION ±50mm TOP OF DEPTH PLATE ±4mm
BEDDING MATERIAL ±5 CEMENT MORTAR -20mm
BRICKWORK MORTAR JOINTS ±5mm
VOIDAGE 0.5%
DUCT ENTRY POSITION ±25mm DUCT FLUSH WITH WALL -10mm
WALL FLATNESS ±11mm
F & C LEVEL WITH HIGHWAY NIL F & C ROCKING NIL F & C SURROUND IN UNMADE ±5mm F & C UNSUPPORTED OVER BOX +5mm
MANHOLE INTERNAL LENGTH & WIDTH ±25mm
MANHOLE INTERNAL HEIGHT ±15mm
SHAFT DIMENSIONS 610mm -10mm + 15mm SHAFT POSITION IN ROOF ±100mm
STEEL BARS ALIGNMENT VERT & HORIZ ±15mm NEAR FACE TO FAR FACE ±15mm
STEEL CAGE GRID PATTERN ±10mm
STEEL DEPTH OF COVER ±5mm
STEEL DEPTH TO LUG ±5mm STEP POSITION ±15mm STEP HORIZONTAL ±5mm
SUMP POSITION ±25mm SUMP DEPTH ±10mm ROUND SUMP 2300 ±5mm
VERTICALITY OF WALLS ±15mm
SLAB THICKNESS -10 TO +150mm
BOLT FOUNDATION ±5mm

SCHEDULE					
ITEM	DESCRIP.	DRWG. NO.	NO. OFF		
1	ANCHOR IRON NO. 4		CN 1162	11	
2	GRATING SUMP		CN 9165	1	
3	STEPS MANHOLE NO.1		CN 1961	1	
	STEEL LADDER WITH	HOOKS			
	M'H SIZE	LENGTH			
4	613A	2250	CN 1161	1	
	613B	2550			
	613C	2850			
5	FRAME AND COVER		CN 1961	1	
6	CABLE BEARER NO.1	CN 1059	12		
7	BOLT FOUNDATION INDENTED No.2		CN 1166	24	
8	BRACKET CABLE BEARER 18		CN 1069	24	
9	PINS LOCKING CABLE	BEARER	CN 1301	24	
10	FRAME & COVER		CN15572	1	

MANHOLE HEIGHT VARIATION AND No. OF DUCTS						
TYPE	INTERNAL HEIGHT	EXTERNAL HEIGHT (REF)	No. OF DUCTS IN POSITIONS			
			R			
Α	2100	2700	64			
В	2400	3000	60			
C	2700	3300	96			

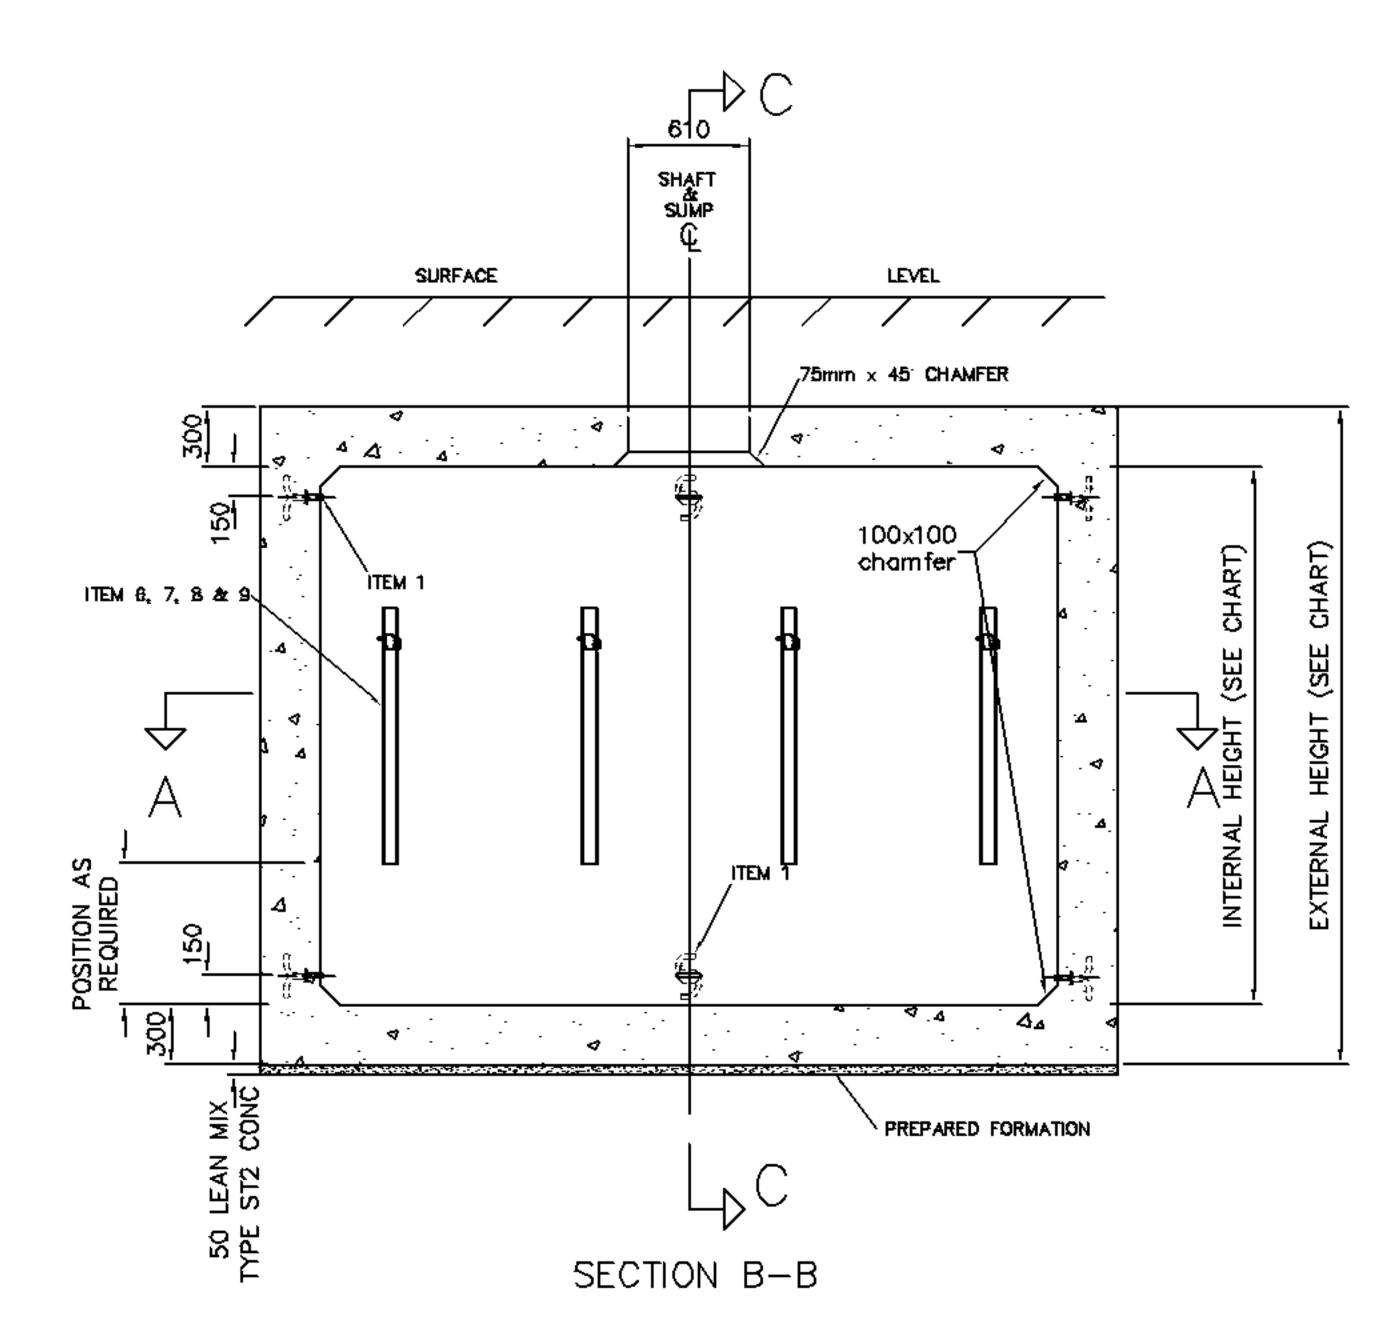

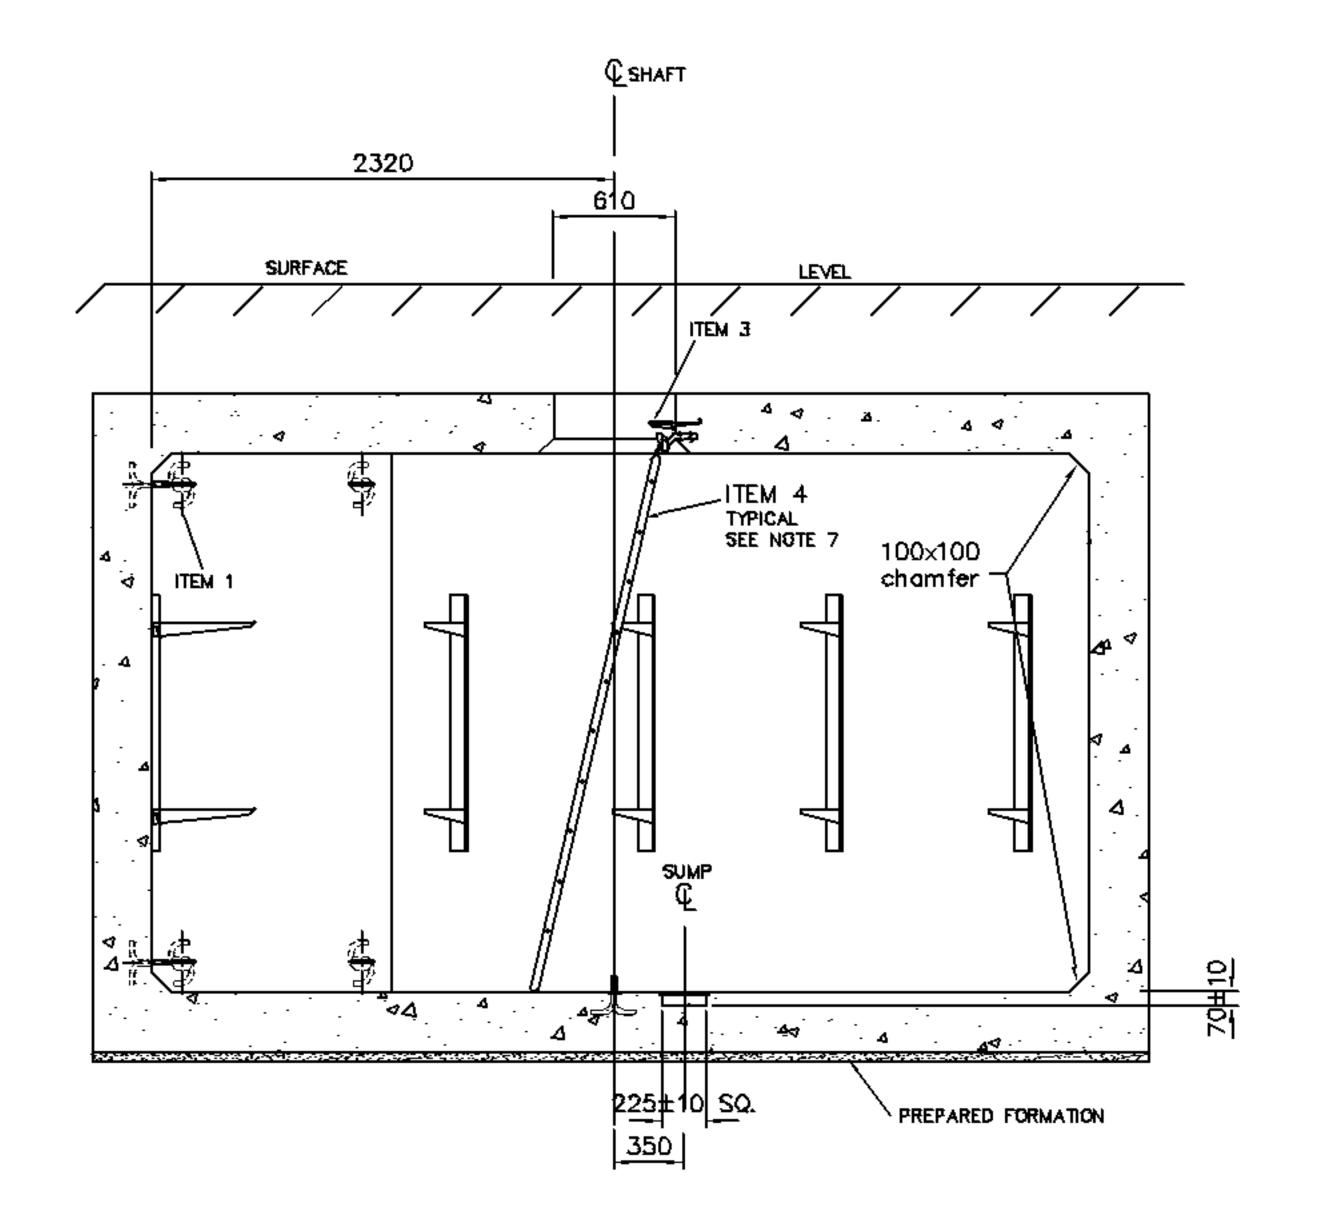

SECTION C-C

<u>NOTES</u>

- 1. THIS DRAWING TO BE READ IN CONJUNCTION WITH ALL OTHER DRAWINGS, DOCUMENTATION AND SPECIFICATIONS RELATING TO THIS MANHOLE STRUCTURE TYPE CONSTRUCTION.
- 2. WORKMANSHIP, MATERIALS AND METHOD OF CONSTRUCTION ARE TO COMPLY WITH ALL CURRENT RELEVANT CONTRACT DOCUMENTS, BRITISH STANDARDS, EUROCODES AND CODES OF PRACTICE (RELEVANT TO THE CONSTRUCTION INDUSTRY) AND ACCEPTED CONSTRUCTION PRACTICE.
- 3. ALL EXISTING SERVICES POSITIONS ARE TO BE VERIFIED ON SITE BY THE CONTRACTOR PRIOR TO STARTING THE WORKS.
- 4. ALL ACCEPTED SAFE DIGGING PRACTICES AND SAFE METHODS OF WORKING ARE TO BE EMPLOYED DURING THE INSTALLATION OF THE MANHOLE STRUCTURE.
- 5. CONCRETE TO BE GRADE C35/45 WITH A WATER CEMENT RATIO 0.4. MIN. CEMENT CONTENT 380kg/m³. AGGREGATE MAX. SIZE 20mm. ALL IN ACCORDANCE WITH BS8500 (BS EN206).
- 6. DUCT ENTRIES CAN BE PLACED IN THE WALLS IN THE POSITIONS REQUIRED WITH MINIMUM CLEARANCE OF 150mm FROM ADJACENT WALL, 450mm FROM ROOF AND 350mm FROM FLOOR.
- 7. SHAFT TO BE CONSTRUCTED IN ACCORDANCE WITH CN1153 AND POSITIONED AS REQUIRED. STEPS AND LADDER TO BE ORIENTATED TO FACE THE ONCOMING TRAFFIC. DETAILS SHOWN ARE TYPICAL POSITIONS.
- 8. ANY BRICKS USED TO FORM SHAFT OR ADJUST FRAME AND COVER LEVEL TO BE (MINIMUM) CLASS B ENGINEERING BRICKS. MORTAR TO BE 1:5 CEMENT: SAND RATIO (MAXIMUM) OR 1:1:5 CEMENT: LIME: SAND CLASS (iii).
- 9. BRICKS AND MORTAR TO BE IN ACCORDANCE WITH BS EN1996.
- 10. REINFORCEMENT TO BE GRADE B500B OR B500C CONFORMING TO BS4449: 2005 (CLAUSE 1712 SHW).
- 11. BAR SCHEDULE AND BENDING TO CONFORM TO BS8666.
- 12. MINIMUM COVER 55mm TO ANY CONCRETE FACE PROPRIETARY APPROVED SPACERS TO BE UTILISED.
- 13. BARS INTERSECTING HOLES TO BE CUT ON SITE AND TRIMMED TO CN13916.
- 14. ADDITIONAL BARS MAY BE UTILISED TO TIE / SUPPORT MAIN BARS AS REQUIRED.
- 15. MAXIMUM SPACING OF REINFORCING BARS TO BE 150mm C/C.
- 16. SUMP TO BE POSITIONED BELOW SHAFT. TYPICAL POSITION SHOWN.
- 17. ANCHOR IRONS MUST BE POSITIONED AT LEAST 230mm FROM ANY DUCT OR WALL OPENING. ANCHOR IRONS MUST BE POSITIONED 150mm FROM ANY WALL, ROOF OR FLOOR. FLOOR ANCHOR IRONS SHOULD BE PLACED BELOW SHAFT.
- 18. STANDARD DEPTHS OF COVER TO THE TOP OF THE ROOF
- 150mm F00TWAY
- 450mm CARRIAGEWAY
- 19. ALL WORKS TO BE UNDERTAKEN IN ACCORDANCE WITH THE SPECIFICATION FOR HIGHWAY WORKS (SHW) 1998 AND ALL SUBSEQUENT AMENDMENTS.
- 20. ALL BACKFILL MATERIAL IS TO BE CLASS 6N TYPE.
- 21. ALL CONSTRUCTION JOINTS TO BE AS PER CLAUSE 1710 SHW.
- 22. INTERNAL CORNER CHAMFER DETAILS TO BE AS PER APPENDIX D OF BD 31/01 THE DESIGN OF BURIED CONCRETE BOX AND PORTAL FRAME STRUCTURES.
- 23. CONTRACTOR TO PROVIDE A GENERAL ARRANGEMENT DRAWING SHOWING THE POSITION OF THE STRUCTURE IN RELATION TO THE HIGHWAY AND ITS FEATURES, INCLUDING RELATIVE LEVELS TO HIGHWAY SURFACE.
- 24. CONTRACTOR TO PROVIDE DETAILS; NUMBER AND POSITION OF DUCT ENTRY OPENINGS WITHIN THE CHAMBER.
- 25. CONTRACTOR TO PROVIDE PROGRAMME OF CONSTRUCTION SEQUENCE DETAILING TIMING OF POURS AND COMMENCEMENT OF BACKFILL.
- 26. CONCRETE TESTING TO BE UNDERTAKEN IN ACCORDANCE WITH BT SPECIFICATION.

MANHOLE DRAWN TO 'C' SIZE

© British Telecommunications pls 1994 DO NOT SCALE ORIGINAL SCALE 1:20 DIMENSIONS IN mm UNLESS OTHERWISE STATED STANDARD ANY MODIFICATION TO THE DRAWING OR THE USE OF ALTERNATIVE ITEMS TO THOSE SPECIFIED MUST BE AGREED WITH THE DESIGNER. TOLERANCES TO SPECS BS8666, BS5606, BS EN1992 REFERENCES SPEC: BS4449,BS8668, BS5606,BS EN1992,LN550. OMS Drawing Review Hatching added DRN RFG C S A 1 CKD M.S.

CERTIFICATION
DESIGNER
M DA RIOS
CLIENT MANHOLE MRX610A.610B,610C DRGS: CN1059, CN1153, CN1161, CN1162, CN1166, CN1961, CN1166, CN1961, GENERAL ARRANGEMENT VARIOUS LOCATIONS SPECS: BS8500, BS EN206 24.08.15 M DA RIOS CMS CN 14946 SHT 01 OF 08 ISSUE Openreach DATE 04/07/94 AMENDMENT