


3-BENDS DUCT
No.54A

CONCRETE FOUNDATION



BENDS MAYBE SET LOWER TO AVOID
OBSTRUCTIONS AS INDICATED BY
CHAINDOT - - - - - OUTLINE.

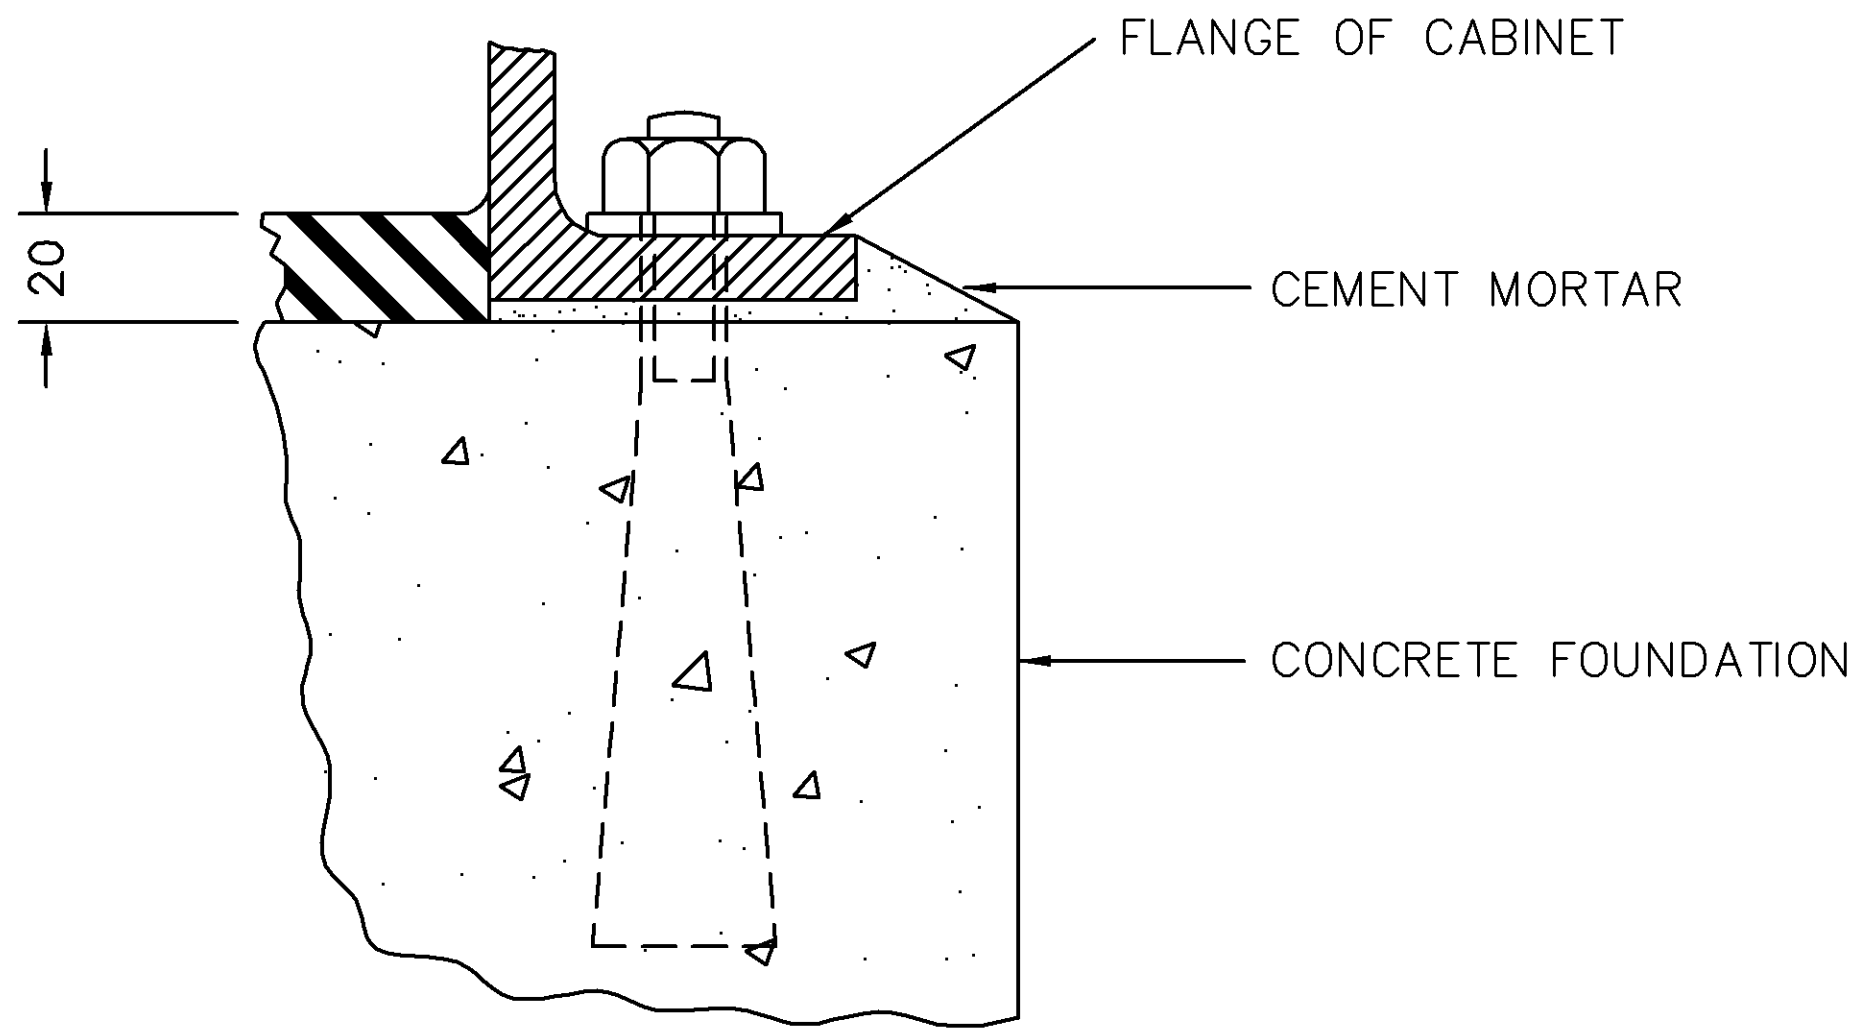

NOTES: -

1. CONCRETE TABLE MINIMUM C32/40.
2. RESIN PACK 6B BEFORE POURING IN,
THE INTERNAL SURFACE OF THE CABINET BASE
MUST BE CLEANED.
3. POUR RESIN PACK 6B TO A DEPTH OF 20mm.

METHOD OF FIXING CABINET
TO CONCRETE FOUNDATION

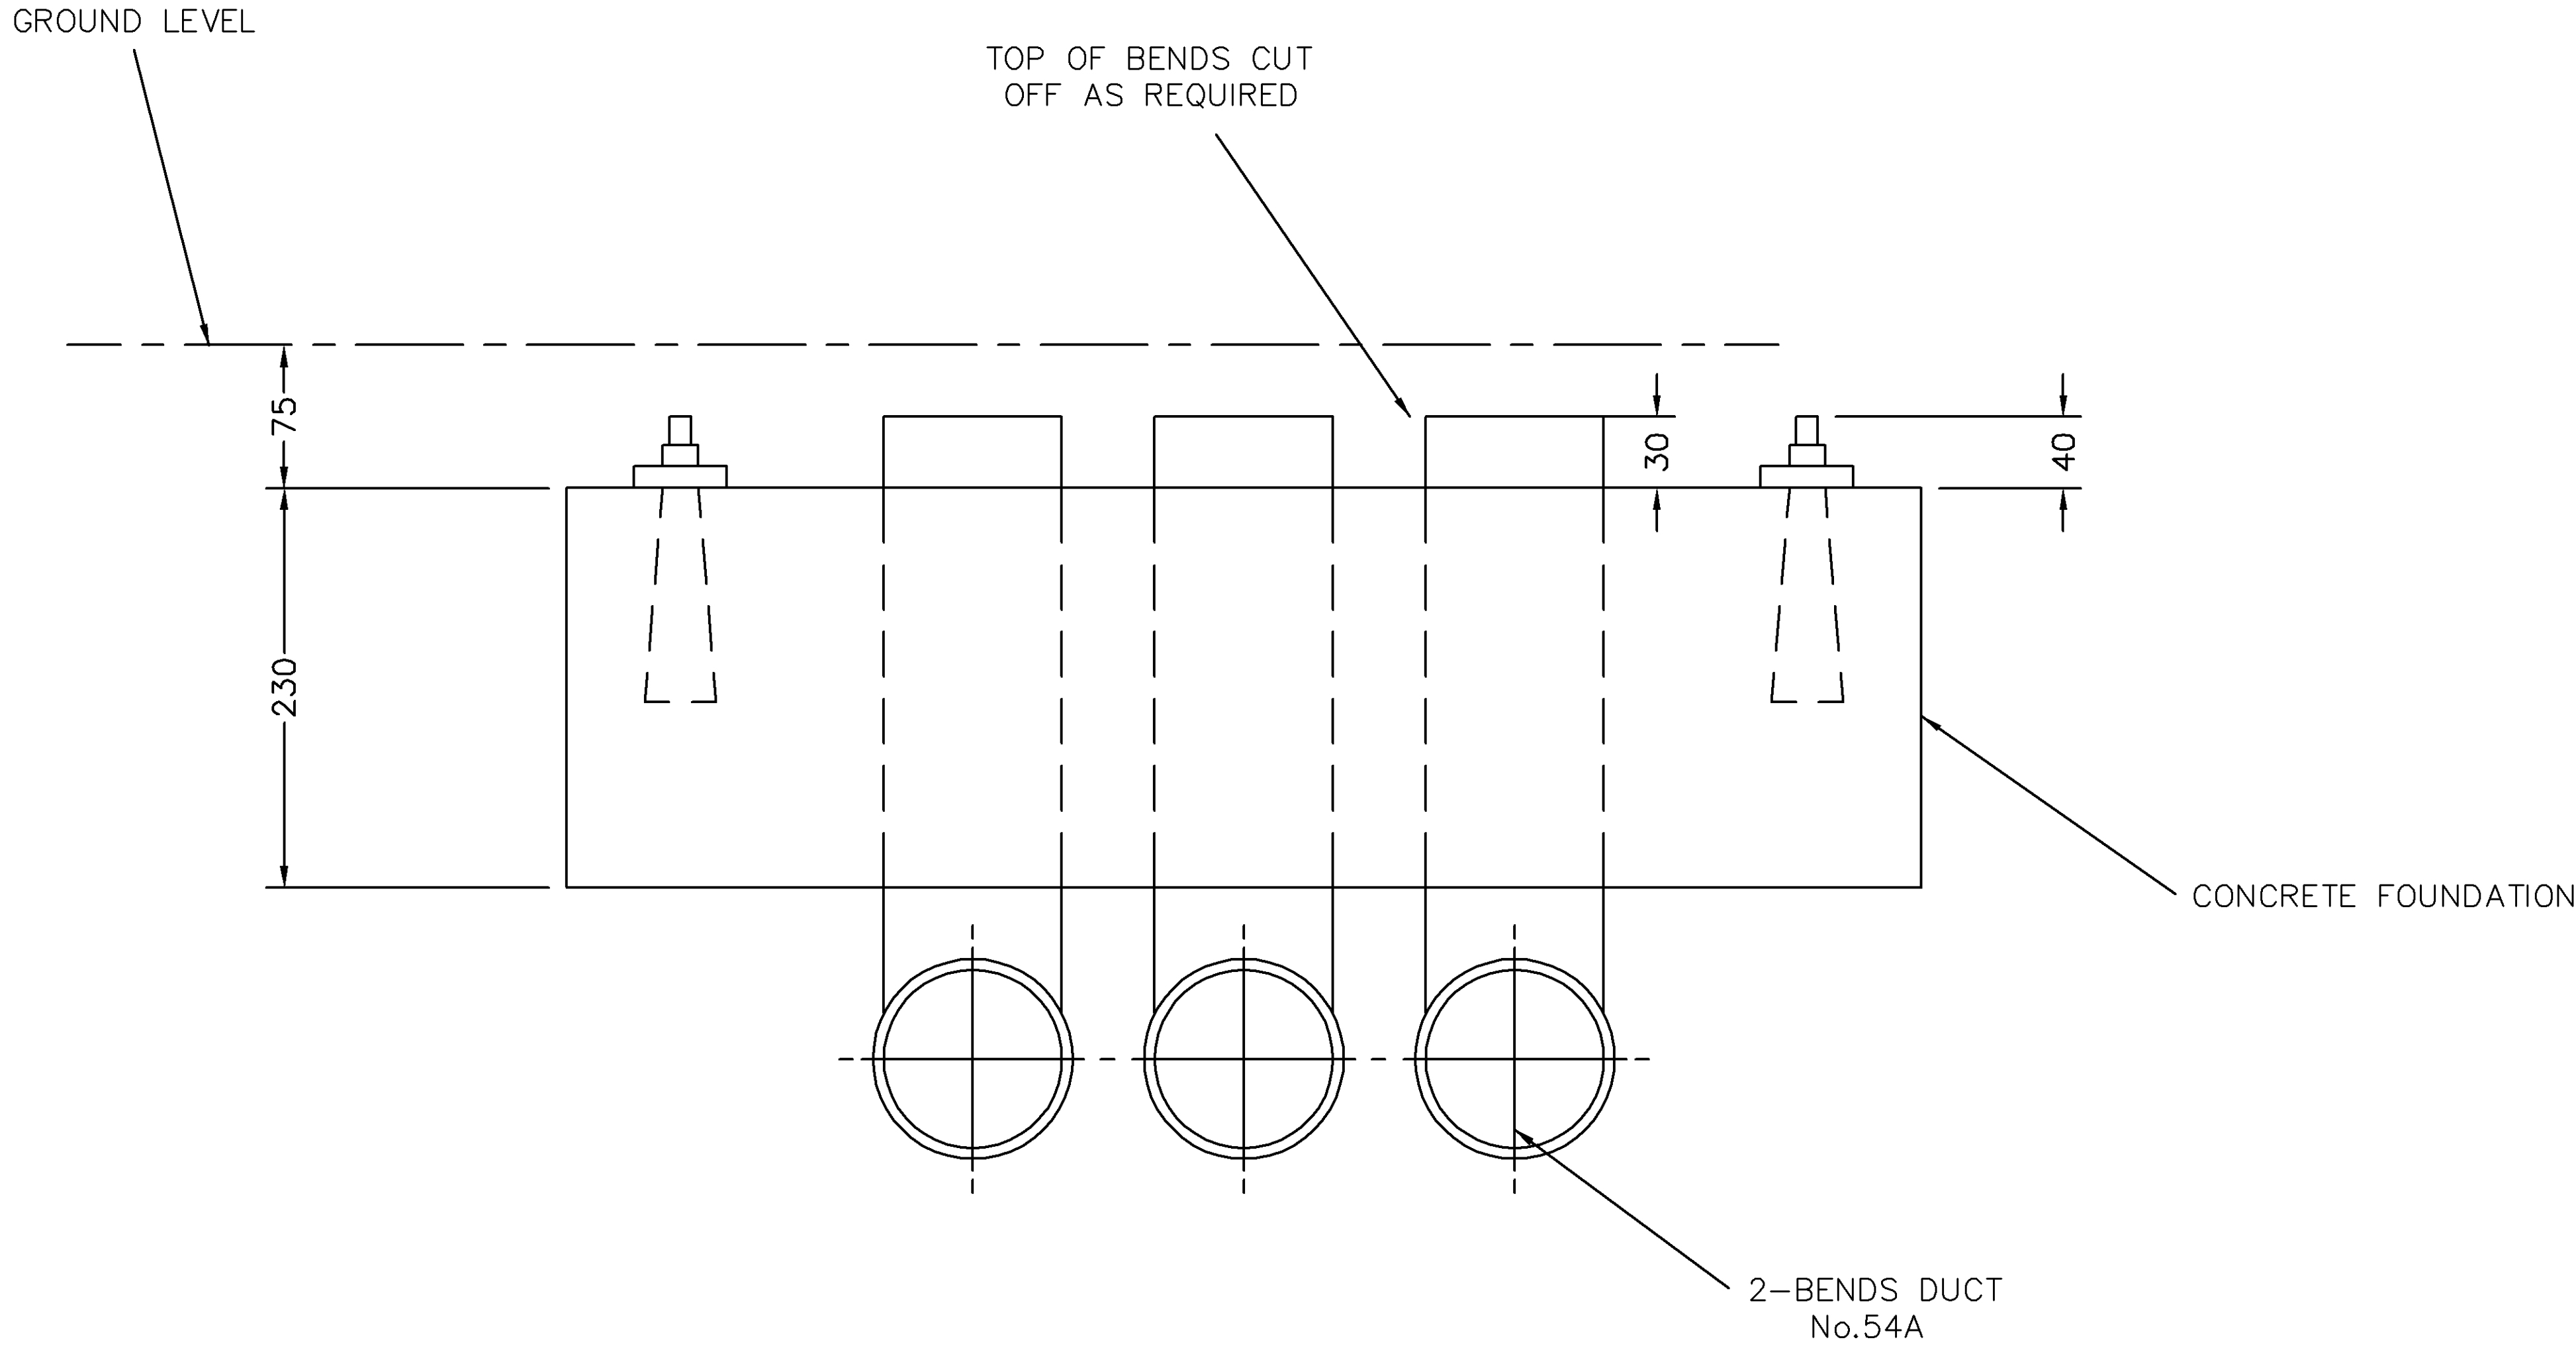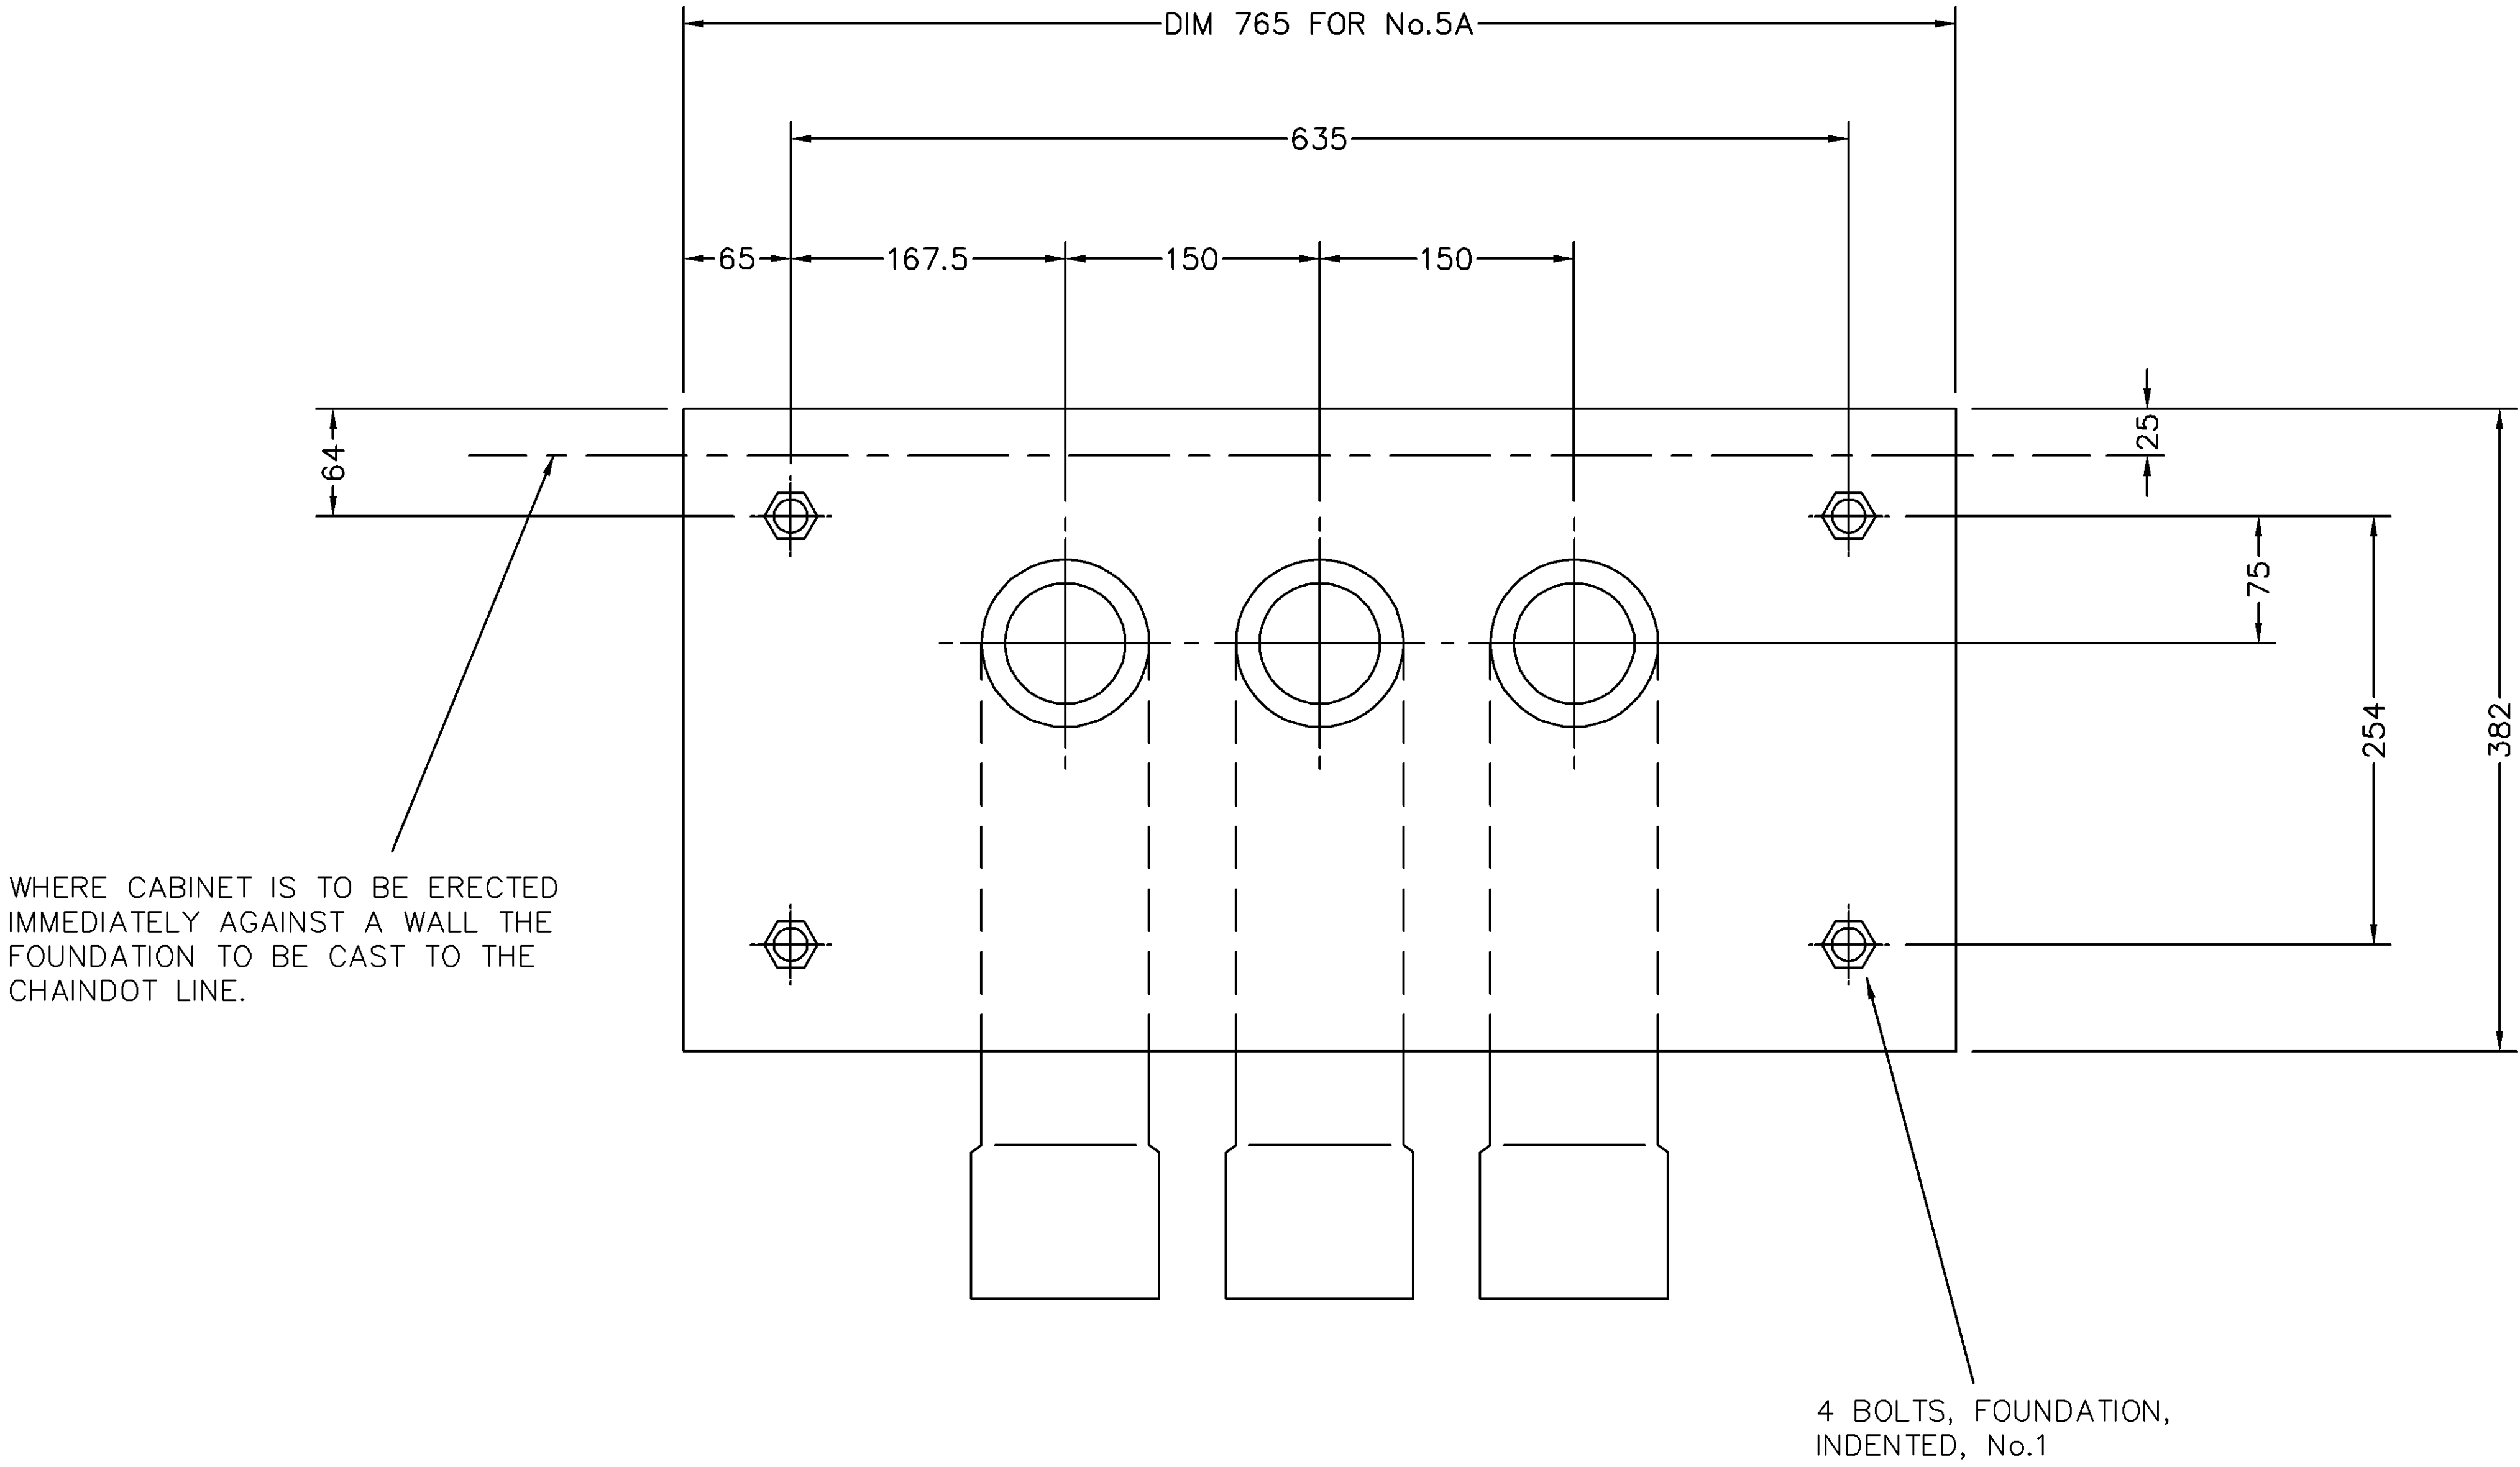

DETAILS OF CONCRETE FOUNDATIONS

A1 A2	DRN S.E.M. CKD GAC	ANY MODIFICATION TO THE DRAWING OR THE USE OF ALTERNATIVE ITEMS TO THOSE SPECIFIED MUST BE AGREED WITH THE DESIGNER.	MATERIAL	AMEND ATTRIBUTES REMOVE REF TO PAINT RESIN 6b 40mm UO SIDE OF CABINET	S	Duct Position Tolerance +/-10mm	METHOD OF INSTALLATION CABINET CROSS CONNECTION No.5A		REFERENCES SPEC.LN550
	CERTIFICATION DESIGNER J.P.K. CLIENT R.H.HARRIS		FINISH						
	DATE 07/03/97		D.CUSSELLE			MM	01/09/09		
			AMENDMENT		ISSUE	OPENREACH	NC&D	CN 1464	SHT 01 OF 05