
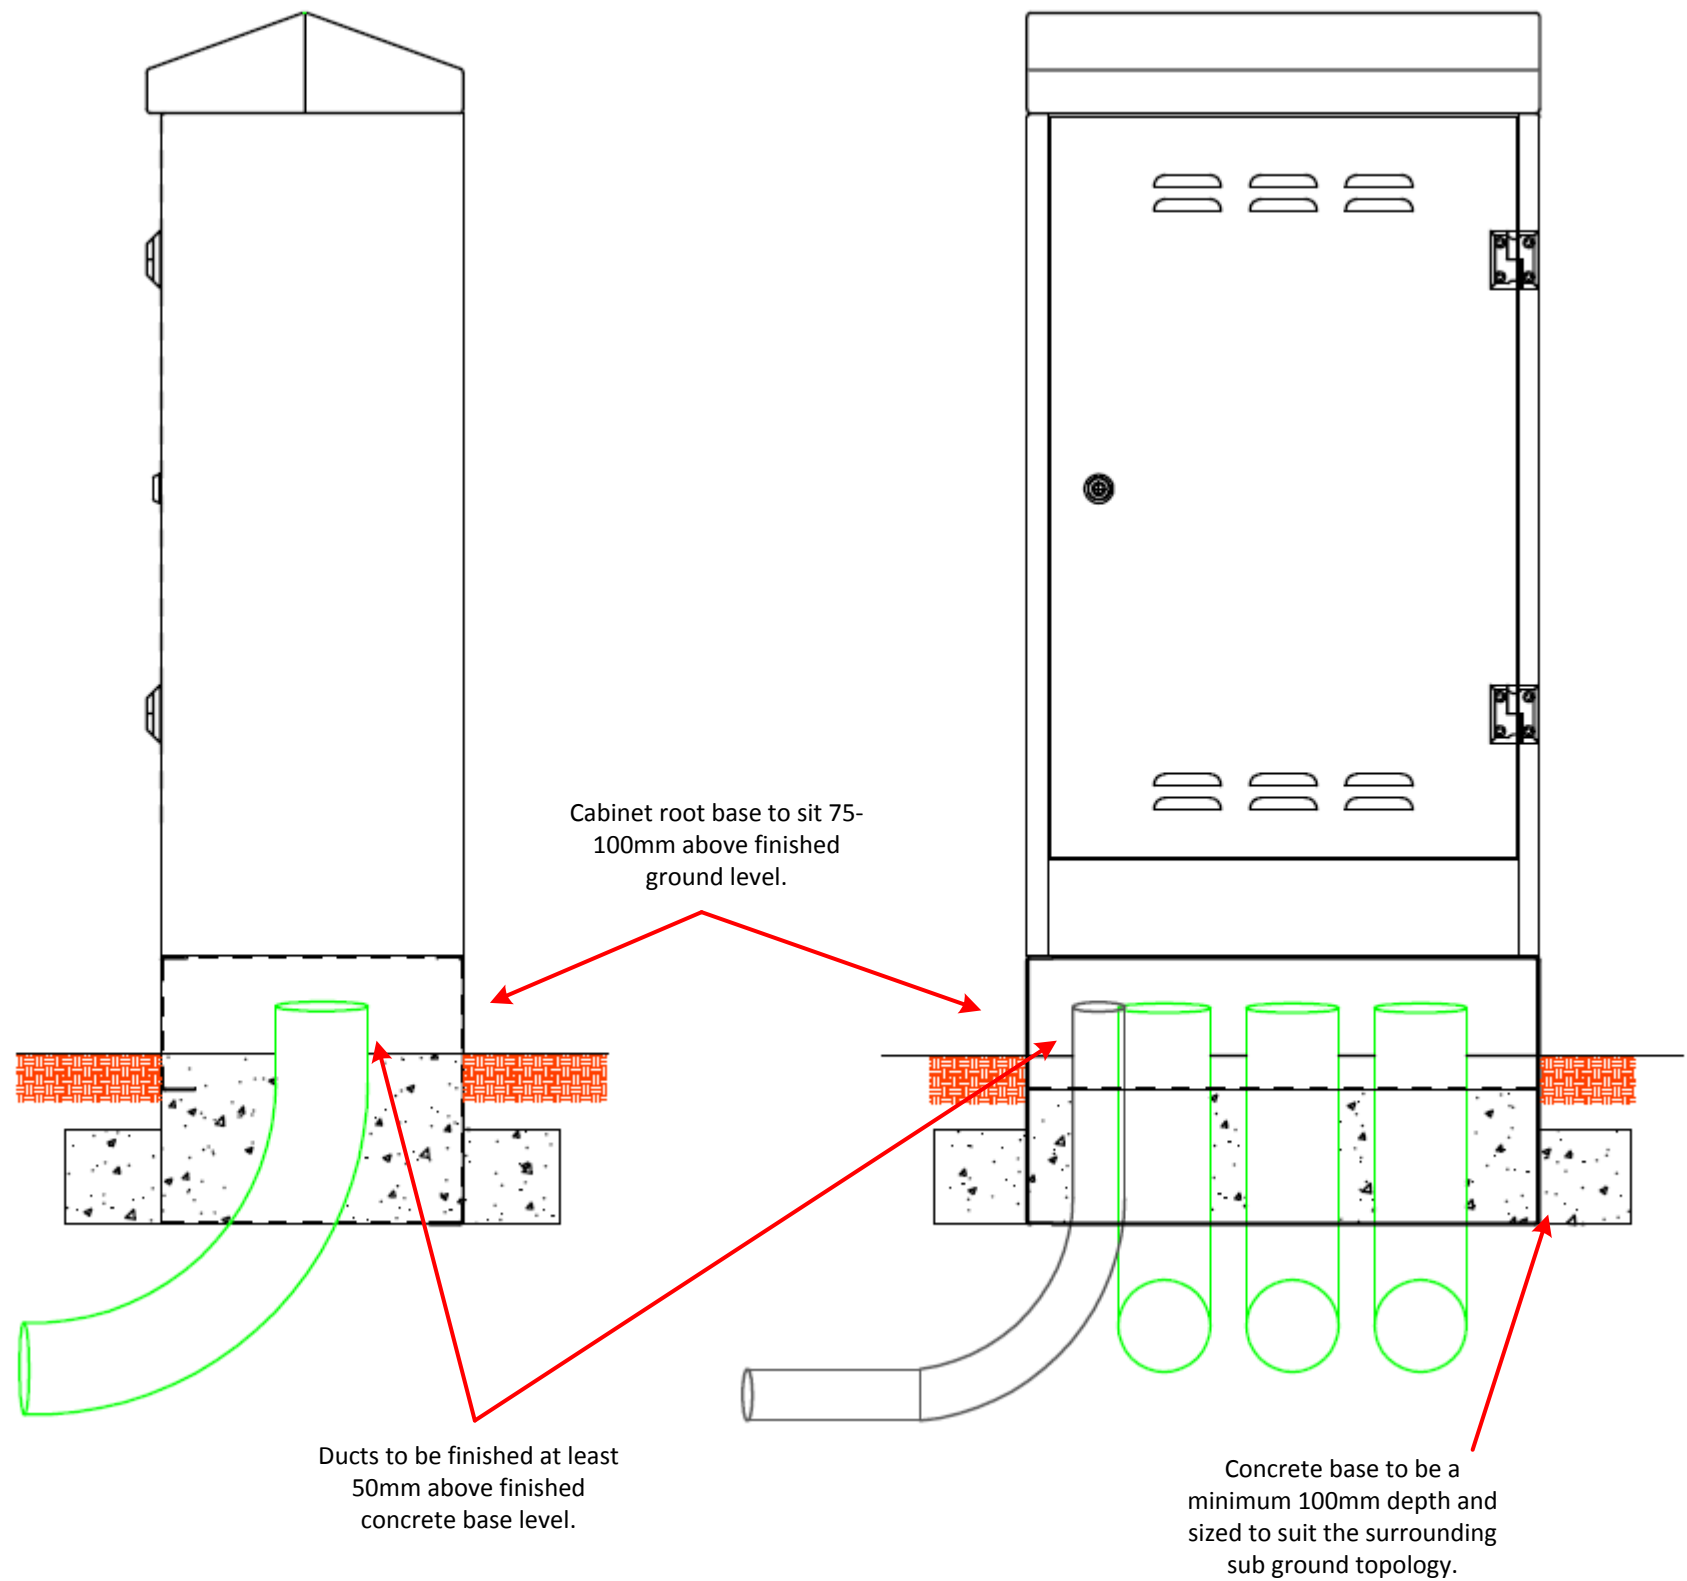


- 1. All civils work to be carried out in conjunction with the Virgin Media specification.
- 2. Earth rod installation to be carried out in conjunction with NSH3529.
- 3. All Ducts to be green unless otherwise stated.
- 4. Earth rod to protrude no more than 75mm.
- 5. Ducts to extend 50mm above concrete base.
- 6. C30/20 concrete to be used to cast the base.
- 7. All reinstatement to comply with NRSWA.
- 8. Finished root level to be 75-100mm above ground level.
- 9. All dimension sin millimetres unless otherwise stated.
- 10. The maximum duct configuration for the SD1 cabinet is shown below. On the instruction of the Virgin Media Delivery Engineer, the duct layout can be adjusted however duct size and colour is mandatory.

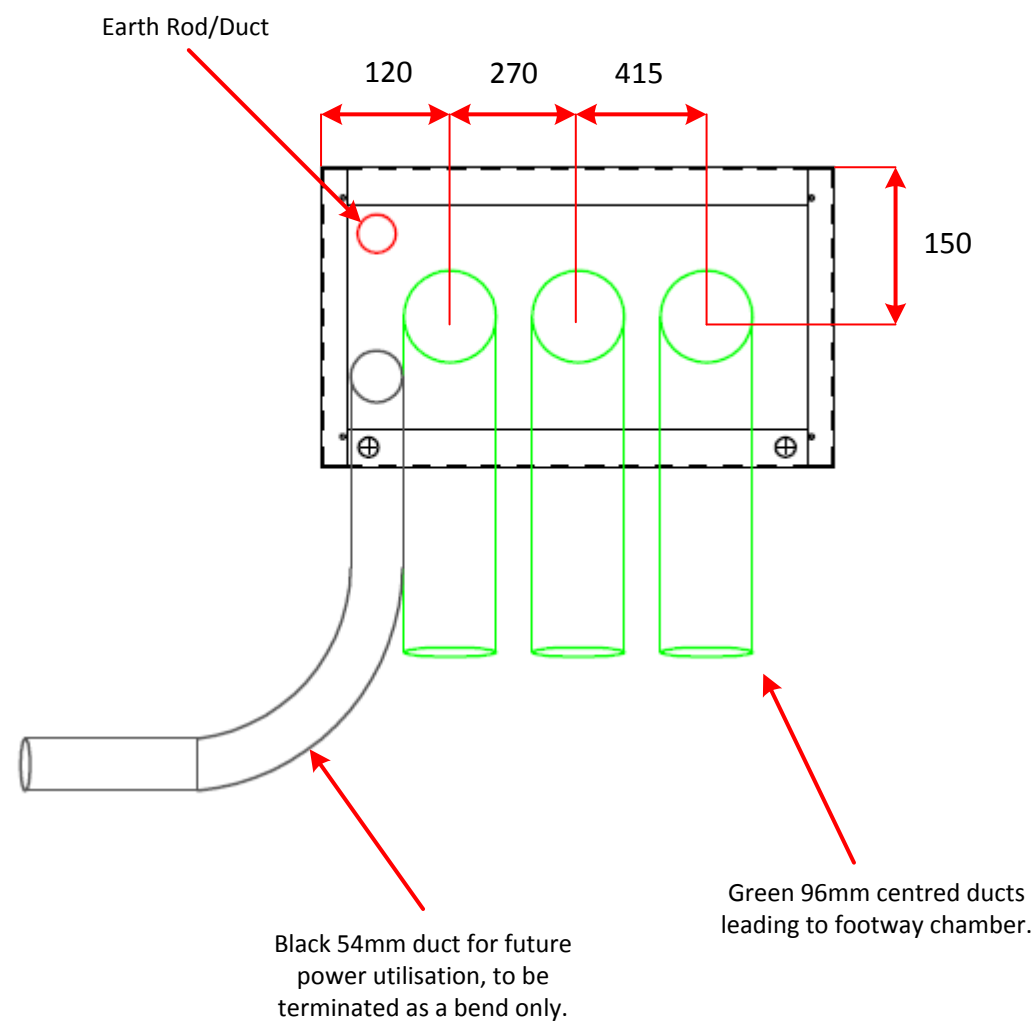

VMTD0020a

Version 1.4 Revised 17/03/14

Created By Stephen Scott

Authorised by Statutory and Standards

Drawing owned and maintained by Virgin Media Technical Drawings. For any queries or feedback please contact...

TechnicalDrawings@virginmedia.co.uk

VMSD1 Root Base and Duct Configuration

© 2014 Virgin Media Ltd. All rights reserved. No part of this publication may be reproduced, stored in a retrieval system or transmitted in any form or by any means (Electronic, Mechanical, Photocopying, Recording or otherwise) without the prior written expressed consent of the Company.