




NOTES.

1. HARDSTAND TO BE CONSTRUCTED IN ANY SROH MATERIAL SUBJECT TO APPROVAL OF LOCAL AUTHORITY. THE SURFACE MATERIAL CHOSEN MUST INCLUDE ANY BASE AND SUB-BASE TO SROH REQUIREMENTS
2. WHERE CONCRETE IS USED, GRADE C35/45 SHOULD BE USED.
3. COSOLIDATE THE BASE AS NECESSARY.
4. IF THE FAR EDGE OF HARDSTAND IS LESS THAN 200mm FROM ADJACENT PAVIOR/FLAGS, EXTEND TO SUCH PAVING.
5. WHERE CABINET HAS 2 X SIDE DOORS, 2 X HARDSTANDS WILL BE REQUIRED.
6. HARDSTAND TO BE POSITIONED DIRECTLY IN FRONT OF DOOR OPENINGS.
7. EXTENSION OF DUCTS TO OUTER EDGES OF HARDSTAND WILL BE REQUIRED TO FACILITATE EASE OF CONNECTION PICK UP.

288 STAND ALONE CABINET
SHOWN FOR ILLUSTRATION
PURPOSES ONLY.

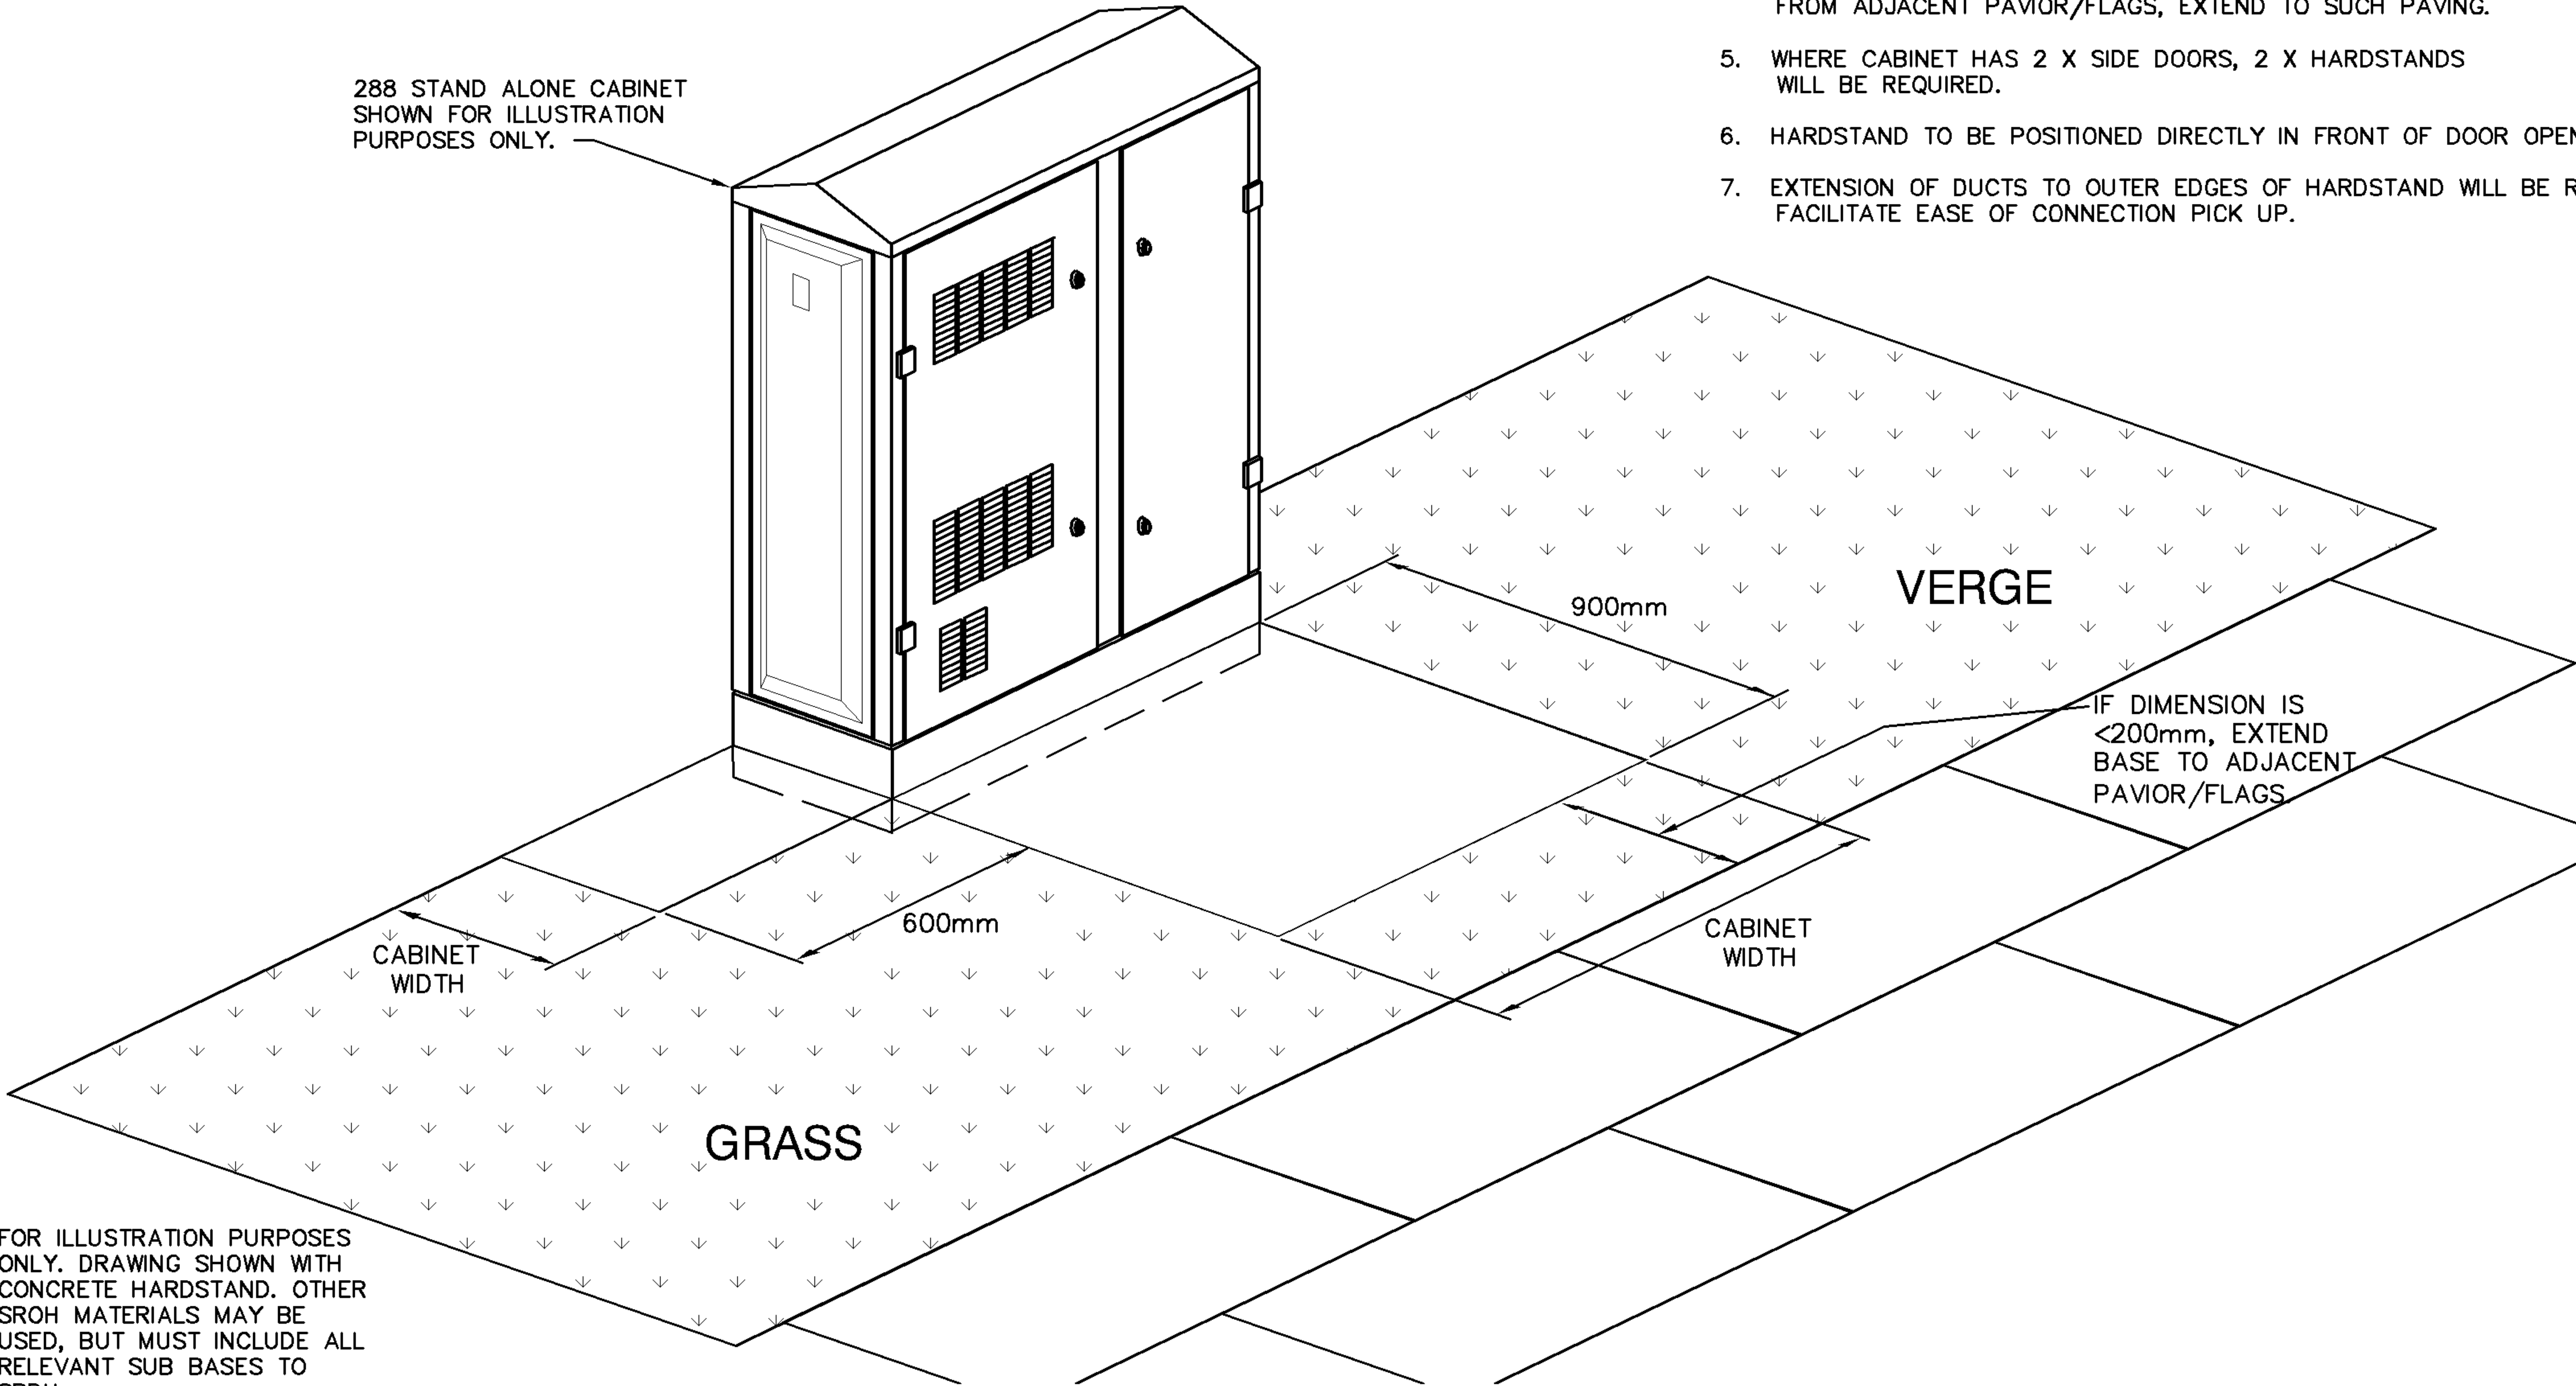

FOR ILLUSTRATION PURPOSES
ONLY. DRAWING SHOWN WITH
CONCRETE HARDSTAND. OTHER
SROH MATERIALS MAY BE
USED, BUT MUST INCLUDE ALL
RELEVANT SUB BASES TO
SRDH

A1 A2	DRN S.A.D CKD D.CUSSELLE	ANY MODIFICATION TO THE DRAWING OR THE USE OF ALTERNATIVE ITEMS TO THOSE SPECIFIED MUST BE AGREED WITH THE DESIGNER.	MATERIAL -	OMS Drawing Review Concrete grade amended	F	FTTC CABINET/S HARDSTAND IN GRASS VERGES		REFERENCES BT SPEC LN550			
	CERTIFICATION DESIGNER D.CUSSELLE		FINISH -								
	CLIENT D.CUSSELLE										
DATE 15/12/10			BT OMS 14.10.15			ISSUE Openreach		BEA3	CN 15725	SHT 01 OF 01	
			AMENDMENT								