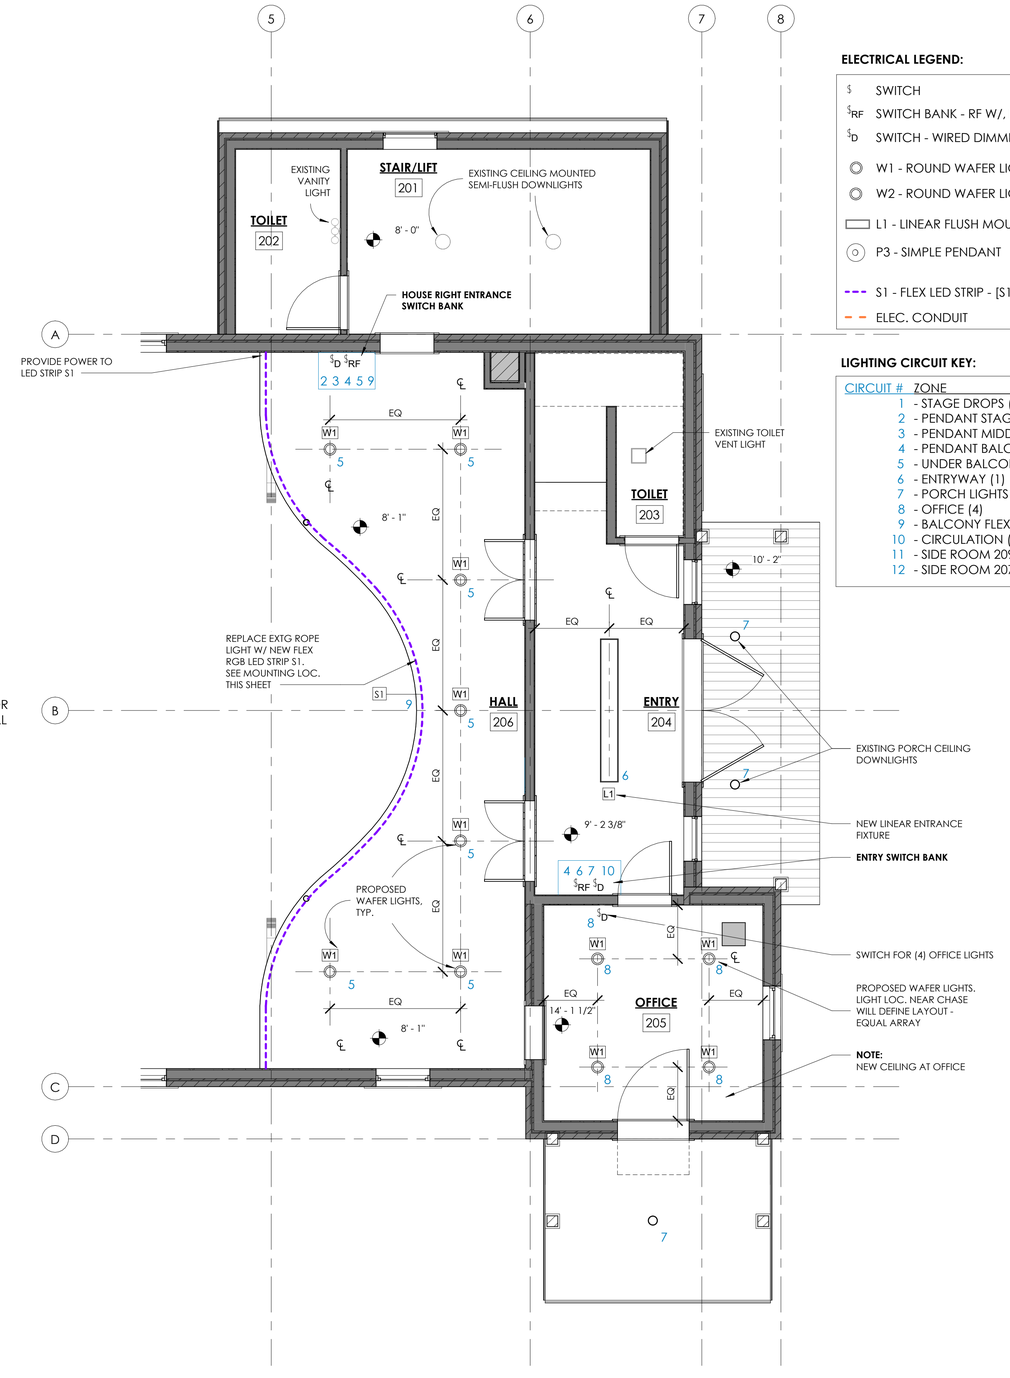


1 Reflected Ceiling Plan at Entry
1/4" = 1'-0"


ELECTRICAL LEGEND:

$	SWITCH
$RF	SWITCH BANK - RF W/, DIMMER
$D	SWITCH - WIRED DIMMER
	W1 - ROUND WAFER LIGHT 4"
	W2 - ROUND WAFER LIGHT 6"
	L1 - LINEAR FLUSH MOUNT
	P3 - SIMPLE PENDANT
	S1 - FLEX LED STRIP - [S1]
	ELEC. CONDUIT


LIGHTING CIRCUIT KEY:

CIRCUIT #	ZONE
1	- STAGE DROPS (2)
2	- PENDANT STAGE (2)
3	- PENDANT MIDDLE (4)
4	- PENDANT BALCONY (3)
5	- UNDER BALCONY WAFERS (7)
6	- ENTRYWAY (1)
7	- PORCH LIGHTS (3)
8	- OFFICE (4)
9	- BALCONY FLEX STRIPS (2)
10	- CIRCULATION (OPTION)
11	- SIDE ROOM 209 (1)
12	- SIDE ROOM 207 (1)

ELECTRICAL AND LIGHTING NOTES:
1. EXTG/ NEW WIRING NOT INDICATED.
2. LIGHT COLOR TEMP SHOULD MATCH THROUGHOUT. WE BELIEVE THIS IS 3000K BUT SHOULD BE VERIFIED.
3. LIGHT FIXTURES W/O TAGS ARE EXTG. TO REMAIN. ANY REMAINING INCANDESCENT/ FLOURO BULBS SHOULD BE SWAPPED TO LED (DIMMABLE)
4. PROVIDE CONDUIT WITH PULL STRINGS FOR FUTURE USE AS INDICATED. - VERIFY NEEDS WITH OWNER.
5. SWITCH BANKS ARE RF SWITCHES (LUTRON CASETA) WITH CIRCUITS AS INDICATED UTILIZING WIRED / WIRELESS CONNECTIONS AS NEEDED.
6. REFER ALSO TO DRAWINGS AND SPECS BY DARKSTAR THAT DETAIL A/V REQUIREMENTS
7. PROVIDE POWER AND NET/DMX (CAT) TO BOX BOOM AND BALCONY LOCATIONS AS INDICATED ON DARKSTAR DWGS. NET/DMX POSSIBLY FUTURE VIA CONDUIT INSTALLED NOW - VERIFY WITH OWNER

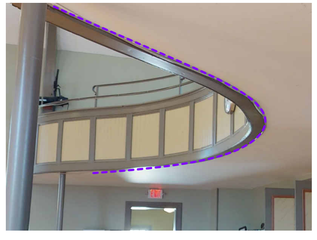

UNDER BALCONY FLEX STRIP LIGHT LOCATION (DOWN LIGHT)

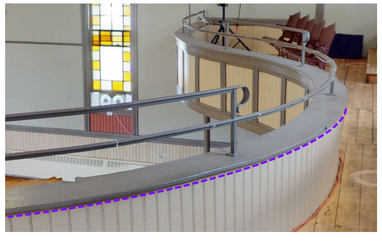

BALCONY FLEX STRIP LIGHT LOCATION (DOWN LIGHT)

VERMONT INTEGRATED ARCHITECTURE, PC

ANDREA MURRAY, AIA, NCARB, LEED AP
andrea@vermontintegratedarchitecture.com

ASHAR NELSON, AIA, LEED AP
ashar@vermontintegratedarchitecture.com

MEGAN NEDZINSKI, AIA, NCARB, LEED AP, CPHC
megan@vermontintegratedarchitecture.com

P.O. Box 862
Middlebury, VT 05753
802.989.7249

TYPE OF CONSULTANT
First Last
Company
email address
000.000.0000

LICENSED ARCHITECT ASHAR NELSON NO. 2969 STATE OF VERMONT

DATE ISSUED: 5/7/26
Drawn: GB
Checked: NW

REVISIONS:

BRISTOL ENERGY RESILIENCE PROJECTS

HOLLEY HALL

1 South Street,
Bristol,
VT 05443

REFLECTED CEILING PLANS

A-3.1